

PROPOSED LAYOUT PLAN

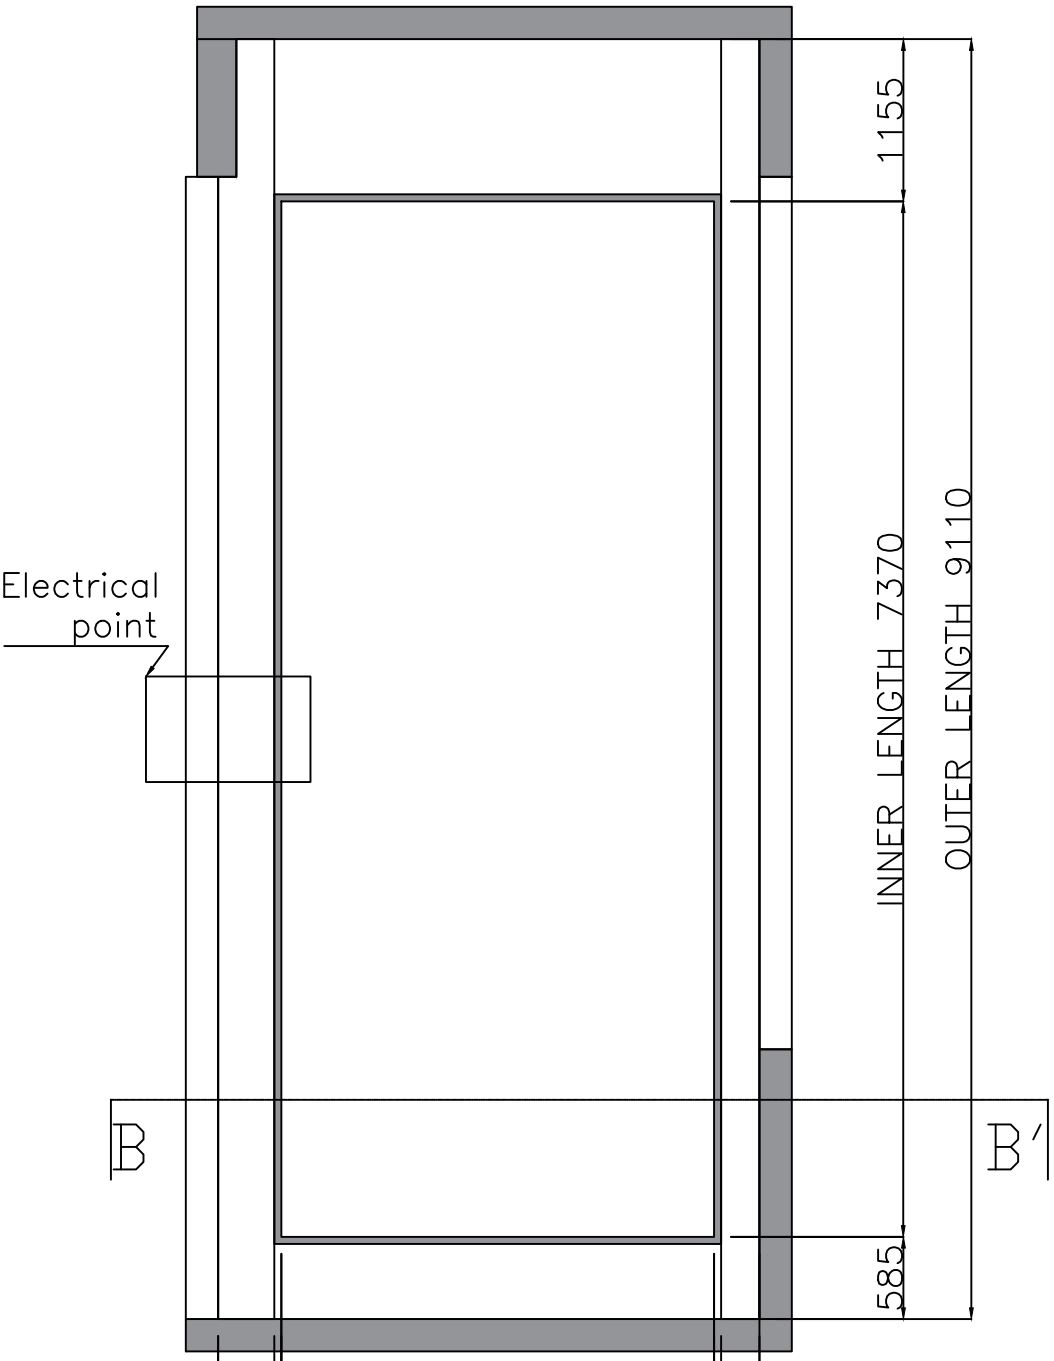

PLAN

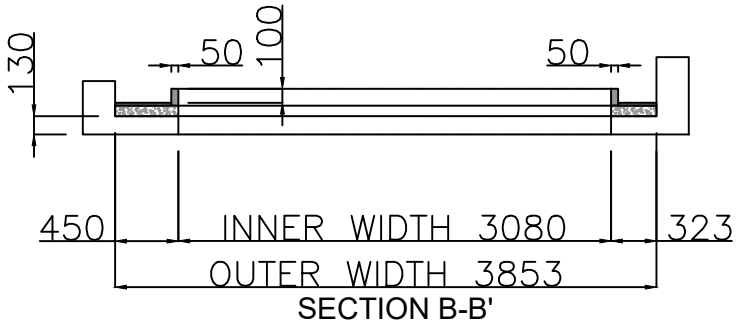

SECTION B-B'

1. THE STRUCTURE AROUND THE CUT OUT SHOULD BE OF CONCRETE FOR FOR PROPER FASTENING OF ROOF. ALL JOINT SHOULD BE LEAK PROOF.
2. TOP SURFACE SHOULD BE OF GRANITE 20MM FOR SMOOTH FUNCTIONING OF ROOF TOWARDS CONCRETE SIDE.
3. CIVIL PATTY AROUND THE CUTOUT OF 50X100 MM.
4. GRADIENT OF 50MM NEED TO BE PROVIDED ALONG THE OUTER LENGTH TO AVOID WATER STAGNANCY IN GUIDE RAIL.
5. ELECTRICAL REQUIREMENT - 220V 5AMP SINGLE PHASE CONNECTION.
6. ALL DIMENSION IN MM.