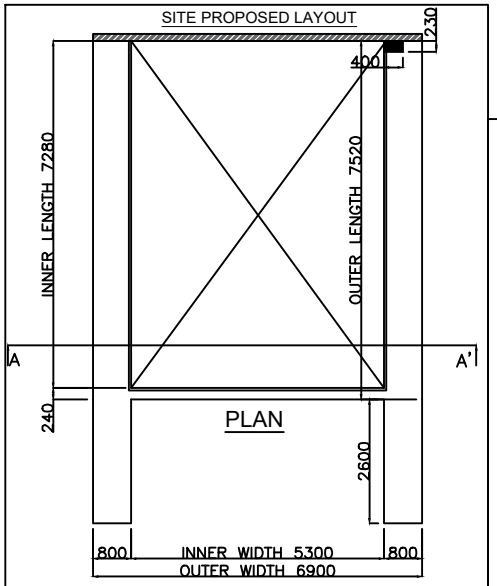
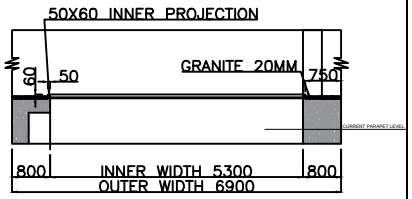
SITE PROPOSED LAYOUT



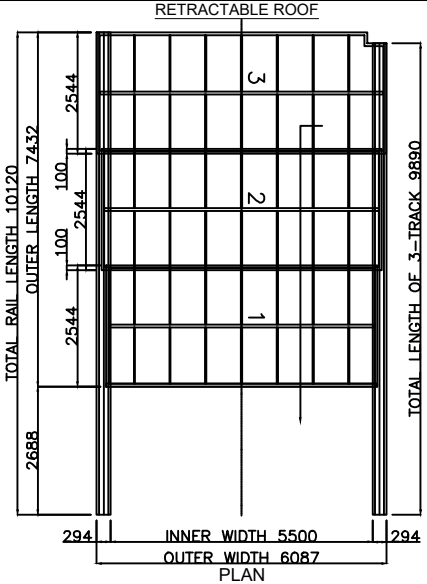

PLAN





SECTION A-A'

1. THE STRUCTURE SHOULD BE OF CONCRETE FOR FOR PROPER FASTENING OF ROOF.
2. INNER PROJECTION OF 50X60MM REQUIRED AS A SINGLE STRUCTURE WITHOUT ANY JOINT TO AVOID WATER SEEPAGE INSIDE.
3. TOP SURFACE SHOULD BE OF GRANITE FOR SMOOTH FUNCTIONING OF ROOF.
4. GRADIENT OF 50MM NEED TO BE PROVIDED ALONG THE OUTER LENGTH TO AVOID WATER STAGNANCY IN GUIDE RAIL.

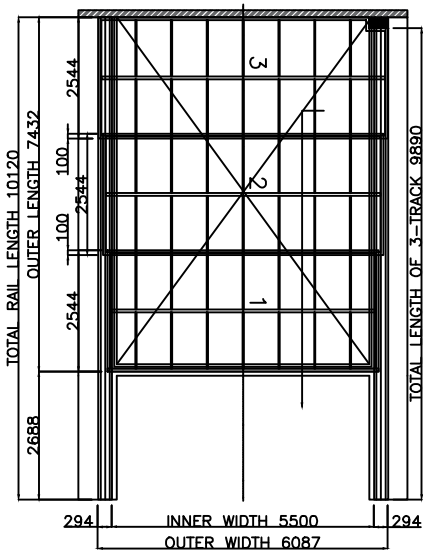
RETRACTABLE ROOF



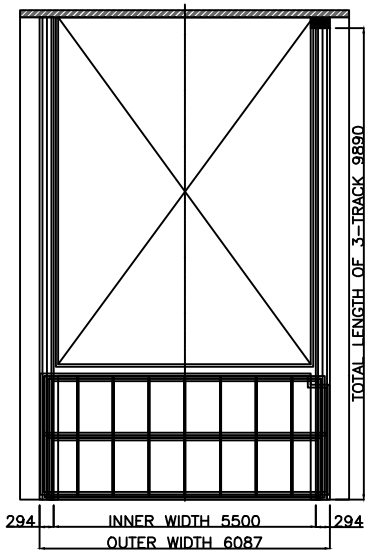

PLAN



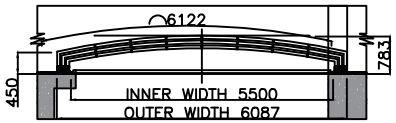

SECTION VIEW




ENCLOSED VIEW




STACKED VIEW




SECTION VIEW

This drawing & design is the property of NIHVA TECHNOLOGIES. Not to be sold or copied to any other concern.

TITLE
COURTYARD
MR. KHIVANSARA

| | NAME | SIGN | DATE |
|---|---|---|---|
| DRAWN | G.J. | | 12.10.19 |
| CHECK | G.J. | | 12.10.19 |
| APPRD. | A.K. | | 12.10.19 |

NIHVA TECHNOLOGIES PVT. LTD.

NIHVA TECHNOLOGIES
PVT. LTD. PUNE
Tel : 020 66304033
Email:- info@nihva.com
Website:- www.nihva.com

If any queries contact : projectsautomation@nihva.com

NIHVA\19-20\0127 | REV- 0

ALL DIMENSION ARE IN mm | SCALE: NTS | SHEET: 01 OF 01