

SCHEDULE OF COLUMNS AND FOOTINGS


SR. NO.	FOOTING ID	FOOTING SIZE				FOOTING REINFORCEMENT				COLUMN NOS.	PEDESTAL SIZE		COLUMN REINF. MAIN REINF.	
						BOTTOM		TOP						
		A	B	D	d	A1	B1	A2	B2		a	b	A5	LINKS (A6)
1	F1	900	900	450	–	Y12@125±	Y12@125±	Y10@200±	Y10@200±	C1	350	350	8–Y12	Y8@150±

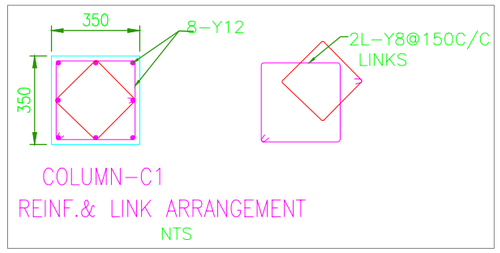


COLUMN–C1
REINF.& LINK ARRANGEMENT
NTS

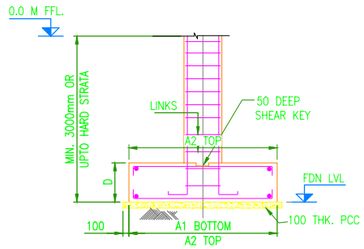


SECT.1–1



PLAN
TYP. DET. FOR
COMBINE FOOTING–F1
NTS

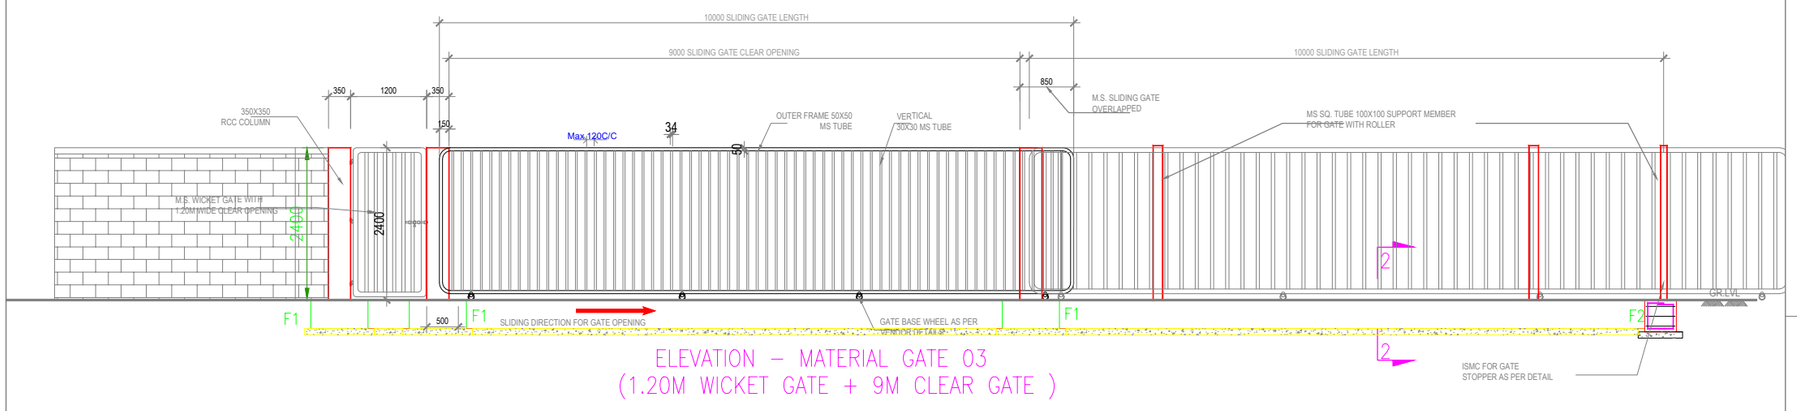


ELEVATION – MATERIAL GATE 03
(1.20M WICKET GATE + 9M CLEAR GATE)

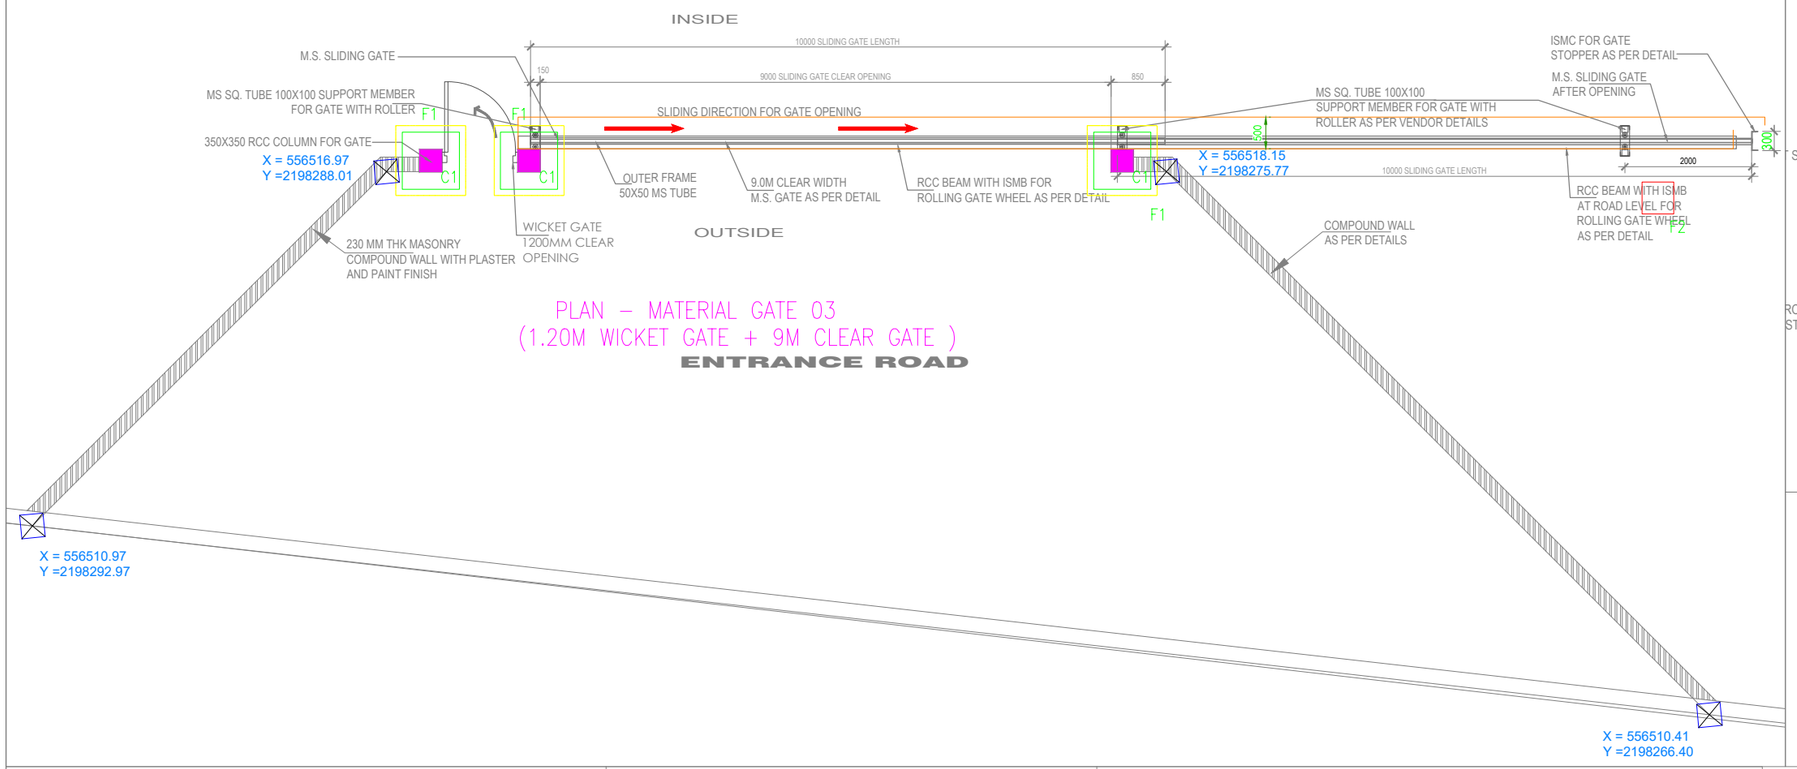


PLAN – MATERIAL GATE 03
(1.20M WICKET GATE + 9M CLEAR GATE)
ENTRANCE ROAD


SIDE

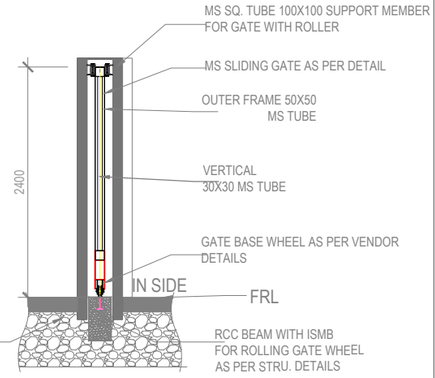


TYP. SECTION

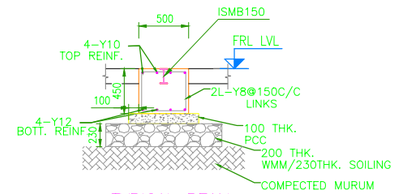

TYPICAL BEAM
REINF.& LINK ARRANGEMENT
SECTION 2–2



F2



DETAIL OF –F2

LEGEND

FGL	FORMED / FINISHED GROUND LEVEL		RCC
EL	ELEVATION		PCC
FFL	FINISHED FLOOR LEVEL		BLOCK MASONRY
℄	CENTER LINE	T&B	TOP AND BOTTOM
TYP.	TYPICAL	BF	BOTH FACES
LVL.	LEVEL	SECT.	SECTION
THK.	THICK / THICKNESS	PCC	PLAIN CEMENT CONCRETE
DET.	DETAIL	BW	BOTHWAY
RCC	REINFORCED CEMENT CONCRETE	R/F	REINFORCEMENT
FDN.	FOUNDATION	REF.	REFERENCE
C	STEEL COLUMN/BEAM	MIN.	MINIMUM
F.	FOOTING	PB	PLINTH BEAM
NTS	NOT TO SCALE	SP	STIFFNER PLATE

ENGINEERING REFERENCE DRAWINGS

1. KOHL_EX_ARCH_MAT.GATE–03 DETAIL

CONSTRUCTION REFERENCE DRAWINGS

1. KOHL_EX_ARCH_MAT.GATE–03 DETAIL

HOLD

XX

NOTES

1. ALL DIMENSIONS ARE IN MILLIMETERS & ELEVATIONS & COORDINATES IN METERS UNLESS OTHERWISE NOTED.
2. IF DOUBT ASK, DO NOT SCALE THE DRAWING
3. FFL 0.00M REFERS TO FINISHED FLOOR LEVEL
4. ALL STRUCTURAL CONCRETE SHALL BE OF GRADE M25 WITH 20 MM DOWNGRADED AGGREGATE UNLESS NOTED.
5. 'Y' INDICATES HIGH YIELD STRENGTH Fe500 DEFORMED BARS CONFORMING TO IS 1786.
6. AS PER GEOTECHNICAL REPORT SAFE BEARING CAPACITY (SBC) IS CONSIDERED 20 TON/SQ.M AT FOUNDING LEVEL OF –3.0 MT BELOW FGL. CONTRACTOR TO VERIFY SBC AT THIS LEVEL BEFORE CONSTRUCTION OF FOUNDATIONS, IF THE VALUES OF SBC FOUND TO BE LESS SHALL BE COMMUNICATED TO DESIGN OFFICE. ALL FOUNDATIONS SHALL RESTS ON HARD STRATA ONLY.
7. EXITING LEVELS AND CENTRELINES FOR COLUMNS SHALL BE CROSSED ON SITE BEFORE EXECUTION.
8. STABILITY OF STRUCTURE DURING CONSTRUCTION IS CONTRACTORS RESPONSIBILITY.

R0	MD 12/05/2023 2008–28–0006	
R1	MD 12/07/2023 2008–28–0006	

ACAD# KOHL_PCPL_STR_GATE–3_WESTSIDE_A130