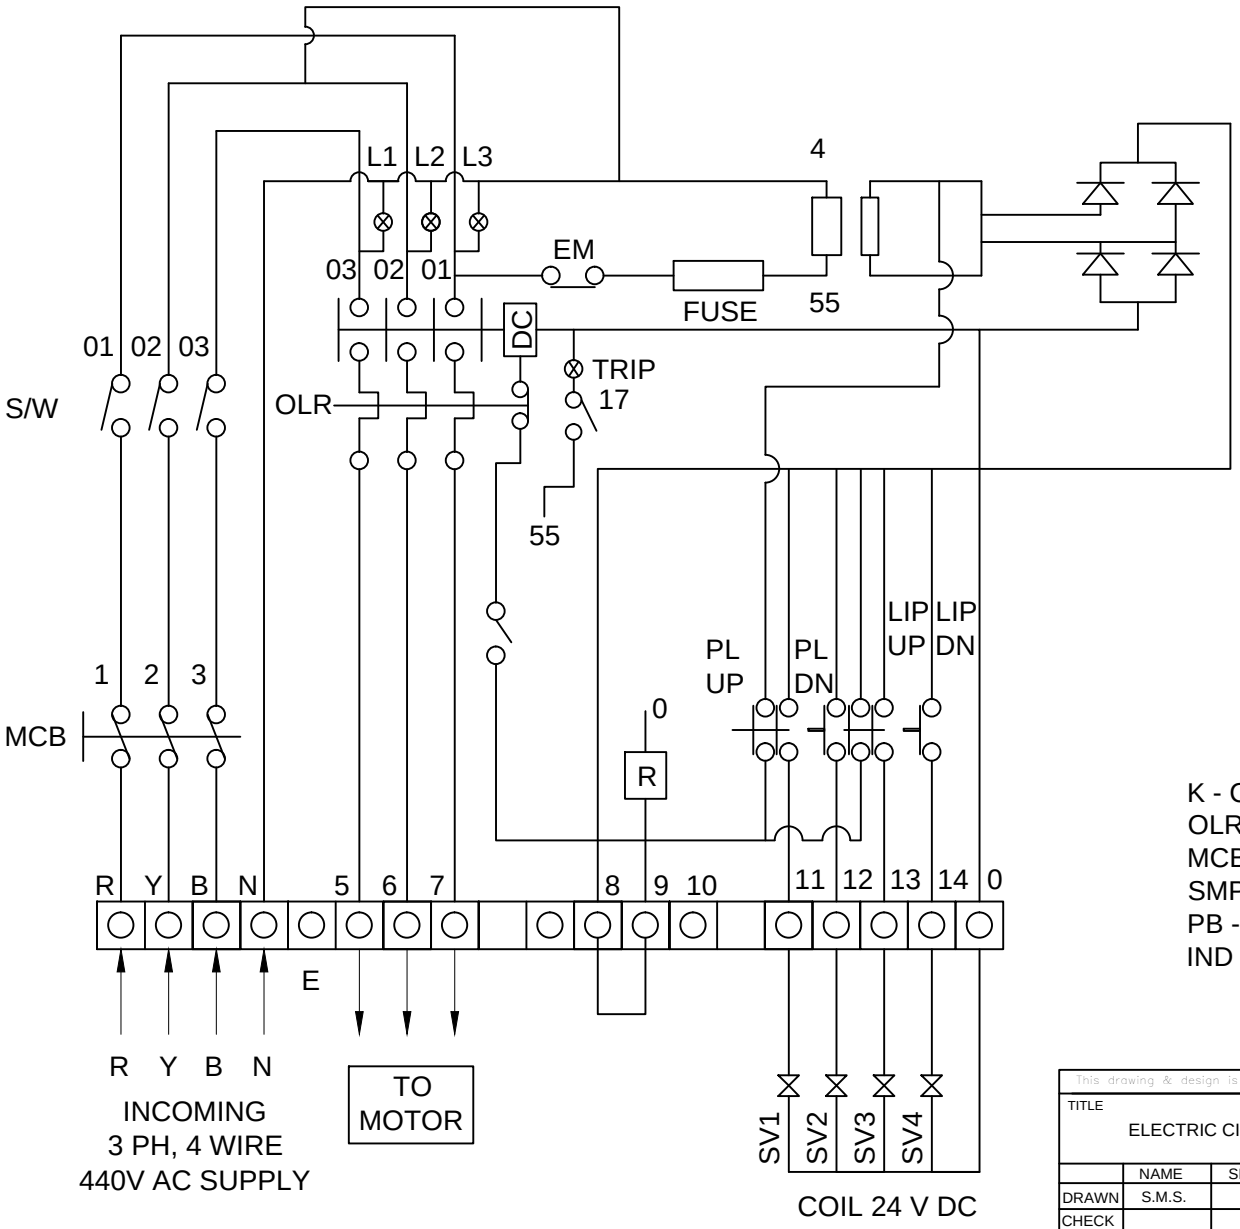

K - CONTACOR DC
OLR - 1.4 - 2.5 +AD
MCB - 3P-10AMP
SMPS - 3 AMP
PB - PUSH BUTTON + NO
IND - L1 L2 L3 INDICATION PHASE FAILURE

This drawing & design is the property of NIHVA TECHNOLOGIES. Not to be sold or copied to any other concern.

TITLE	ELECTRIC CIRCUIT			NIHVA TECHNOLOGIES PVT. LTD. PUNE
	NAME	SIGN	DATE	Tel : 020 66304033
DRAWN	S.M.S.		16.12.2020	Website:- www.nihva.com Email:- info@nihva.com
CHECK				CLIENT - L&T HYDROCARBON
APPRD.				PROJECT - IOCL
				SITE LOCATION -
If any queries contact : design@nihva.com				DWG. NO. : NIHVA/20-21/VDR/0089 REV- 0
ALL DIMENSION ARE IN mm				SCALE: NTS WT: SHEET: 01 OF 01