

PROPOSED PLAN LAYOUT_1

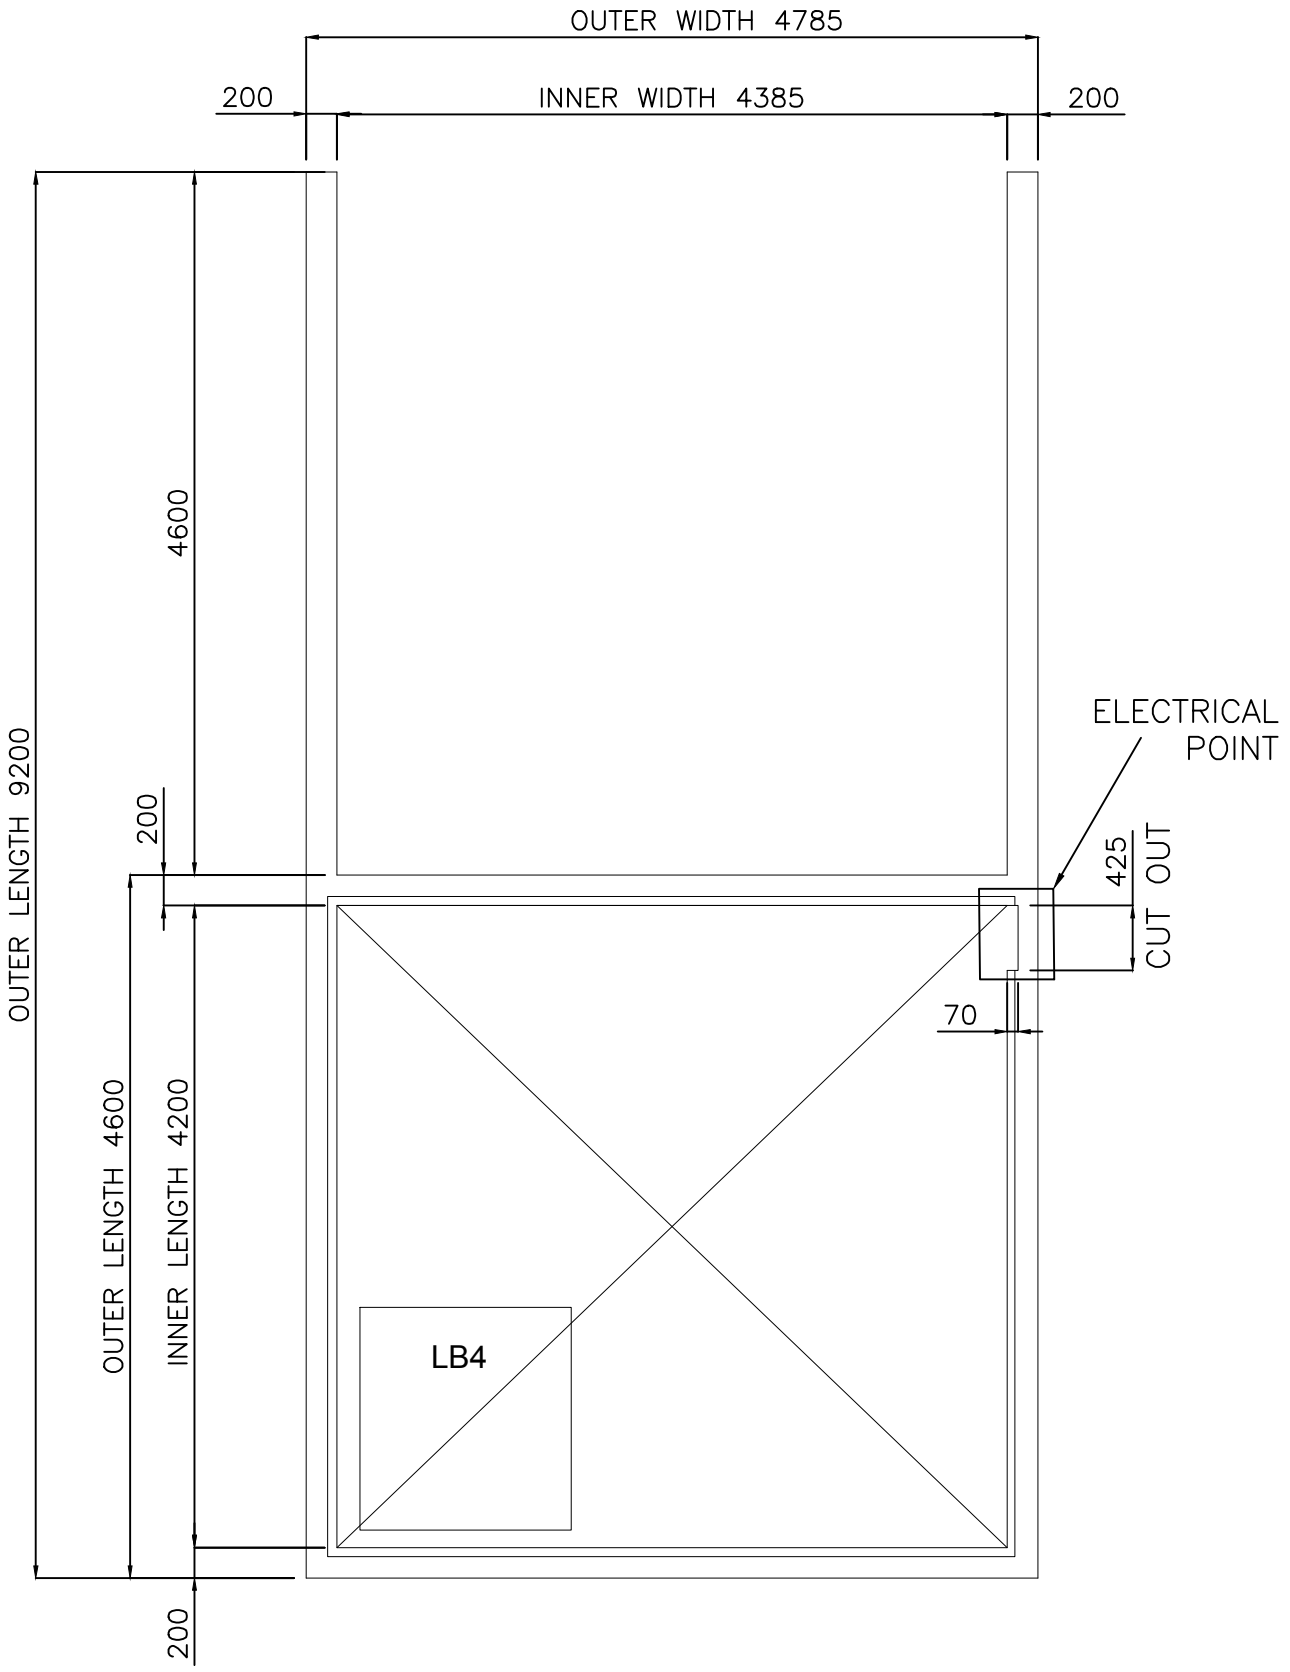

PROPOSED PLAN

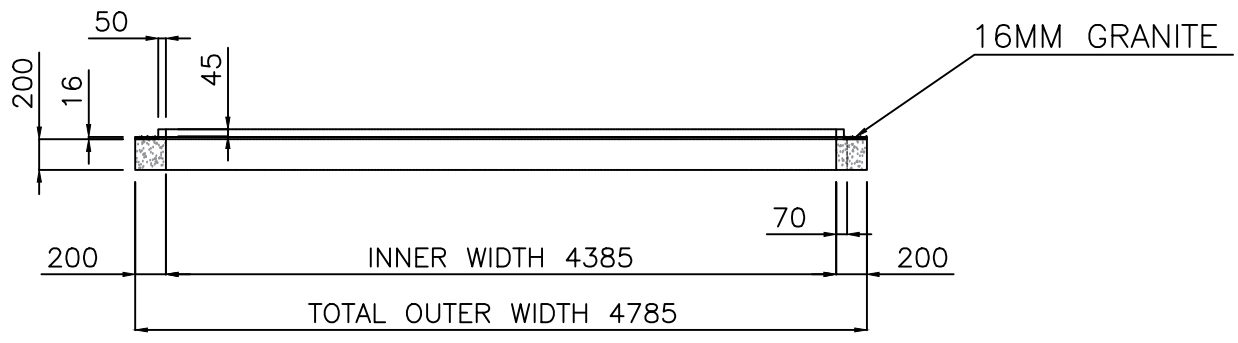

SECTION VIEW

1. THE STRUCTURE AROUND THE CUT OUT SHOULD BE OF CONCRETE FOR PROPER FASTENING OF ROOF.
2. TOP SURFACE SHOULD BE OF GRANITE 16MM FOR SMOOTH FUNCTIONING OF ROOF.
3. GRADIENT OF 45MM NEED TO BE PROVIDED ALONG THE OUTER LENGTH TO AVOID WATER STAGNANCY IN GUIDE RAIL.
4. REQUIRED POER SUPPLY IS 450W, 230V DC
5. CIVIL CUTOUT FOR MOTOR MOUNTING AS PER MENTIONED IN DRAWING
6. AL PROFILE - POWDER COATED , RAL-9007
7. GASKET - EPDM
8. MOTOR -NICE MAKE ITALIAN
9. ELECTRICAL POINT REQUIREMENT
10. ALL DIMENSION IN MM.
11. ALL CIVIL WORK IS IN CLIENT SCOPE

This drawing & design is the property of NIHVA TECHNOLOGIES. Not to be sold or copied to any other concern.

TITLE: PROPOSED PLAN LAYOUT_1 (IN CLIENT SCOPE)	NAME	SIGN	DATE	NIHVA TECHNOLOGIES PVT. LTD.	
DRAWN	D.V.		17.03.23	CLIENT - MAXIMA	
CHECK	P.M.		17.03.23	LOCATION - MUMBAI_IN	
APPRD.	V.T.		17.03.23	PRODUCT - RETRACTABLE ROOF	
If any queries contact : supportautomation@nihva.com				NIHVA\22-23\02XX	REV- 4
ALL DIMENSION ARE IN mm				SCALE: NTS	SHEET: 01 OF 01