

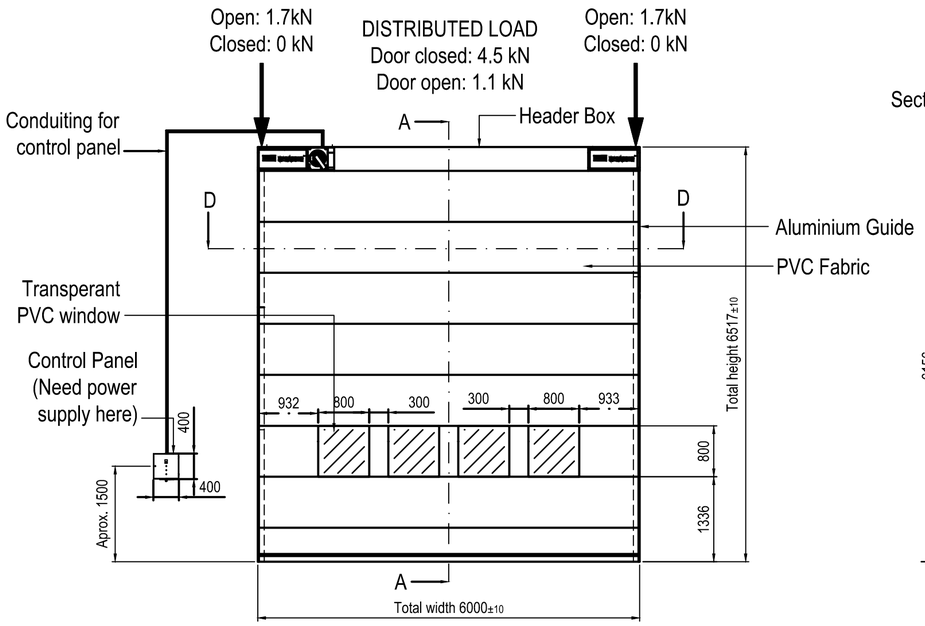


Interior view, Door closed

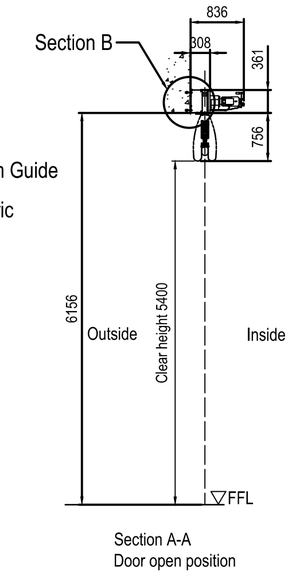


Section A-A
Door open position

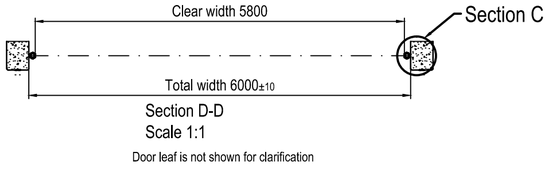


Section D-D
Scale 1:1

Door leaf is not shown for clarification

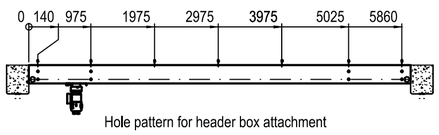


Hole pattern for header box attachment




Force by differential pressure transferred to guide rail at each intermediate position.
F= 2.7 kN


Position of intermidiate beam with guide



Load on header box attachment (each screw), due to wind load and door weight

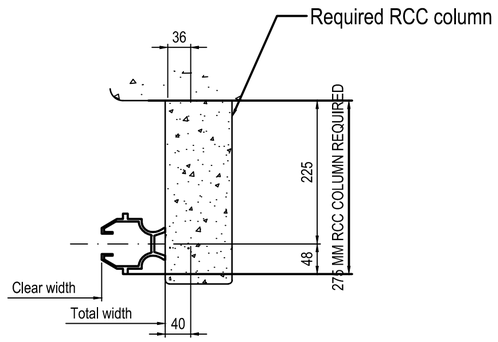

Section C
Guide Mounting Details
Scale 2:1



Section B
Header Mounting Details
Scale 2:1

NOT INCLUDED IN DOOR SUPPLY:

1. Design and supply of all door supporting structural components.
2. Design and supply of all closure between door and adjacent steel.
3. Door jambs adjustable for overall door width and true to plumb.
4. Paint job after completed door installation.
5. Any frameworks being provided by ASSA ABLOY will be clearly indicated as "by ASSA ABLOY".

REQUIREMENTS ON BUILDING:

6. Door head support must be straight within 1/600 of span in the in/out direction and free from protrusions of any kind.
7. For a single door leaf, door head support should be horizontal and straight within 1/600 of span at distributed full door load.
8. Door side jambs must be smooth, straight and parallel, out of plumb must not exceed 2mm/m (total deviation at full length 5 mm) in any direction.
9. Any footings at bottom of jamb columns must not interfere with installation of guide rails at floor level.
10. At time of installation, finished floor, free from obstructions, out to a distance of 2 m on each side of door centreline must be available.
11. Header box must be accessible from both sides during installation.


DOOR PROPERTIES:

12. The door is designed to withstand a differential pressure of 1.15kPa X 1.5 FOS.
13. Metal trim: motor side
14. Side profiles
15. Fabric colour: Please specify

ELECTRICAL:

14. One main control panel provided of PLC type.
15. Audible and visual alarm
16. Safety edge
17. Back-up power switch
18. Approx. size of main control panel: WxHxD (500mm x 600mmx250 mm),
19. Power: 1.4kW
20. Nom. current: 3.3A
21. (max. allowed voltage drop at start: 5%)

BELT HOIST UNITS:
Sk 773.1-90S/4 Z dual brake

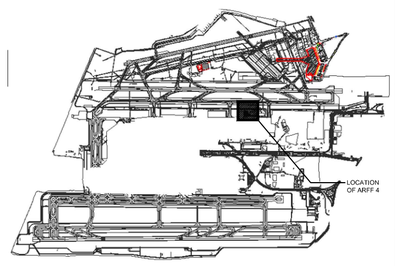

KEY PLAN (NOT TO SCALE)

NOTE:
1. 275 MM RCC COLUMN REQUIRED FOR GUIDE MOUNTING.
IF RCC COLUMN NOT AVAILABLE THEN WE WILL REQUIRE MS STRUCTURE FOR THE SAME.

REFERENCE DRAWING :

DIAL-LT-D-UTL-A-20-300 : ARFF4 FIRE STATION ELEVATIONS
DIAL-LT-D-UTL-A-20-301 : ARFF4 FIRE STATION ELEVATIONS
DIAL-LT-D-UTL-A-10-300 : ARFF4 FIRE STATION GROUND FLOOR PLAN

SHOP DRAWING

REV.NO.	DESCRIPTION	DESIGNED	DRAWN	CHECKED	APPROVED

REVISIONS

CHECKED BY	SIGN	DATE	CHECKED BY	SIGN	DATE	CHECKED BY	SIGN	DATE
ARCHITECTURE			HVAC			GIS		
CIVIL & STRUCTURAL			FPS			GEOTECH.		
ELECTRICAL			PIPING			AIRPORT SYSTEMS		
ELV SYSTEM			PHE			INTERFACE		

DELHI INDIRA GANDHI INTERNATIONAL AIRPORT GMR L&T Construction

CLIENT : DELHI INTERNATIONAL AIRPORT LIMITED

PROJECT: INDIRA GANDHI INTERNATIONAL AIRPORT PHASE-3A DEVELOPMENT WORKS

CONCEPT : ASSA ABLOY

PROJECT CONSULTANT: Engineering Design and Research Center (EDRC), L&T Construction

INSTALLED AND SUPPLIED BY: NIHA TECHNOLOGIES PVT LTD

JOB No : JOBNO.

	NAME	SIGN	DATE
DSGN	G.I.P		02.10.2021
DRWN	G.I.P		02.10.2021
CHKD	A.K.		02.10.2021
APPD	V.T.		02.10.2021

TITLE: ARFF4 MEGADOOR 5800 X 5400 (RS6)

SCALE: SCALE

DRAWING No. DIAL-LT-Q-PTB-A-HSRS-ARFF4-02 SHEET:

PROJECTION: FIRST ANGLE

SIZE: A3 REV: 0

RELEASED FOR: ☐ PRELIMINARY ☐ TENDER ☐ INFORMATION ☑ APPROVAL ☐ CONSTRUCTION