


SITE PROPOSED LAYOUT (DAVANGARE)

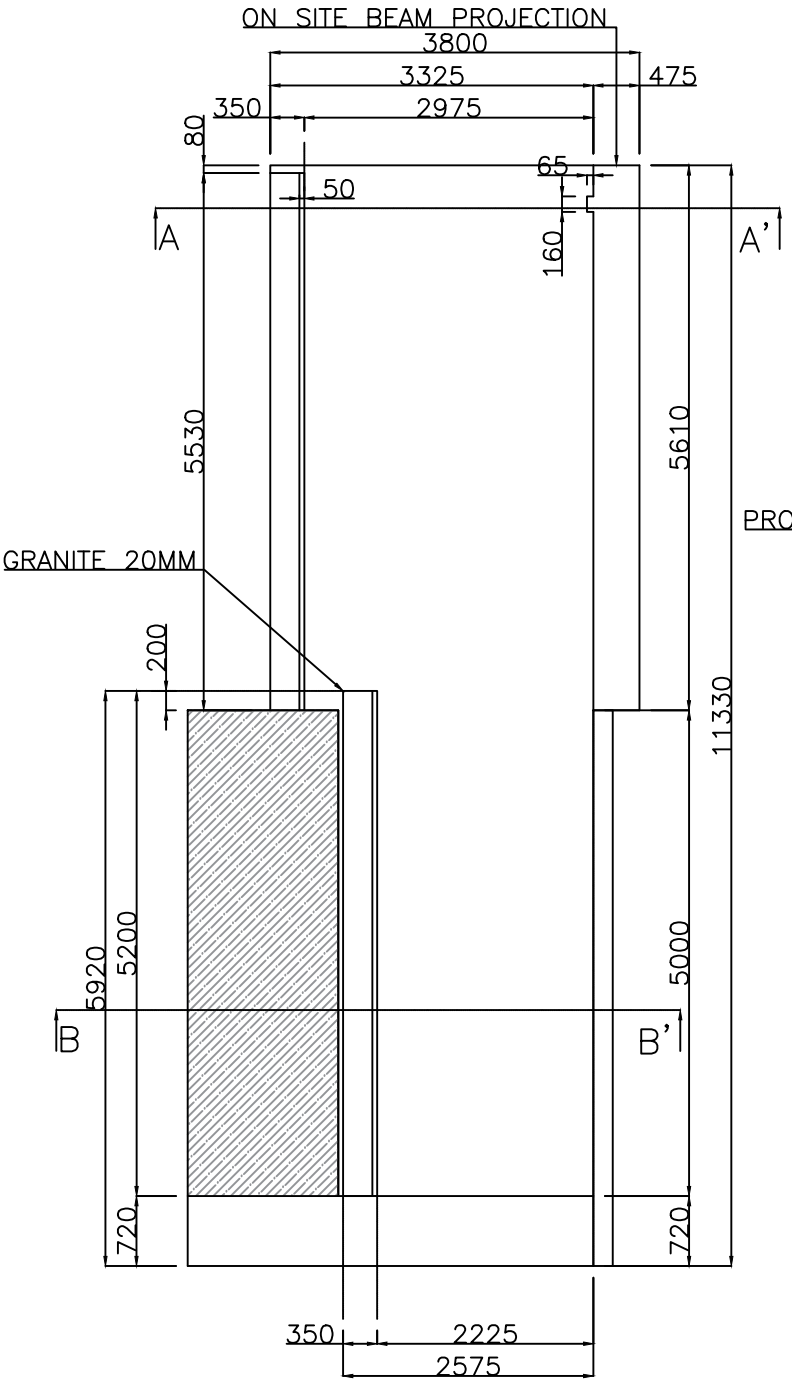

PLAN

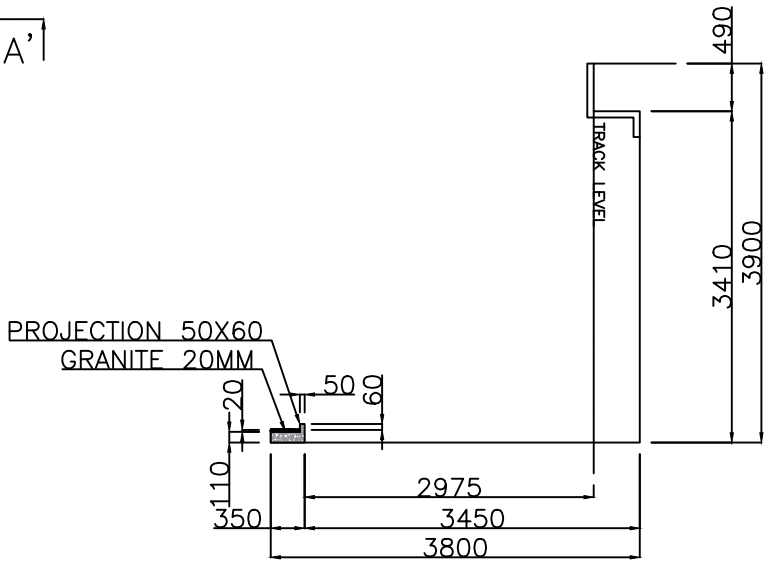

SECTION A-A'

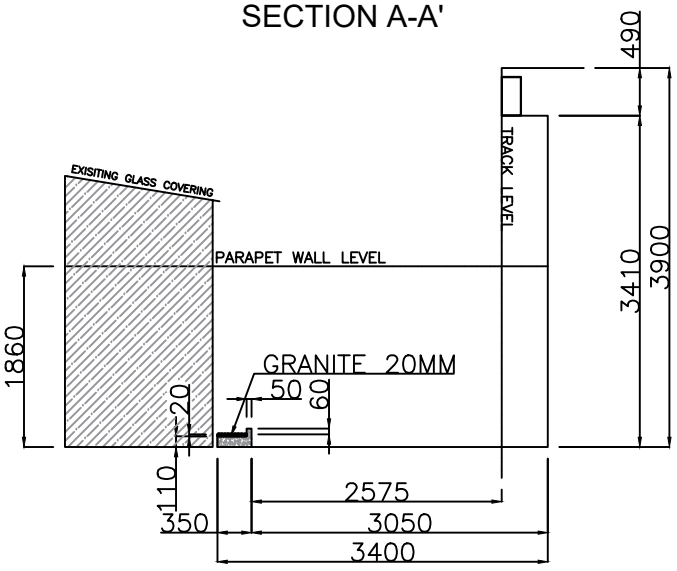

SECTION B-B'

1. THE STRUCTURE ON GROUND LEVEL SHOULD BE OF CONCRETE FOR FOR PROPER FASTENING AND SMOOTH MOVEMENT OF ROOF.
2. INNER PROJECTION OF 50X60MM REQUIRED AS A SINGLE STRUCTURE WITHOUT ANY JOINT TO AVOID WATER SEEPAGE INSIDE.
3. TOP SURFACE SHOULD BE OF GRANITE.
4. STRUCTURAL SUPPORT NEED TO BE PROVIDED FOR THE BEAM OF RHS 400X200X6 FOR A LENGTH OF 5920MM.
5. GRADIENT OF 50MM NEED TO BE PROVIDED ALONG THE OUTER LENGTH TO AVOID WATER STAGNANCY IN GUIDE RAIL.