

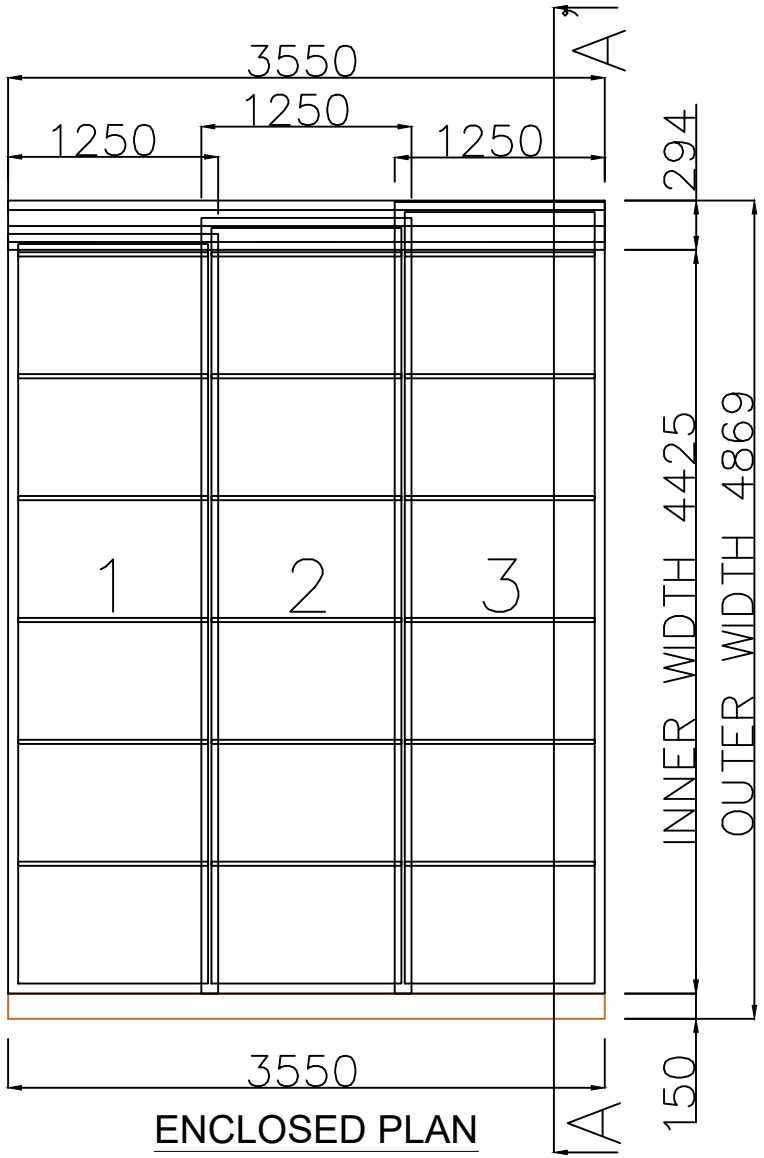



ENCLOSED PLAN

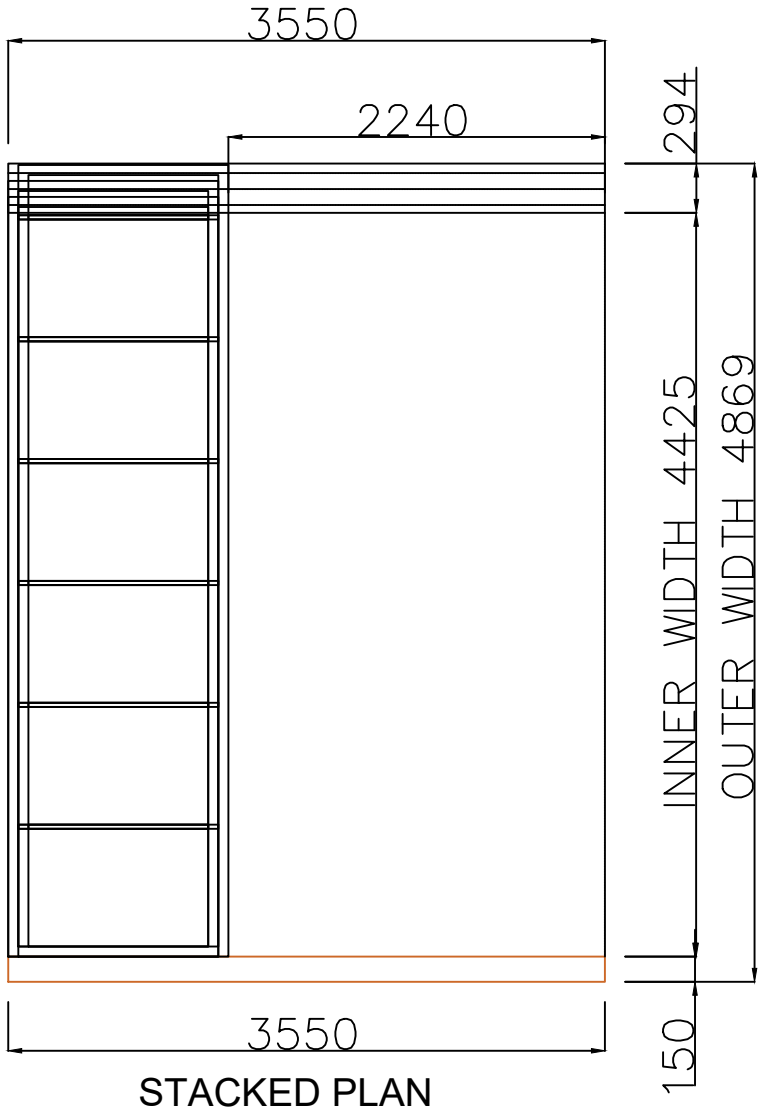


STACKED PLAN

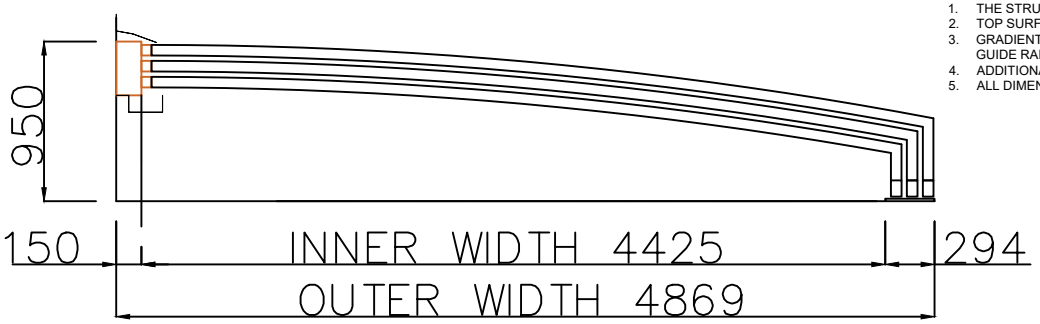


SECTION A-A'

1. THE STRUCTURE AROUND THE CUT OUT SHOULD BE OF CONCRETE FOR FOR PROPER FASTENING OF ROOF.
2. TOP SURFACE SHOULD BE OF GRANITE 20MM FOR SMOOTH FUNCTIONING OF ROOF..
3. GRADIENT OF 50MM NEED TO BE PROVIDED ALONG THE OUTER LENGTH TO AVOID WATER STAGNANCY IN GUIDE RAIL.
4. ADDITIONAL 300MM ALONG THE LENGTH REQUIRED FOR MOTOR MECHANISM.
5. ALL DIMENSION ARE IN MM.

This drawing & design is the property of NIHVA TECHNOLOGIES. Not to be sold or copied to any other concern.

TITLE
RETRACTABLE ROOF PRESENTATION

| | NAME | SIGN | DATE |
|---|---|---|---|
| DRAWN | G.J. | | 12.07.21 |
| CHECK | A.K. | | 12.07.21 |
| APPRD. | V.T. | | 12.07.21 |

NIHVA TECHNOLOGIES PVT. LTD.
NIHVA TECHNOLOGIES PVT. LTD. PUNE
Tel : 020 66304033
Email:- info@nihva.com
Website:- www.nihva.com

CLIENT - DR. PRIYANKA
LOCATION - BIDAR,KA,IN
PRODUCT - RETRACTABLE ROOF
If any queries contact : projectsautomation@nihva.com
NIHVA\20-21\0164 REV- 0
ALL DIMENSION ARE IN mm
SCALE: NTS
SHEET: 01 OF 01