
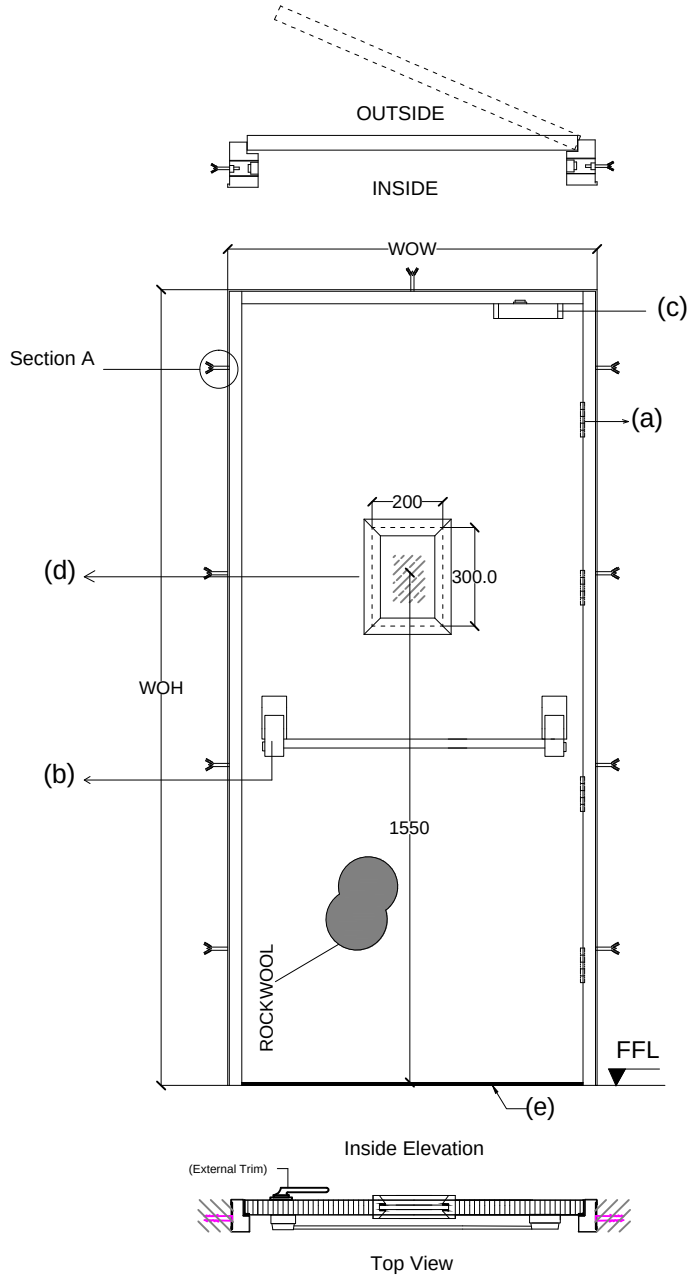


Inside Elevation

Top View

Abbrevation's:
WOW-Wall Opening Width
WOH-Wall Opening Height
FFL-Finished Floor Level

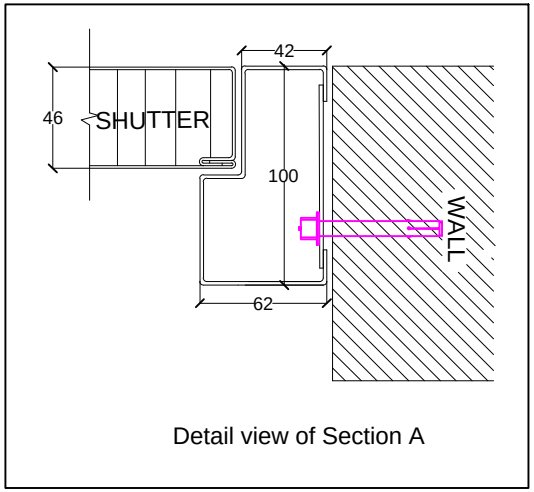

Detail view of Section A

ASSESORIES DETALES

(a) HINGES: SS Ball bearing butt hinges 4"x3"x3mm(MAKE DORMA)

(b) LOCK : Panic bar-single point- DORMA PHCR1000(9121502) with external trim-RHCRT 2905(9121512).

(c) DOOR CLOSER: DORMA TS68 WITH STANDARD ARM SILVER FINISH

(d) GLASS : 5mm Thk. Vision Glass of size 200x300mm.

(e) AUTO DROP DOWN SEAL RP8si seal

Shutter thickness : 46 mm
Frame Sheet thick : 1.5mm
Shutter sheet thick : 1.2mm
Fixing : On Solid Brick plasterd wall with Anchors

NOTE:- *All Dimensions are in mm.
*Tolerance:-All Linear Dimensions ±3mm,Others ±0.5mm.
*The Drawing Is For Location of Hardware only. Drawing Does Not Represent The Hardware For More Clarity, Please Go Through Hardware Broucher.

FIRE RATED EXIT DOOR

SR. NO.	WOW	WOH	TYPE 1 (LH)	TYPE 2 (RH)	TYPE 3 (LHR)	TYPE 4 (RHR)	QUANTITY
01	1185	2392			01		01 NOS

COLOR:-
1. GREY (RAL 7038)

NOTE:-30/06/2018
1.HEIGHT CHANGED 2400mm TO 2392mm

This drawing & design is the property of NIHVA TECHNOLOGIES. Not be sold or copy to any other concern.

TITLE:- FIRE RATED EXIT DOOR FRAME.

	NAME	DATE	SIGN.
DRAWN	SURAJ	23/06/18	
CHECK	PRADEEP	23/06/18	
APPRD.	PRADEEP	23/06/18	

If any queries contact :design@nihva.com

ALL DIMENSION ARE IN mm

NIHVA TECHNOLOGIES PVT. LTD.
NIHVA TECHNOLOGY PVT. LTD. PUNE
Tel : 020 66304033
Email:- info@nihva.com
Website:-www.nihva.com

CLIENT -
PROJECT -
LOCATION -
DWG. NO. - NIHVA/18-19/VDR/040 | REV. : 01
SCALE: 01 | WT: | SHEET: 01 OF 01