

PROPOSED PLAN LAYOUT

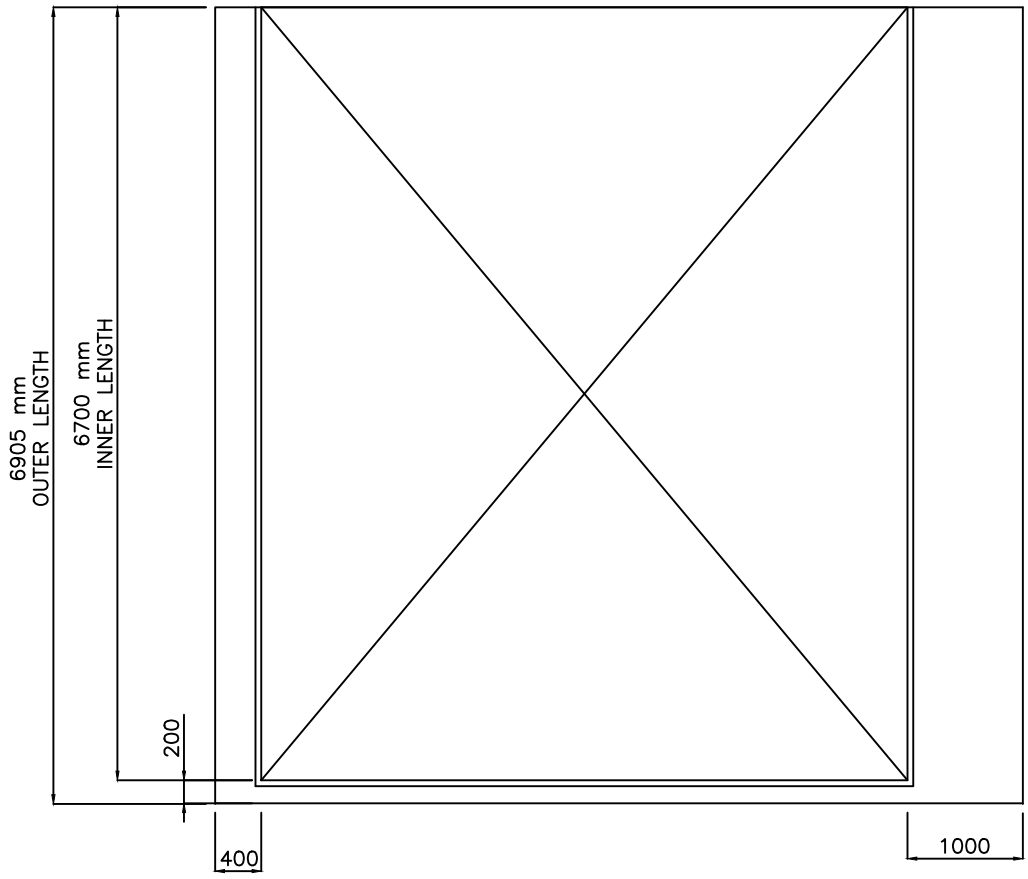

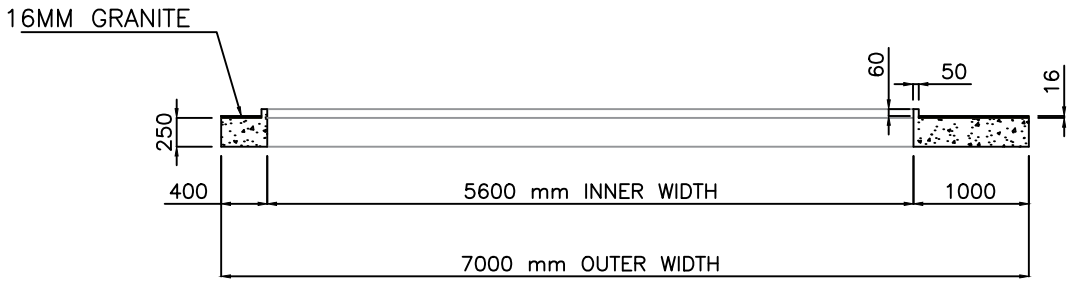

1. THE STRUCTURE AROUND THE CUT OUT SHOULD BE OF CONCRETE FOR PROPER FASTENING OF ROOF.
2. TOP SURFACE SHOULD BE OF GRANITE 16MM FOR SMOOTH FUNCTIONING OF ROOF.
3. GRADIENT OF 50MM NEED TO BE PROVIDED ALONG THE OUTER LENGTH TO AVOID WATER STAGNANCY IN GUIDE RAIL.
4. REQUIRED POWER SUPPLY IS 450W, 230V DC
5. CIVIL CUTOUT FOR MOTOR MOUNTING AS PER MENTIONED IN DRAWING
6. AL PROFILE - POWDER COATED
7. GASKET - EPDM
8. MOTOR - NICE MAKE ITALIAN
9. ELECTRICAL POINT REQUIREMENT
10. ALL DIMENSION IN MM.
11. ALL CIVIL WORK IS IN CLIENT SCOPE

This drawing & design is the property of NIHVA TECHNOLOGIES. Not to be sold or copied to any other concern.

	NAME	SIGN	DATE
DRAWN	H.B.		13.04.23
CHECK	P.M.		13.04.23
APPRD.	V.T.		13.04.23

TITLE: PROPOSED PLAN LAYOUT

NIHVA TECHNOLOGIES PVT. LTD.

CLIENT -

LOCATION -

PRODUCT - RETRACTABLE ROOF

If any queries contact : supportautomation@nihva.com

NIHVA\22-23\02XX | REV-

ALL DIMENSION ARE IN mm

SCALE: NTS | SHEET: 01 OF 01