




PLAN VIEW

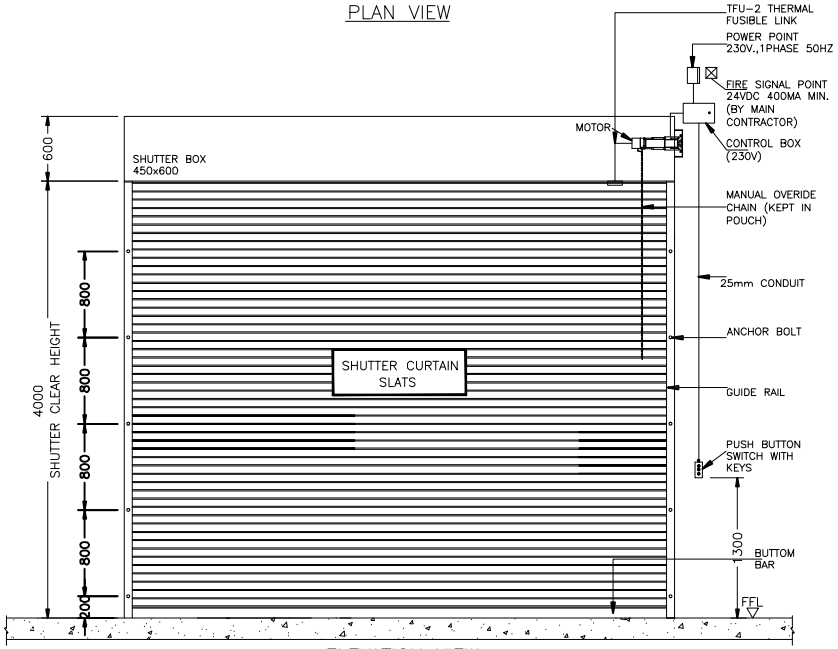


ELEVATION VIEW

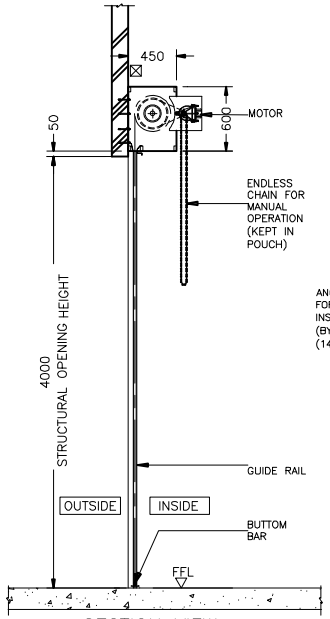


SECTION VIEW

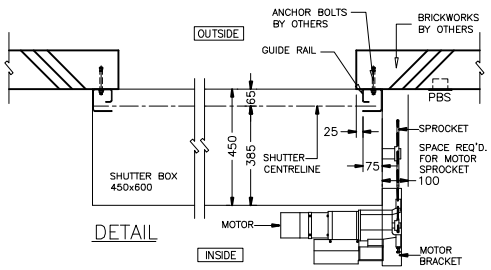


DETAIL

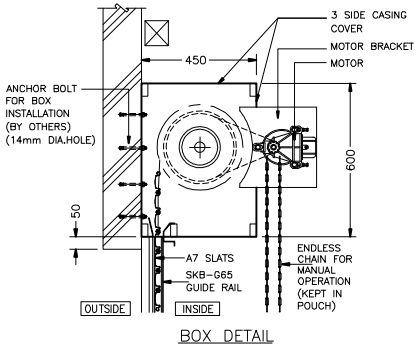


BOX DETAIL




SHUTTER SLAT THICKNESS 1.0mm



FIRE RATED BOTTOM BAR



THICKNESS 3mm GALVANISED STEEL GUIDE RAIL



PUSH BUTTON

TECHNICAL SPECIFICATIONS :

Sr .No.	Specification	Description
1	**Certification**	BS 476 Part 22 & MS 1073 Part 3 1988 Tested in Warrington Fire Reasearch Centre UK & Sirim Malasiya
2	**Shutter Curtain**	Roll formed from 1st grade BHP Zincalume steel SKB-A7 curve slat curtain
3	**Guide Rail**	Fabricated from hot-dipped galvanised steel of 3.0 mm with one piece design surface mounted type.
4	**Bottom Bar**	Assembled of 2 Pieces of 38 x 38 x 3 mm galvanised steel angle bolted 800 mm pitch with galvanised bolts and nuts or 2 pieces of 40 x 40 x 6 mm steel flat bar.
5	**Shutter Enclosure Box**	Pressed Galvanised steel sheet to suite box size comply to fire test approved thickness.
6	**Operation Control**	Gear motor with Thermal protector, limit switches, manual overide, c/w push button switch with keys lockable.
7	**Motor Drive Unit**	Power Source: 110v 60Hz 1 phase 220v 60Hz 1 phase 230v 50Hz 1 phase 400v 50Hz 3 phase Manual Chain Overide One unit push button switch Gravity drop level Auto close by relay switch after receive of 24vdc fire signal
8	**Fire Mode**	Fire Shutter will auto close via upon receiving of 24VDC fire signal

SIZES :

SHUTTER NO.	LOCATION	CLEAR WIDTH	CLEAR HEIGHT	MOTOR POSITION	QTY
	–	mm	mm	RIGHT	

This drawing & designing is the property of NIHVA TECHNOLOGIES. Not to be sold or copied to any other concern

TITLE :-
MOTORISED ROLLING SHUTTER

NIHVA TECHNOLOGIES PVT. LTD.
NIHVA TECHNOLOGIES PVT. LTD. PUNE
Tel : 020 66304033
Email:- info@nihva.com
Website:- www.nihva.com

	NAME	DATE
DRAWN	J.S.	19/01/2024
CHECK	A.K.	19/01/2024
APPROVAL	V.T.	19/01/2024

CLIENT - TATA

PROJECT -FIRE RATED ROLLING SHUTTER

DWG. NO. : NIHVA-23-24-CLT-102 | REV-00

SCALE: NTS | WT: | SHEET: 01 OF 01

ALL DIMENSION ARE IN mm

If any queries contact : design@nihva.com