| Revision | | Date | By |
|---|---|---|---|
| A | CW was 9000, CH was 5400 | 2022-09-27 | KMÖ |

NOT INCLUDED IN DOOR SUPPLY:

1. Design and supply of all door supporting structural components.
2. Design and supply of all closure between door and adjacent steel.
3. Door jambs adjustable for overall door width and true to plumb.
4. Paint job after completed door installation.
5. Any frameworks being provided by ASSA ABLOY will be clearly indicated as "by ASSA ABLOY".

REQUIREMENTS ON BUILDING:

6. Door head support must be straight within 1/600 of span in the in/out direction and free from protrusions of any kind.
7. For a single door leaf, door head support should be horizontal and straight within 1/600 of span at distributed full door load.
8. Door side jambs must be smooth, straight and parallel, out of plumb must not exceed 2mm/m (total deviation at full length 5 mm) in any direction.
9. Any footings at bottom of jamb columns must not interfere with installation of guide rails at floor level.
10. At time of installation, finished floor, free from obstructions, out to a distance of 2 m on each side of door centreline must be available.
11. Header box must be accessible from both sides during installation.

DOOR PROPERTIES:

12. The door is designed to withstand a differential pressure of 1.15kPa.
13. Color of door fabric: Please specify
14. Side profiles
15. Metal trim: motor side

ELECTRICAL:

16. One main control panel provided of PLC type.
17. Audible and visual alarm
18. Back-up power switch
19. Safety edge
20. Approx. size of main control panel: WxHxD (500mm x 600mmx250 mm),
21. Power: 2.7kW
22. Nom. current: 6.4A
23. (max. allowed voltage drop at start: 5%)

BELT HOIST UNITS:

SK 873.1-100L/4 Z dual brake

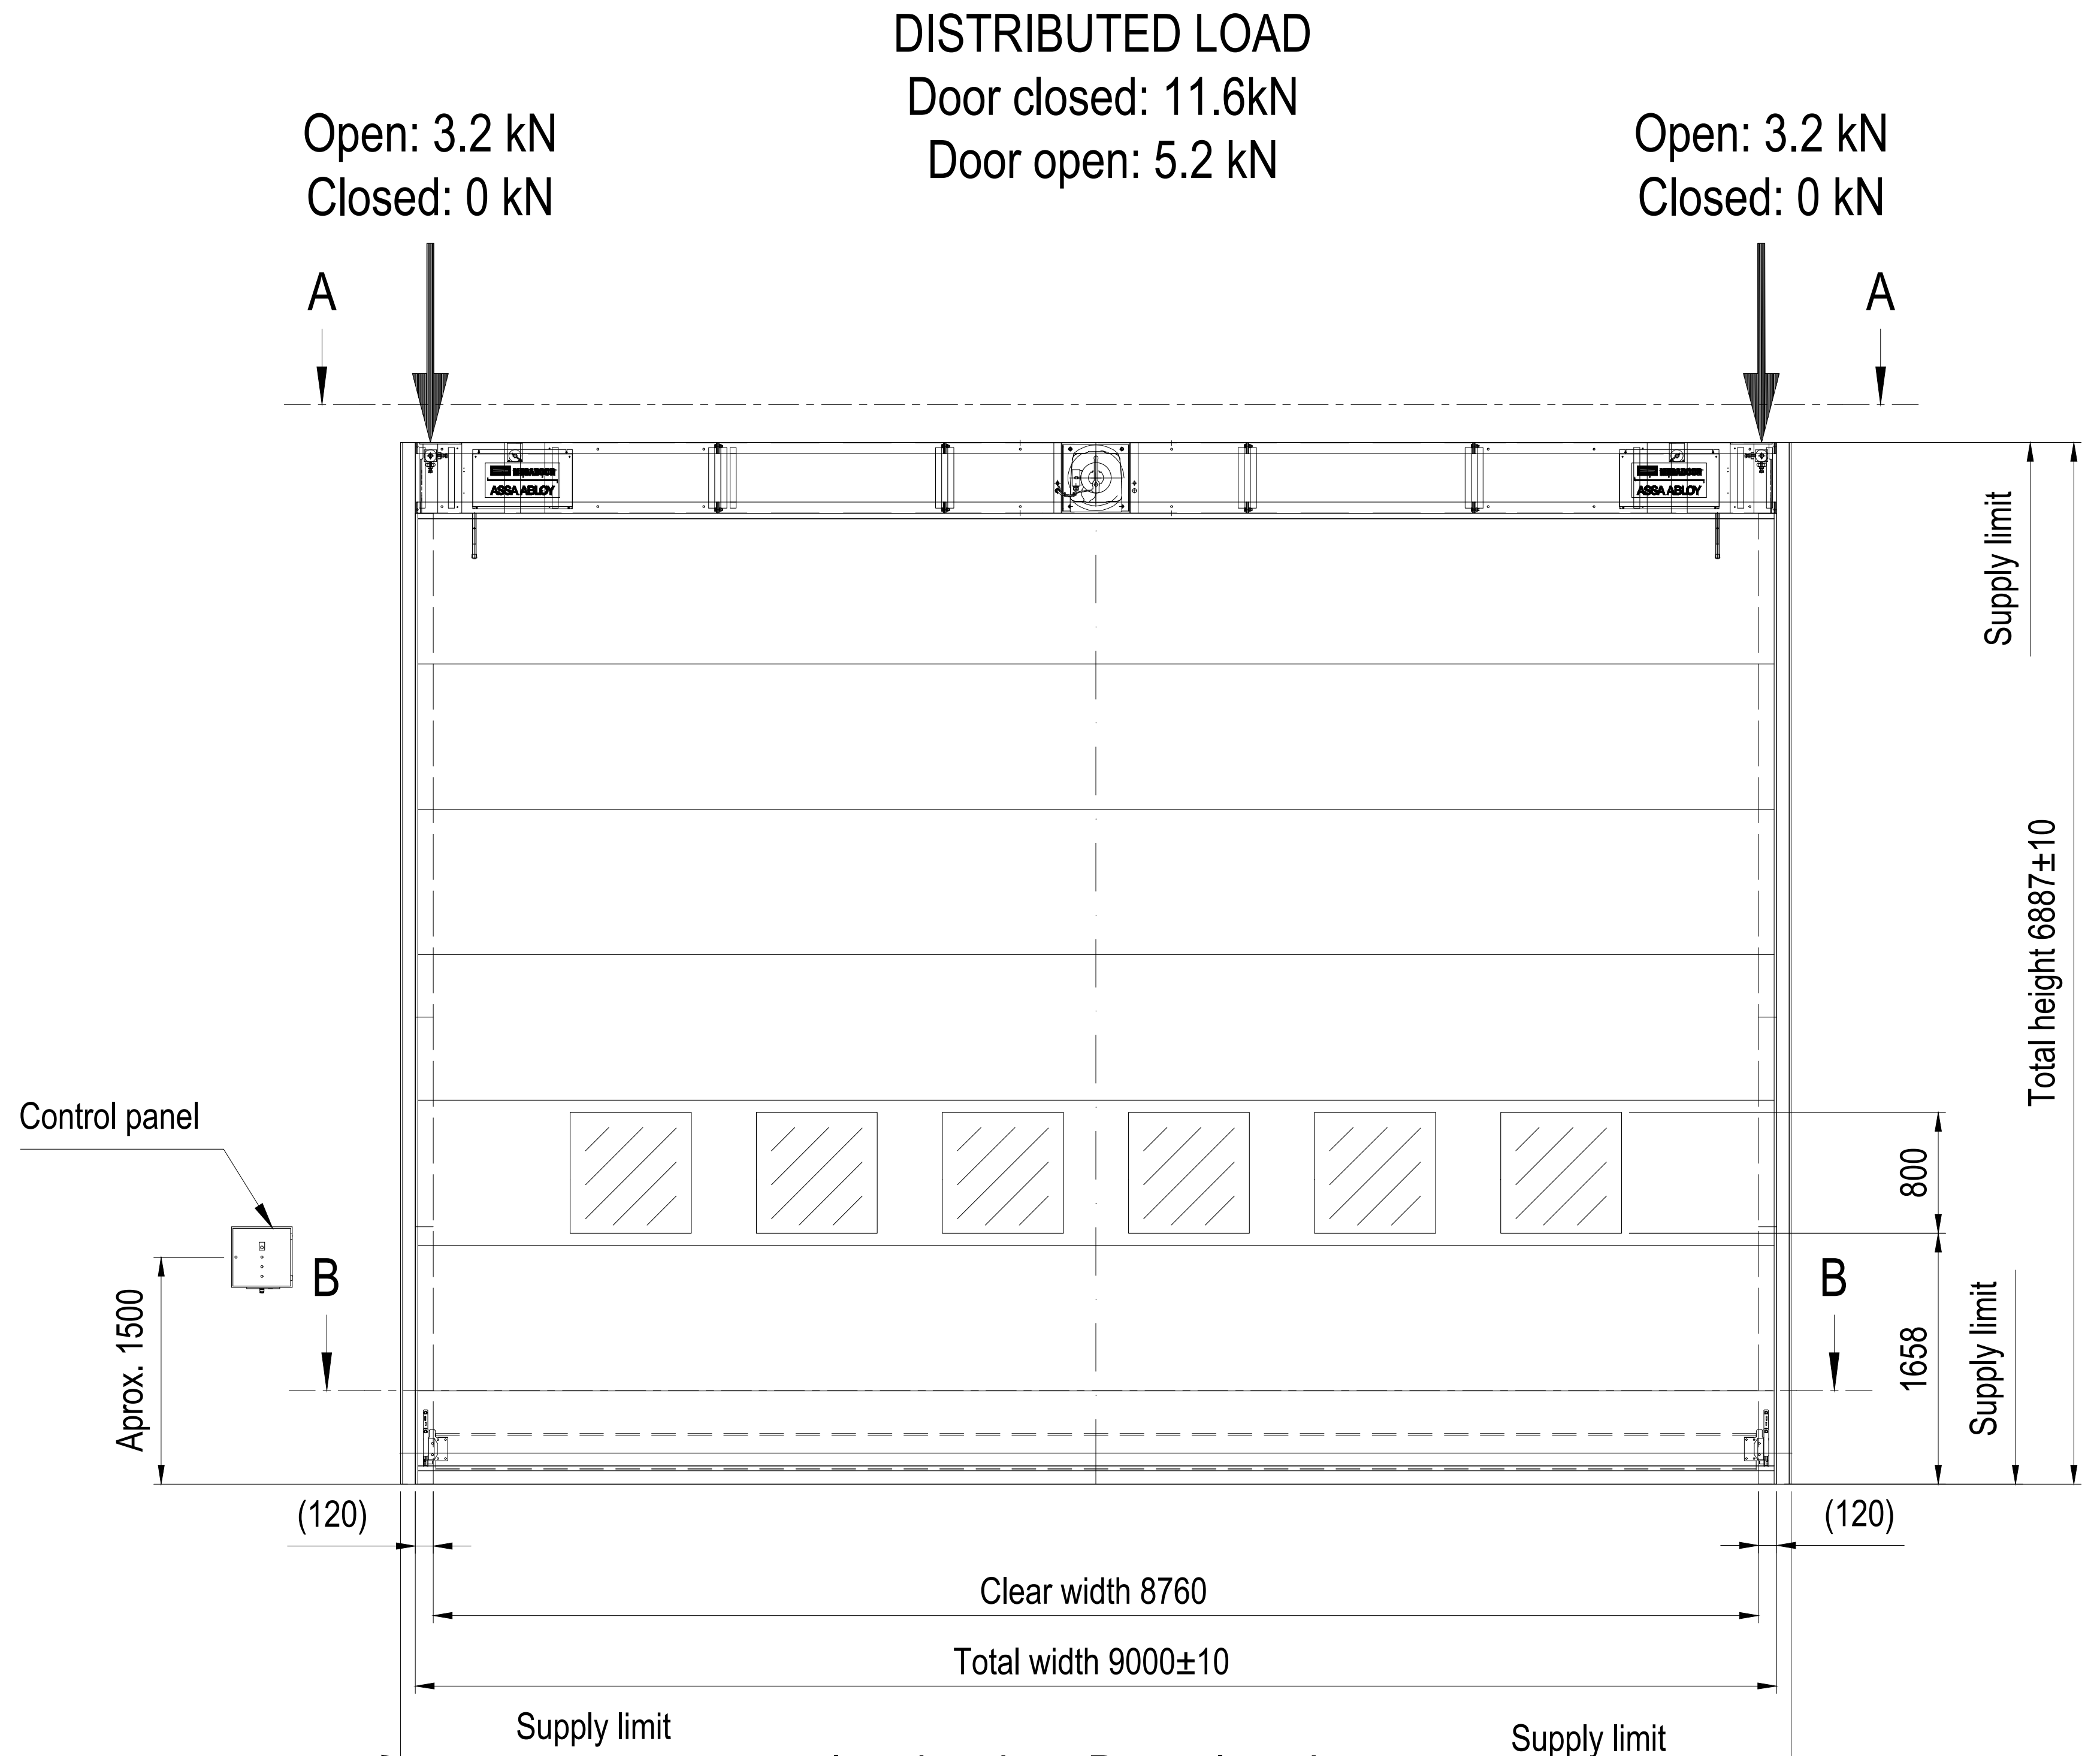

Interior view, Door closed

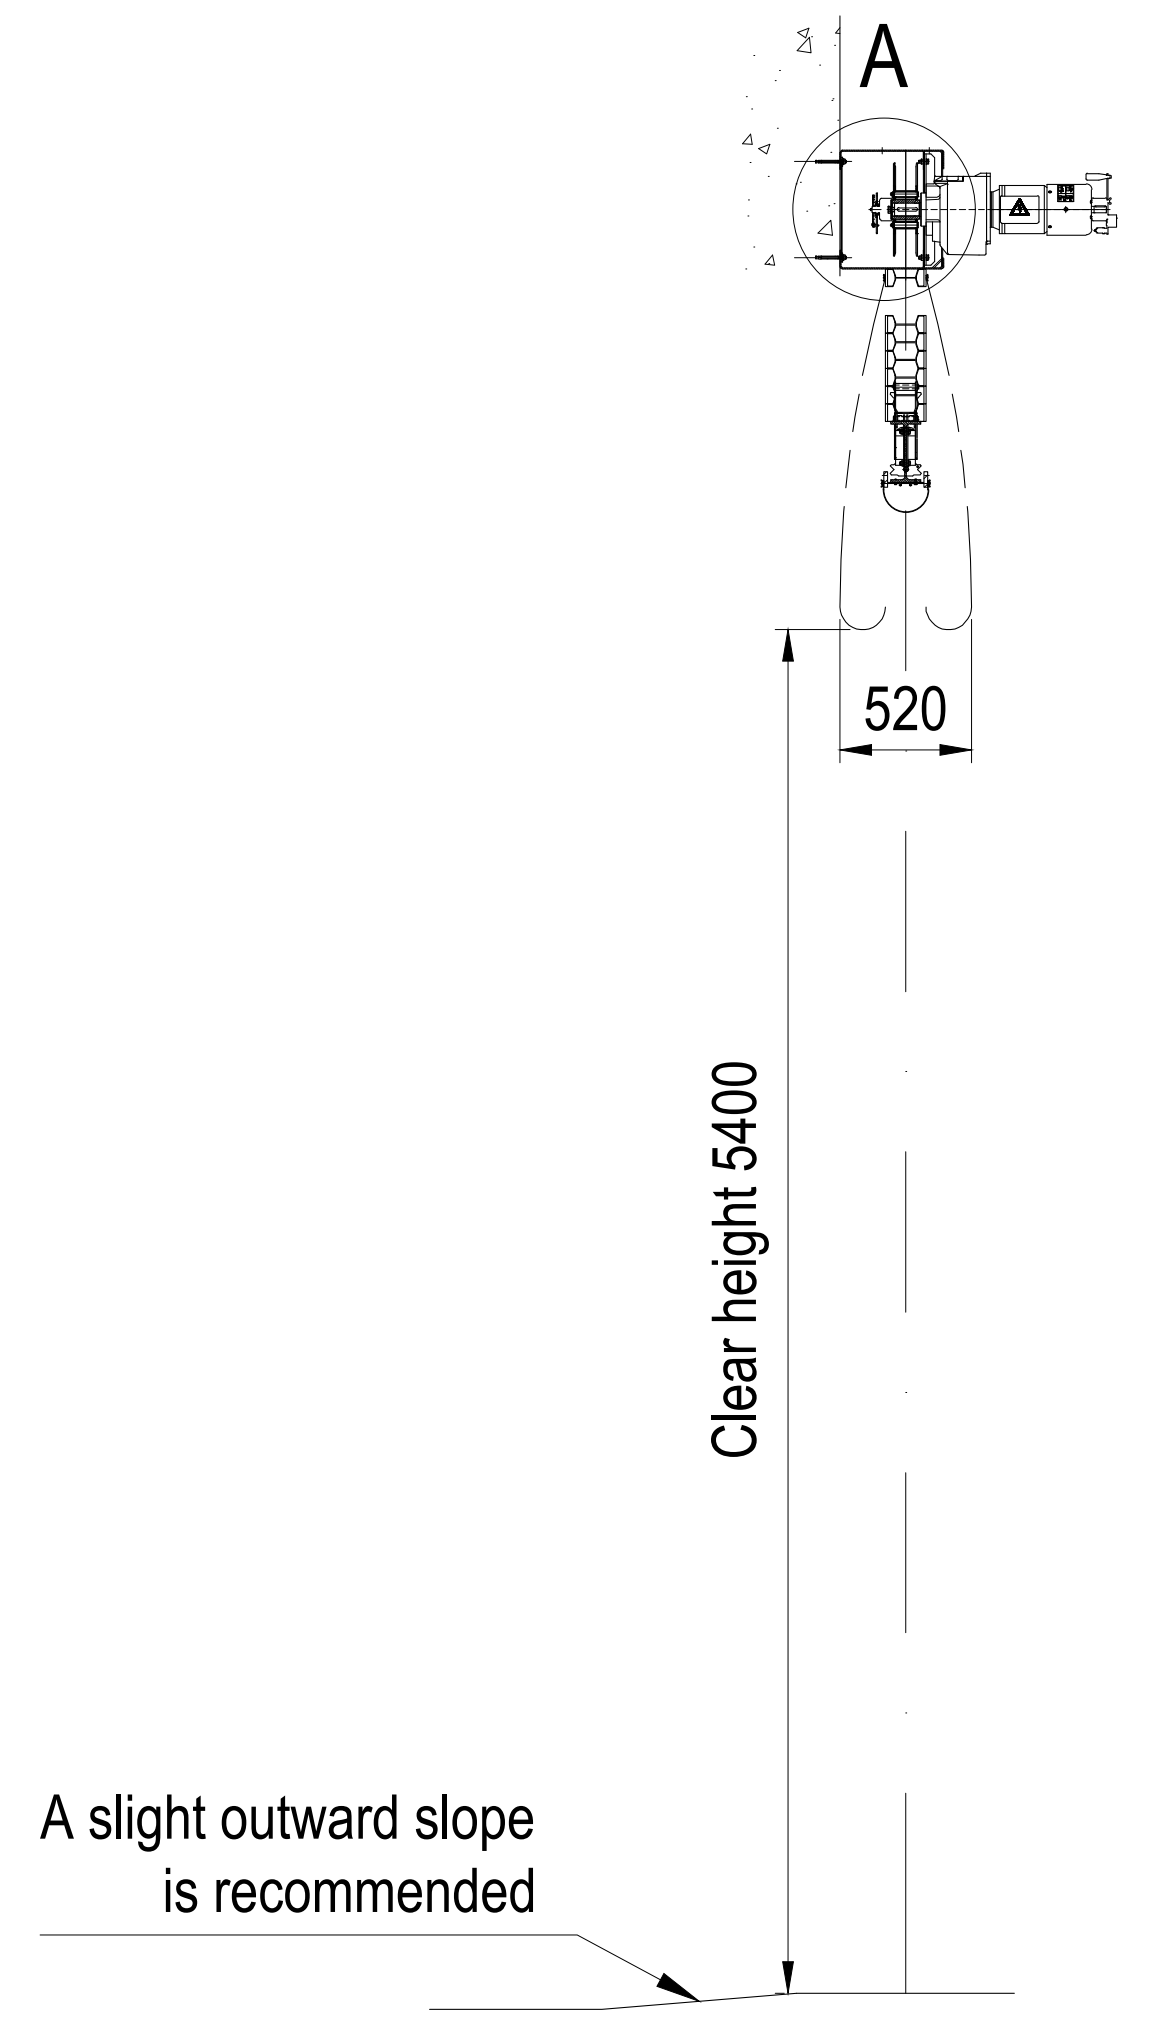

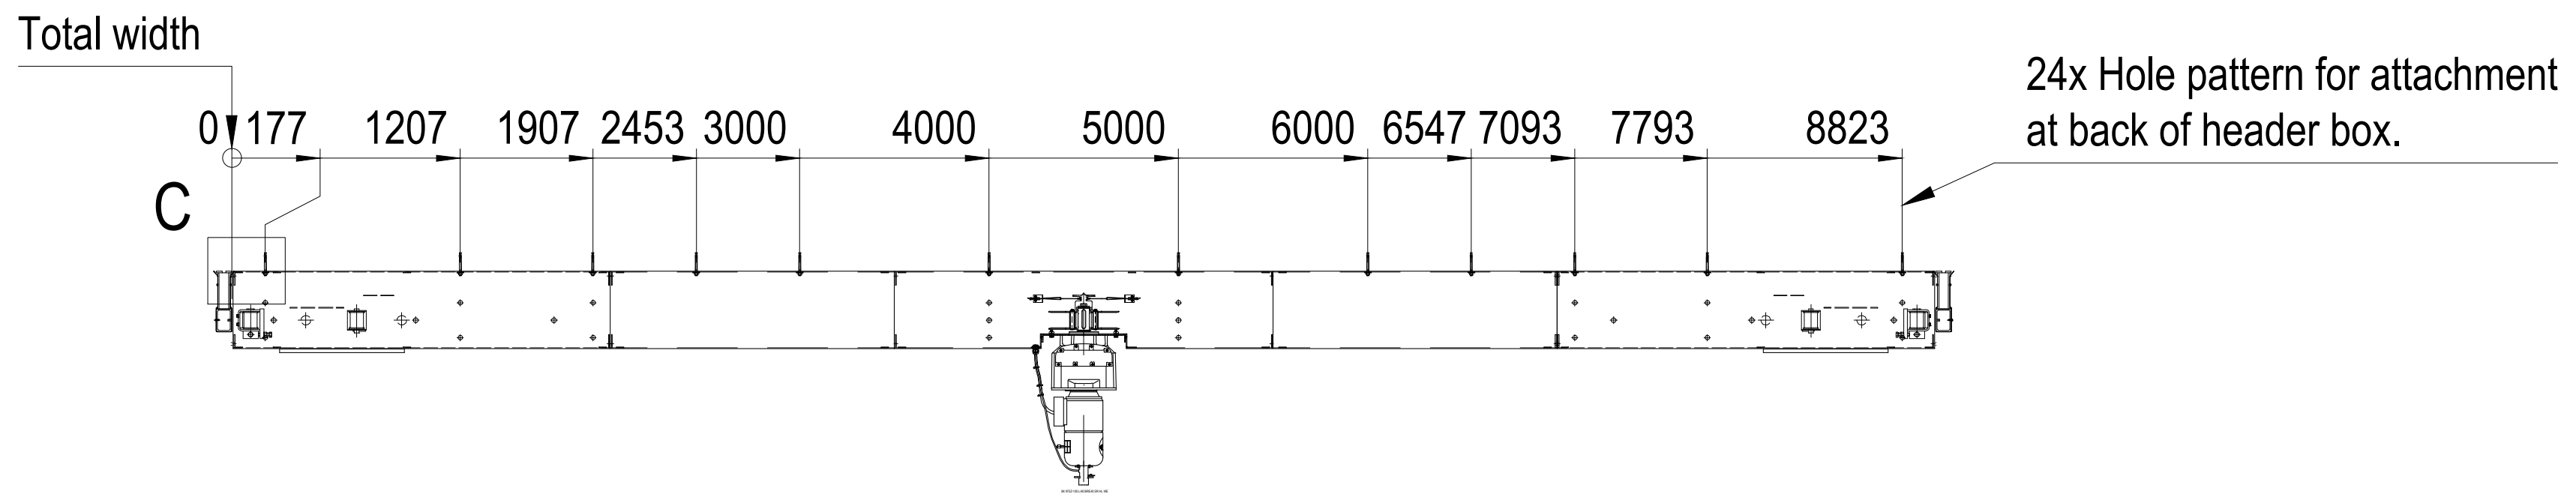

SECTION A-A

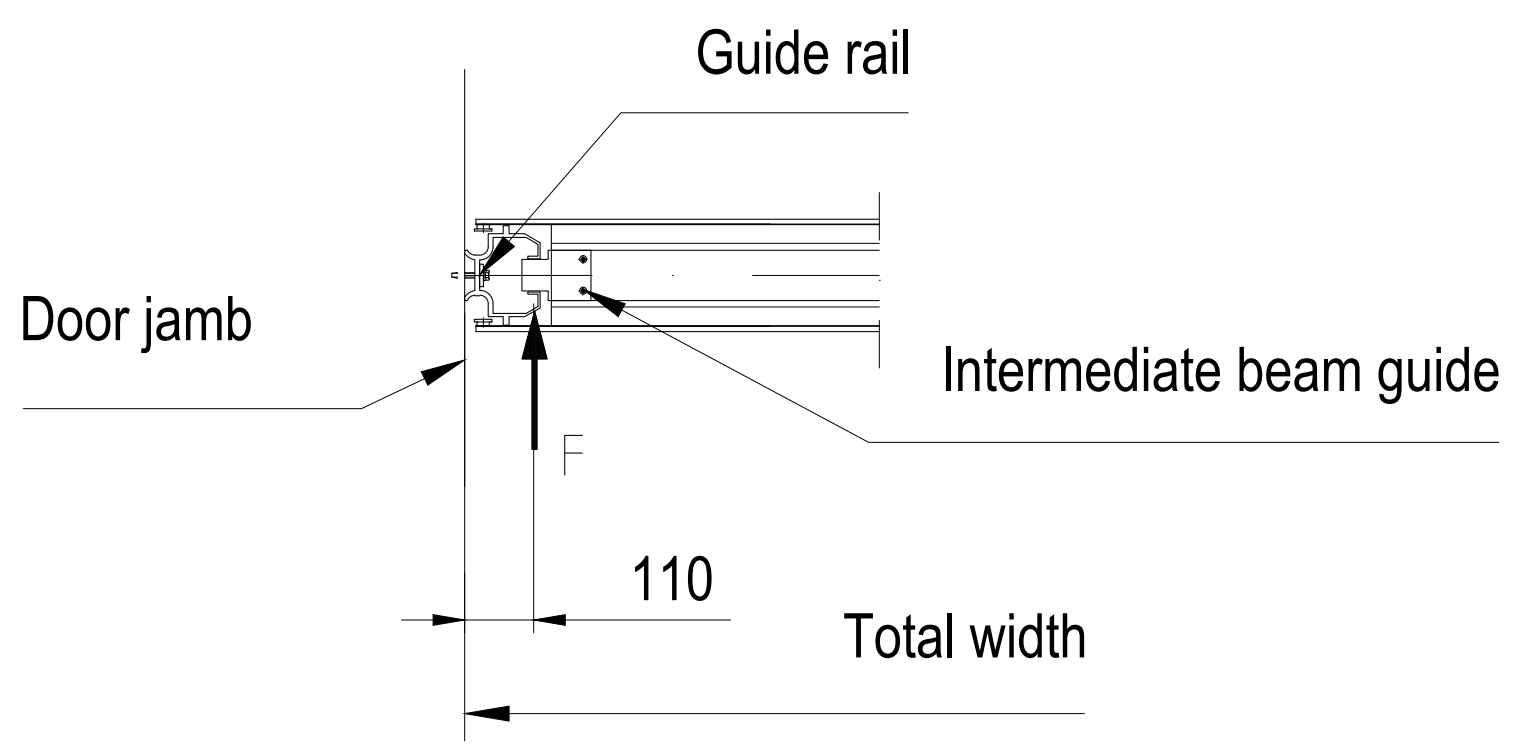

Force by differential pressure transferred to guide rail at each intermediate position.
F=4.7 kN

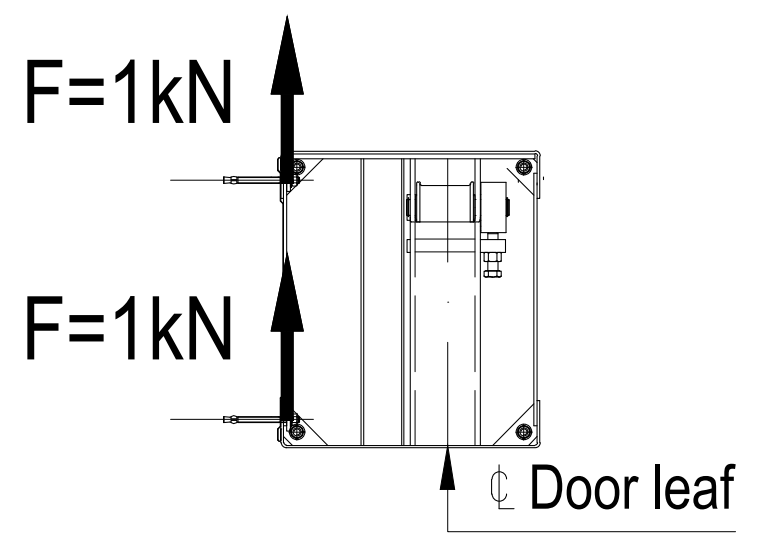

Load on header box attachment (each screw), due to wind load and door weight

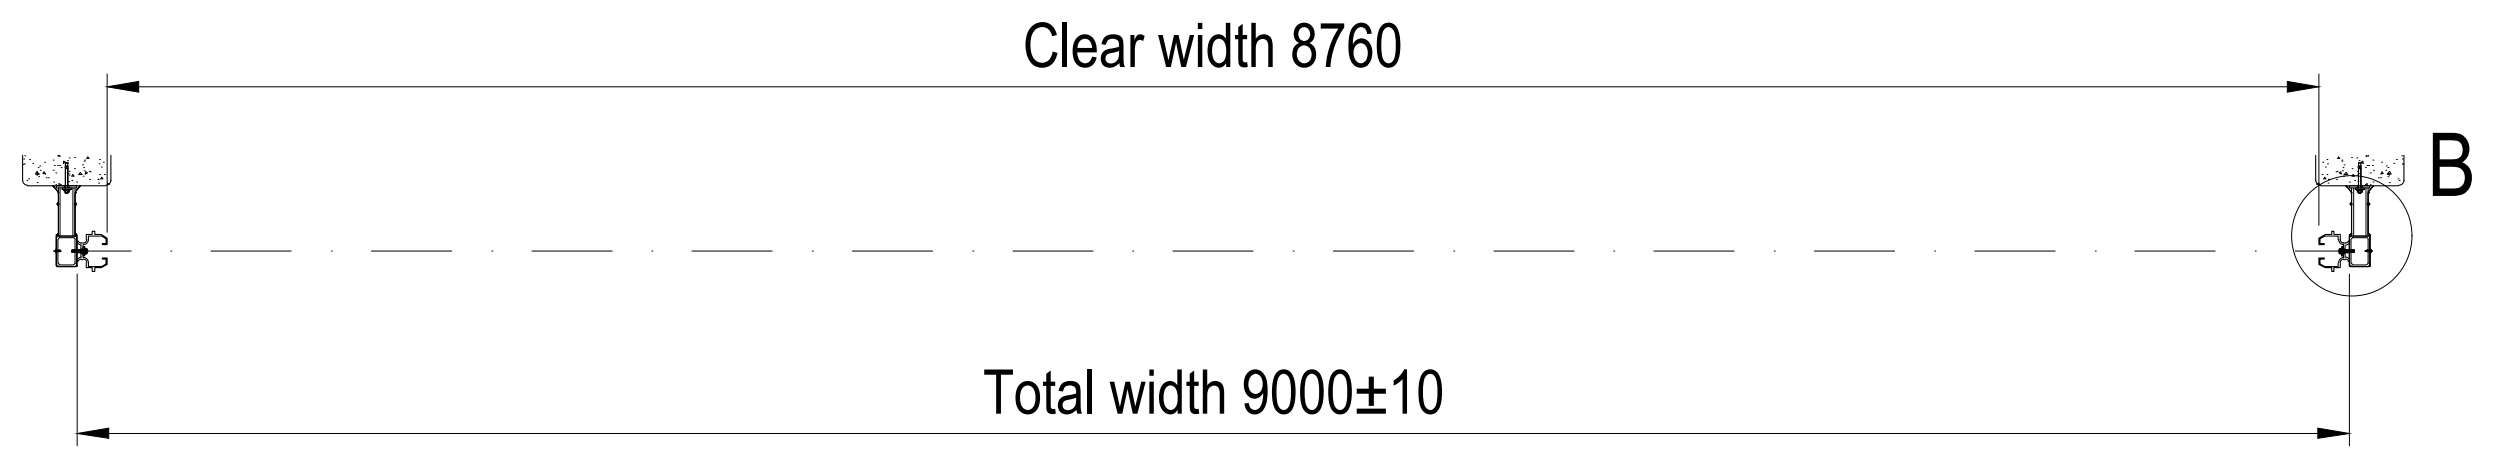

SECTION B-B

Door leaf is not shown for clarification

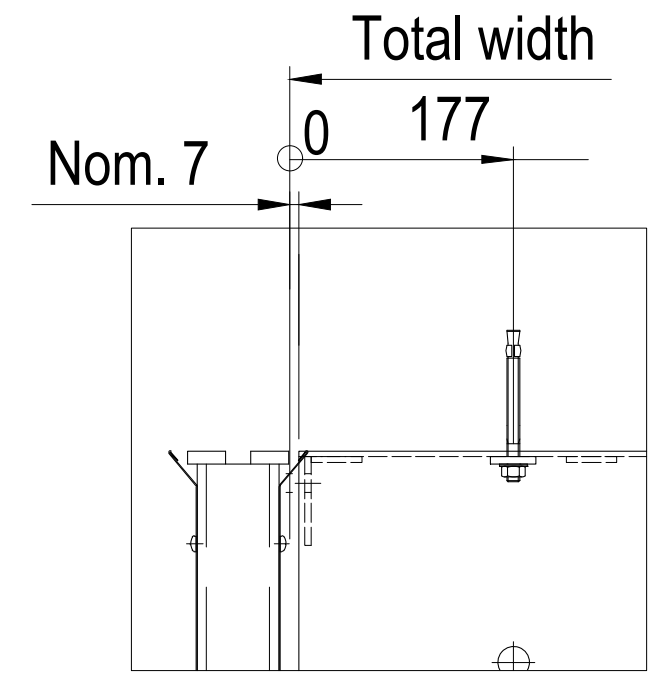

DETAIL C, SCALE (1:10)

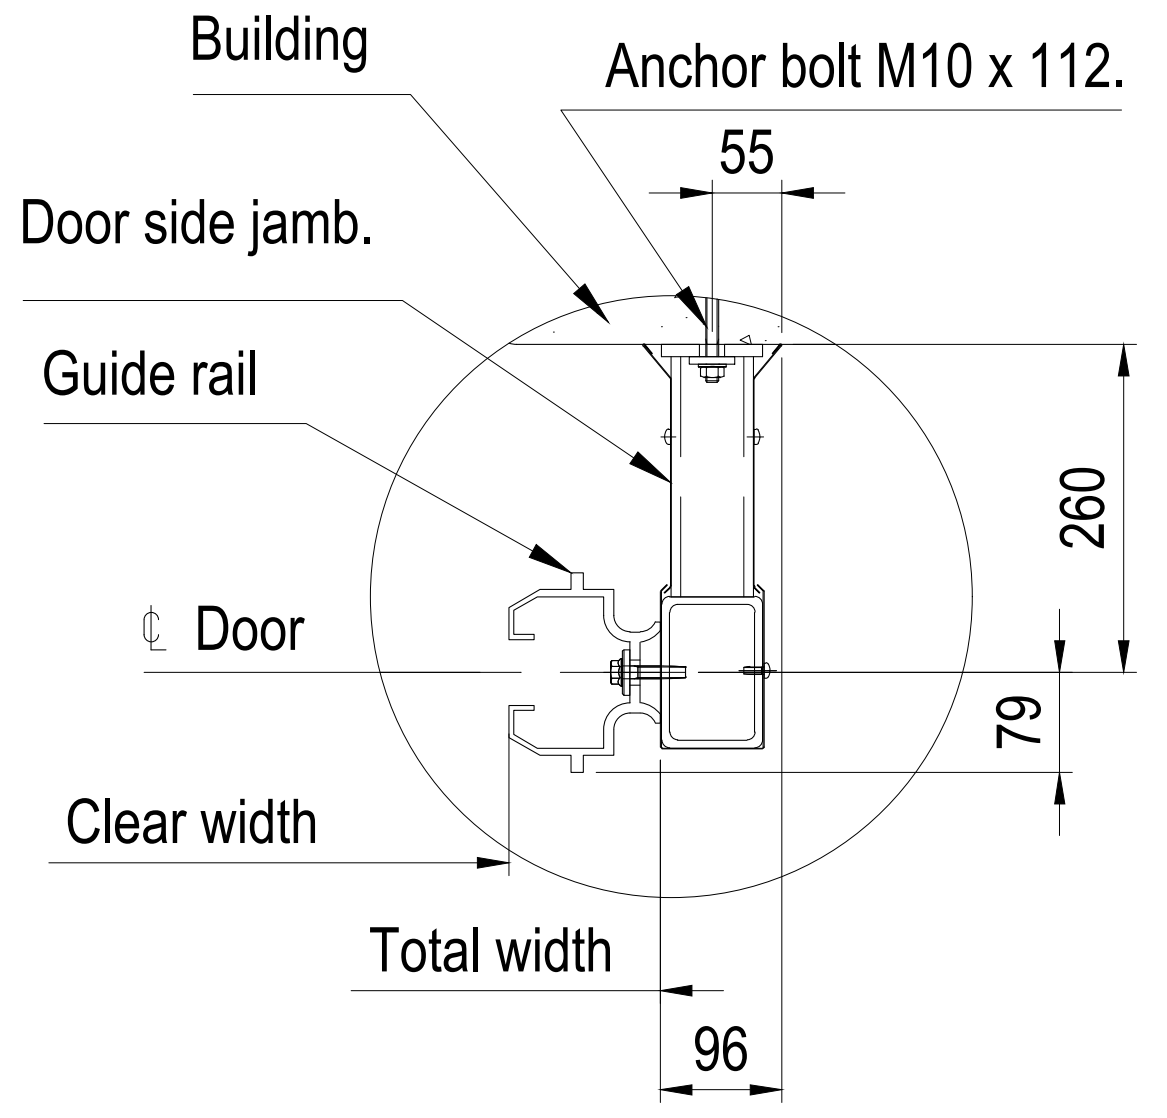

DETAIL B, SCALE (1:10)

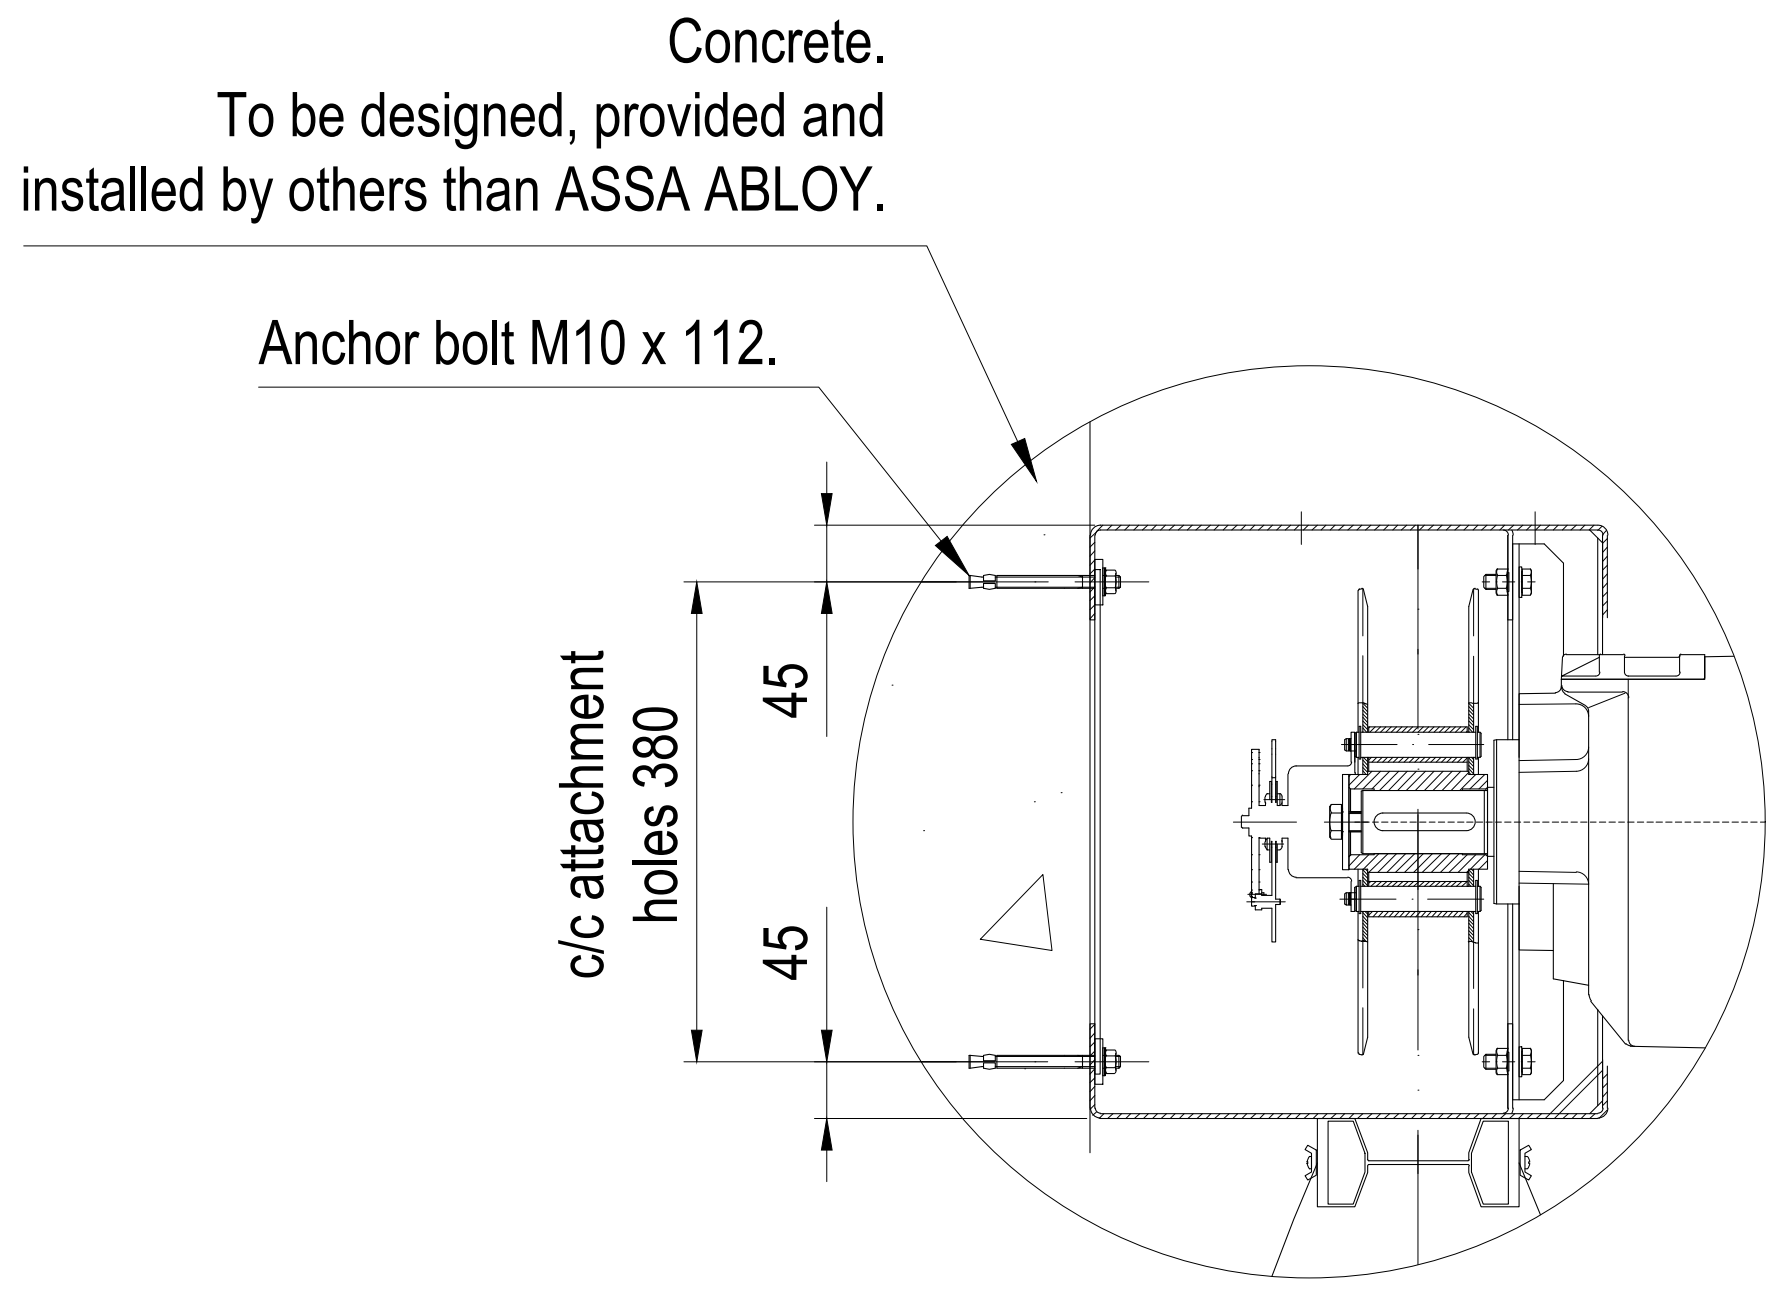
Concrete.
To be designed, provided and
installed by others than ASSA ABLOY.
Anchor bolt M10 x 112.
c/c attachment
holes 380
45
45

DETAIL A, SCALE (1:10)

Building: ARFF4

DESIGNED
KMÖ

SIZE A1

SCALE 1:50

CODE
22238-22239

ITEM NO

DATE
2021-07-22

ASSA ABLOY

If not otherwise stated:
Tolerances
ISO 2768-m
EN ISO 13920-B
Cutting class
ISO 9013-442
Weld class
ISO 5817-C
Surface finish
Smooth raw surface

Delhi Fire Station
India
Megadoor 8760 x 5400
Sales interface

DRAWING NO
74147

REVISION
A

PLOT DATE

This document is the property of ASSA ABLOY Entrance Systems AB and shall not without our written permission be copied, imparted to a third party or used for any other unauthorized purpose.