AMs

Project - KINGFA, Chakan

Material Approval / Inspection Request

Civil

KINGFA

Date : 23/11/18

Description of Material: Sliding Door - Five Rated (2hrs)

Manufacturer Details: NiHva Technologies Pvt. Ltd

Supplier Details: Radiant Safedoors Pvt. Ltd

Project Technical Specifications ref: As per BOQ

Intended for:

Location / Area of use : Factory 2 —

Inspection Report/Image

1) 70 x 50 mm MS Hollow tube in Leaf/shutter - Missing
2) 10mm square bar bracing @ bottom shutter - Missing
3) Steel frame with EPDM flexible seal on 3 sides & grouting lugs - Missing
4) CBRI Certification is of single leaf door.
5) Make - Subject to approval from client


Attachment :	Y	N		Y	N
1. Specification	☑	☐	4. Test Report	☑	☐
2. Sample Submitted	☐	☑	5. Other Supportive Document	☐	☐
3. Brochures	☑	☐	6. BOQ/ Tender Specification	☑	☐


Approval	☐ Approved	☑ Approved subject to Rectifications Listed	☐ Not Approved [See Remarks]
Approval Date			
REMARKS			
RANJANARUP PROJECTS PUNE 23/11/18 For RPPL	A.M. Tarkar 24/11/18 For AMs	24/11/2018 For Kingfa	


Scanned by CamScanner


DSSF – 1622

Sliding doors (Fire Rated)

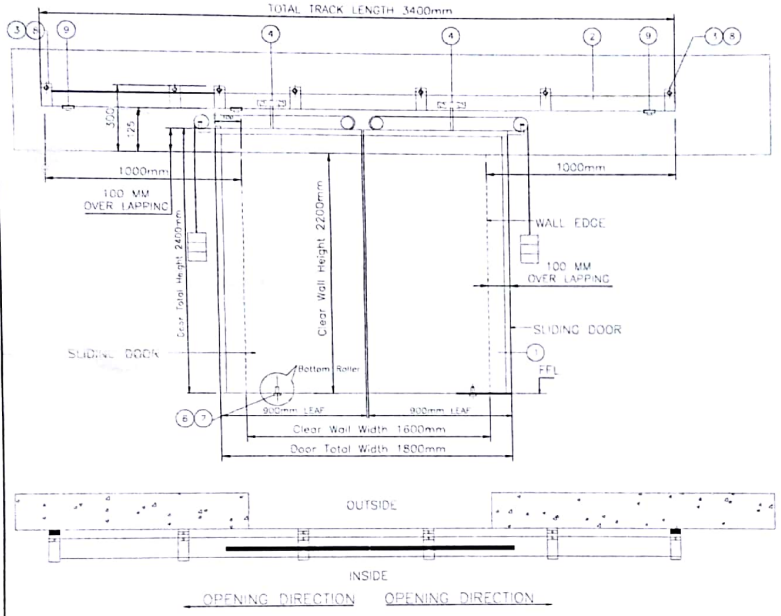



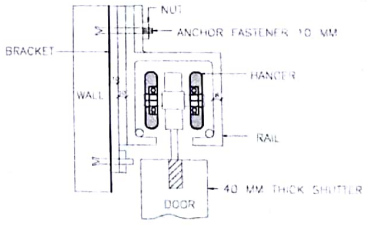



DETAIL AT 'B'

SR.NO.	QTY.	DESCRIPTION
9	1	STOPPER (FOR HANGER ASSLY.)
8	1	COVER (FOR TRACK BKT.)
7	1	BOTTOM ROLLER MTG. FLAT (BOTTOM ROLLER BKT.)
6	1	BOTTOM ROLLER ASSLY.
4	2	HANGER ROLLER ASSLY.
3		TRACK BRACKET
2		SLIDING TRACK
1	1	SLIDING DOOR & FRAME / BACK SUPPORT SQ. TUBE

DOOR DIMENSION		
CLEAR WIDTH	CLEAR HEIGHT	
1600mm	2200mm	01NOS

NOTE : DOOR OVERLAPING 100mm AT RH & LH AND TOP SIDE
ALL DIMENSIONS ARE IN MM.
CLIENT SHOULD CONFIRM DOOR OPENING DIRECTION.

TOLERANCE:- ± 10mm

This drawing & designing is the property of NIHVA TECHNOLOGIES. Not to be sold or copied to any other concern.

TITLE: AUTOMATIC SLIDING DOOR	NAME	SIGN	DATE
DRAWN	SURAJ		21/11/18
CHECK	P.A		20/11/18
APPROVAL	R.D		20/11/18

If any queries contact : design@nihva.com
ALL DIMENSION ARE IN mm

NIHVA TECHNOLOGIES PVT. LTD. PUNE
NIHVA TECHNOLOGIES PVT. LTD.
Website - www.nihva.com
Tel : 020 66304033
Email - info@nihva.com

CLIENT - RATNARUP PROJECT PVT. LTD.
PROJECT -RATNARUP PROJECT PVT. LTD.
SITE - BANNER,PUNE.
DWG. NO. : NIHVA/18-19/0181 REV- 0
SCALE: NTS WT. SHEET: 01 OF 01

Scanned by CamScanner

TEST SCHEDULE 1/1
(Reference No. – FR / 0212)

1.	**Name of the Laboratory**	: Fire Research Laboratory CSIR-Central Building Research Institute, Roorkee-247 667
2.	**Name of the Party**	: **M/s Radiant Safedoors Pvt. Ltd.,** 539 GIDC. Phase II, Vatva, **Ahmedabad-382 445**
3.	**Name of the Test**	: Fire Resistance Test
4.	**Date of Test**	: September 29, 2015
5.	**Ambient Temperature**	: 15 °C
6.	**Fire Exposure**	: As per BS:476,Part 20 & 22
7.	**Applicability if Test Criteria**	: Stability : Yes Integrity : Yes Insulation : Yes
8.	**Specimen Details**	: Single Leaf Sliding G.I. Composite Fire Door (Counterweight System). **Door Dimensions (Panel)** Height : 3000 mm Width : 3000 mm Thickness : 40 mm Door Panel Thickness: 40 mm
9.	**Specimen Construction**	: As shown in Figure 1 (Drg. No. 1/1 -0212(1) & Drg. No. 1/1 -0212-(2))
10.	**Door Type**	: Insulated
11.	**Indented Test Duration**	: Two Hours

Test Results

The data of evaluation reveals that the single leaf sliding G.I. composite fire door with counterweight system has been found to be able to withstand standard fire exposure for 120 minutes (One Hundred Twenty minutes only) with respect to **stability, integrity and thermal insulation.**

(Sushil Kumar) (Narendra Kumar) (Dr. Suvir Singh)

(Technical data provided in this schedule pertains to the specific sample submitted to the Institute and tested. CBRI's name or logo cannot be used for commercial purposes. All procedural, legal, and / or operational matters will be the responsibility of the party using these results. Accepting / Rejecting the results, partly or fully rests with the users agencies.)

FIRE RESEARCH LABORATORY
CSIR - Central Building Research Institute
Roorkee - 247 667 (U.K.) INDIA

Scanned by CamScanner

NIHVA
NIHVA Technologies Pvt. Ltd.

RADIANT SAFEDOORS PVT. LTD.

SPECIFICATION SHEET

FIRE DOORS (120 Minutes)
(CONFORMS TO IS: 3614 (PART - II), 1992 & BS: 476 (PART 20 & 22

Auto Sliding Door:

This type of door is fabricated from GI / MS sheet having thickness of 18 SWG with overall panel thickness of 40 / 42 mm. Mineral Wool is used as an infill material to provide with integrity, stability and insulation. This door can be made in Single leaf or Double leaf (Bi-parting Door) or depending upon the requirement and suit the application and conditions prevailing at site. This door comprises of Sliding Rail to guide the panel, fusible link (fire rated at 68 deg.C), wire rope, bottom rollers to guide the panel at the bottom, counter weights etc. This door is always kept into open position and at the time of fire break, fusible link melts which allows the counter weight hung to the wire rope to pull the panel automatically close and to prevent fire from spreading further. Standard accessories are included in the supply.

FINISH

The door are primed with Zinc-Phosphate Stoving Primer and finished with two coats of Polyurethane paint as required up to a minimum of 70 microns.

NIHVA Technologies Pvt. Ltd.
187, G-Block, Thermax chowk, MIDC
Chinchwad, Pune – 411019.
Phone: +91 (0) 2066304033

Scanned by CamScanner

RADIANT SAFEDOORS PVT. LTD.
539, PHASE II, GIDC, VATVA, AHMEDABAD - 382445. INDIA
PHONE : 9099911791 - 9712921330
Email : radiant@radiantsafedoors.com • rdoors@vsnl.net
URL : www.radiantsafedoors.com

ISO 9001 : 2008 COMPANY

Date: 23-11-2018

TO WHOMSOEVER IT MAY CONCERN

This is to certify that M/s. Nihva Technologies Pvt. Ltd., Pune are our authorized Business Partners in India and can sell, service our products as well and do value addition in terms of Automation in India till 31-03-2019, subject to further renewal thereafter.

FOR, RADIANT SAFEDOORS PVT. LTD.
Kunal M. Patel
DIRECTOR

RADIANT+
DOORS R US

Scanned by CamScanner