

SHUTTER TYPE	2HRS FIRE RATED SHUTTER
SHUTTER SLATS	1.0 mm GALVALUME STEEL SOLID SLATS
FINISHING OF SLATS	POWER COAT STANDARD RAL COLOUR
GUIDE RAIL	GALVANIZED ,3mm THICK
FINISHING OF GUIDE	POWDER COAT STANDARD RAL COLOUR
BOTTOM BAR	T-120
FINISHING OF B/BAR	POWDER COAT STANDARD RAL COLOUR
BOX DESIGN	MILD STEEL SECTION FRAME DESIGN
FINISHING OF BOX	POWDER COAT STANDARD RAL COLOUR
BOX COVER PLATE	0.8mm GALVANISED STEEL SHEET
FINISHING OF COVER	POWDER COAT STANDARD RAL COLOUR
OPERATION	MOTORIZE WITH MANUAL OVERRIDE CHAIN
MOTOR POWER SOURCE	230 VOLTS,1 PHASE,50HZ
FIRE MODE	THERMAL FUSIBLE LINK WILL AUTO CLOSE BY GRAVITY FORCE WHEN ROOM TEMP RISES UP TO 68°C FIRE SIGNAL FROM FIRE CONTROL ROOM AND SHUTTER SHALL CLOSE DOWN BY GRAVITY FORCE WITHOUT DELAY


LOCATION	SHUTTER NO.	CLEAR WIDTH (STRUCTURE)	CLEAR WIDTH (STRUCTURE)	QUANTITY	MOTOR POSITION
	FRS	1700 mm	3000 mm	1	RH

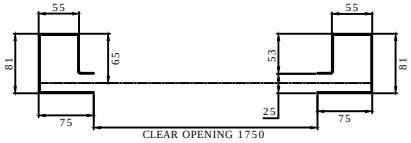


GALVANISED STEEL GUIDE RAIL
THICKNESS 3mm




SHUTTER SLAT




FIRE RATED BOTTOM BAR

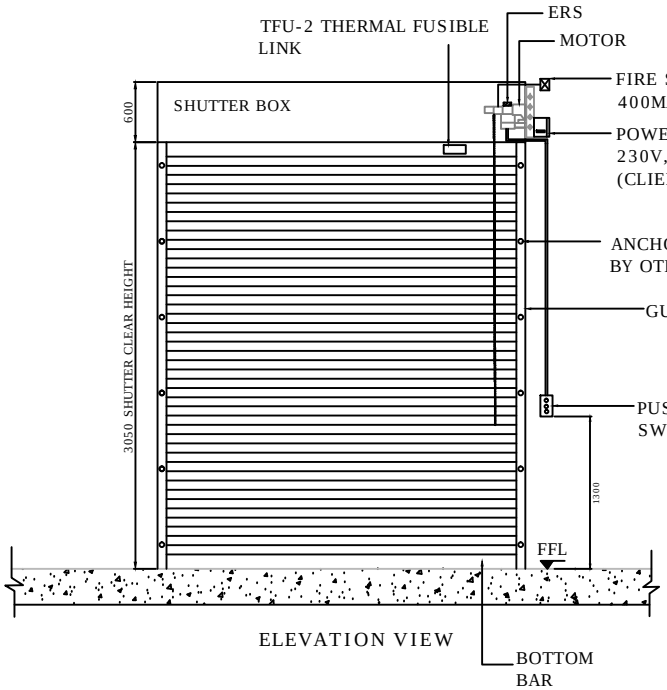

ELEVATION VIEW

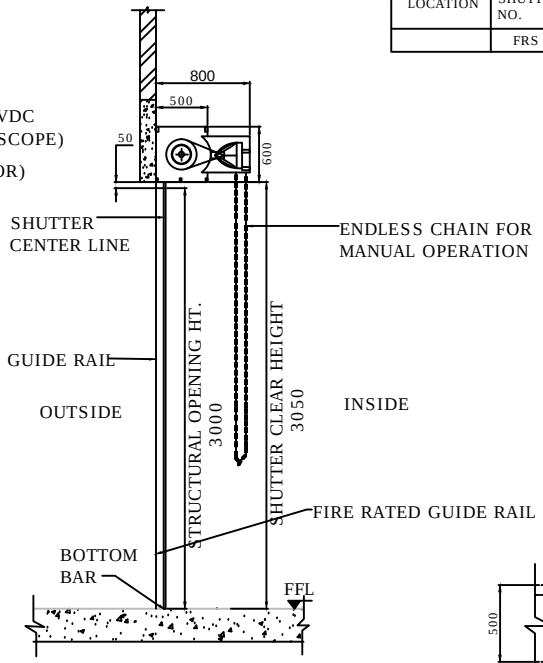


SIDE VIEW

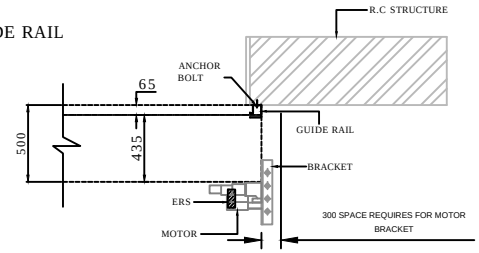

GUIDE & MOTOR ASSEMBLY DETAILS

NOTE- WIDTH & HEIGHT OF SHUTTER WILL BE 50mm
MORE THAN CLEAR WIDTH

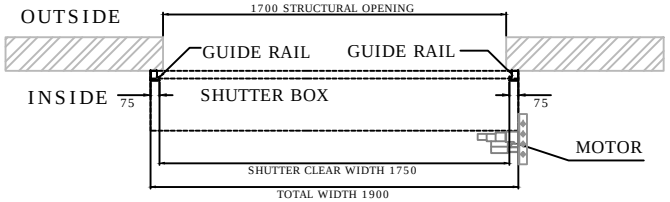

PLAN VIEW

SHUTTER COLOR - 1.RAL 7025 GREY
2. RAL 9010 PURE WHITE

CLEAR WIDTH (CW)	CLEAR HEIGHT (CH)	QUANTITY
1700	3000	01 NOS

This drawing & design is the property of NIHVA TECHNOLOGIES. Not to be sold or copied to any other concern.

TITLE	FIRE RATED ROLLING SHUTTER 1		NIHVA TECHNOLOGIES PVT. LTD. PUNE Tel : 020 66304033 Email:- info@nihva.com Website:- www.nihva.com
	SIGN	DATE	
DRAWN	OMKAR	24/08/17	CLIENT - PACK INNOVATIONS
CHECK	SHEKHAR	24/08/17	PROJECT -
REV.			SITE - CHAKAN,PUNE
APPROVAL	SHEKHAR	24/08/17	DWG. NO. : NIHVA/17-18/0176
If any queries contact : projects@nihva.com			SCALE: NTS | WT: | SHEET: 01 OF 01
ALL DIMENSION ARE IN mm			