

PROPOSED PLAN

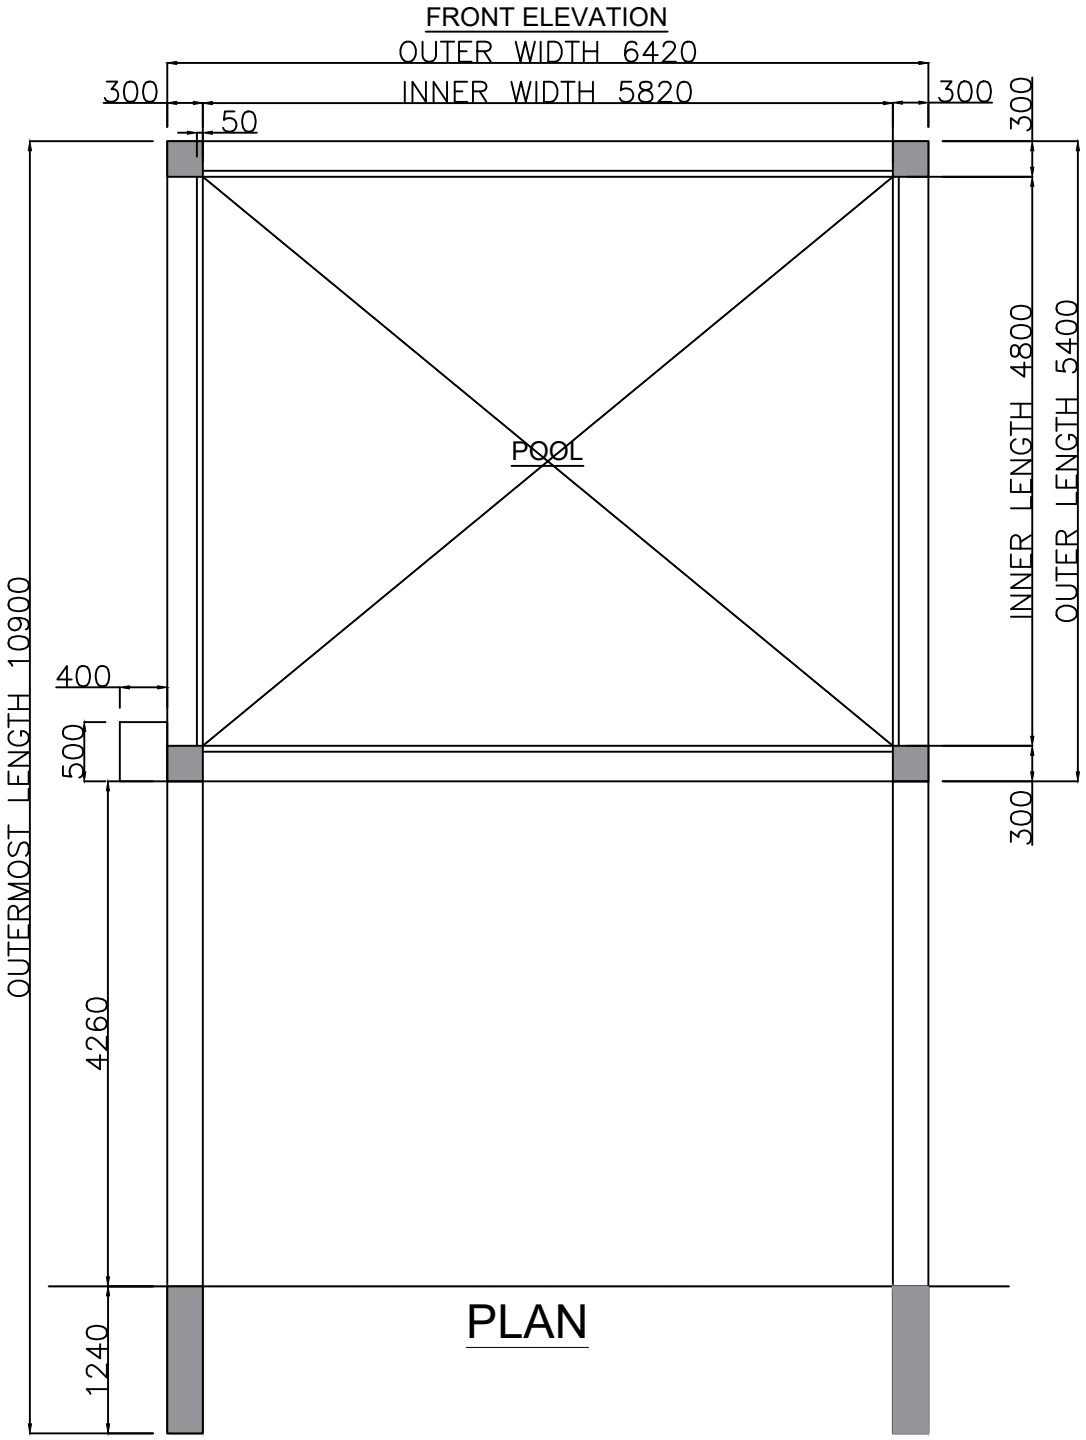

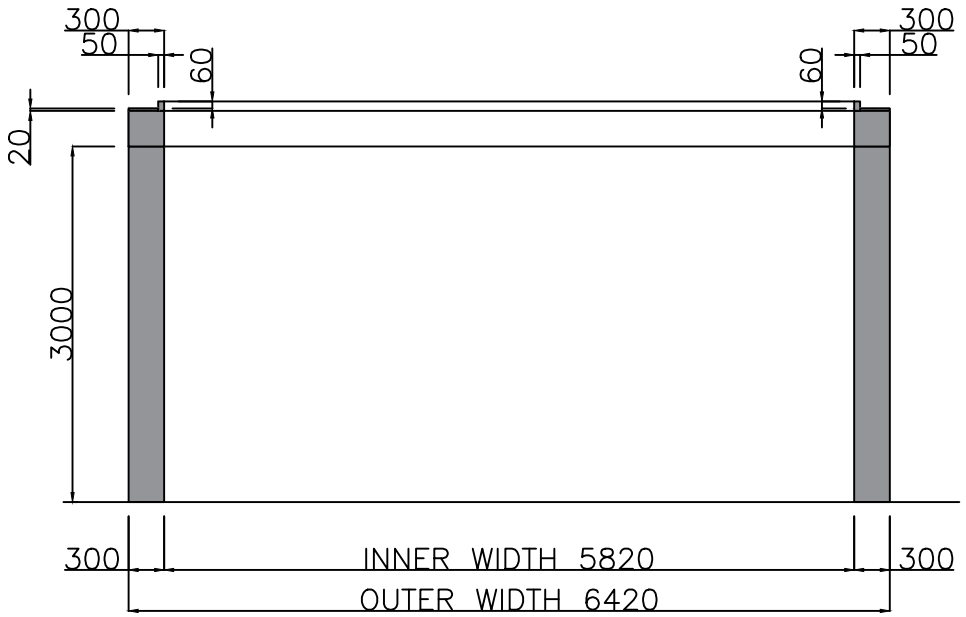

SECTION A-A'

1. THE STRUCTURE AROUND THE CUT OUT SHOULD BE OF CONCRETE FOR FOR PROPER FASTENING OF ROOF.
2. INNER PROJECTION OF 50X60MM REQUIRED AS A SINGLE STRUCTURE WITHOUT ANY JOINT TO AVOID WATER SEEPAGE INSIDE.
3. TOP SURFACE SHOULD BE OF GRANITE 20MM FOR SMOOTH FUNCTIONING OF ROOF.
4. ROOF EXTENSION IS SHOWN FOR ONLY REFERENCE. IT CAN BE MODIFIED AS PER THE WORK UNDERTAKEN.
5. GRADIENT OF 50MM NEED TO BE PROVIDED ALONG THE OUTER LENGTH TO AVOID WATER STAGNANCY IN GUIDE RAIL.
6. ELECTRICAL REQUIREMENT - 220V 5AMP SINGLE PHASE CONNECTION.
7. ALL DIMENSION IN MM.

This drawing & design is the property of NIHVA TECHNOLOGIES. Not to be sold or copied to any other concern.

TITLE: PROPOSED PLAN LAYOUT				NIHVA TECHNOLOGIES PVT. LTD. PUNE Tel : 020 66304033 Email:- info@nihva.com Website:- www.nihva.com	
	NAME	SIGN	DATE		
DRAWN	S.S.		29.06.22	CLIENT - MR. AGARWAL	
CHECK	A.K.		29.06.22	LOCATION - LUCKNOW_UP_IN	
APPRD.	V.T.		29.06.22	PRODUCT - RETRACTABLE ROOF	
If any queries contact : projectsautomation@nihva.com				NIHVA\22-23\0xxx	REV- 0
ALL DIMENSION ARE IN mm				SCALE: NTS	SHEET: 01 OF 01