

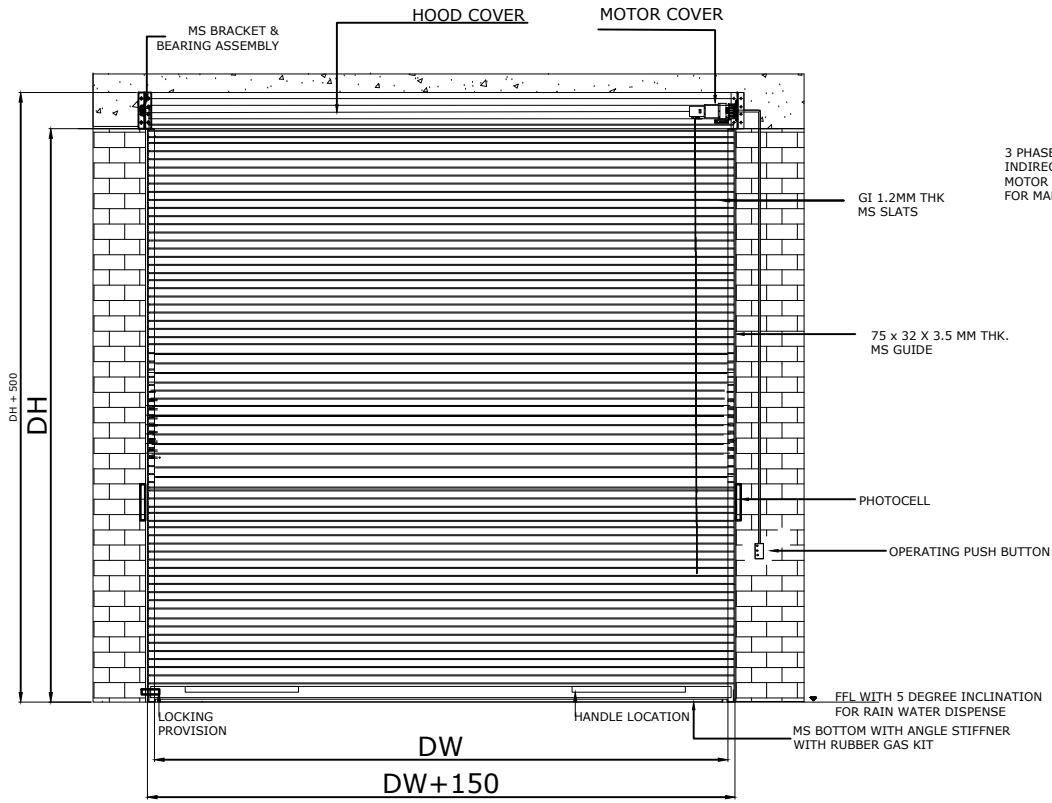


ELEVATION

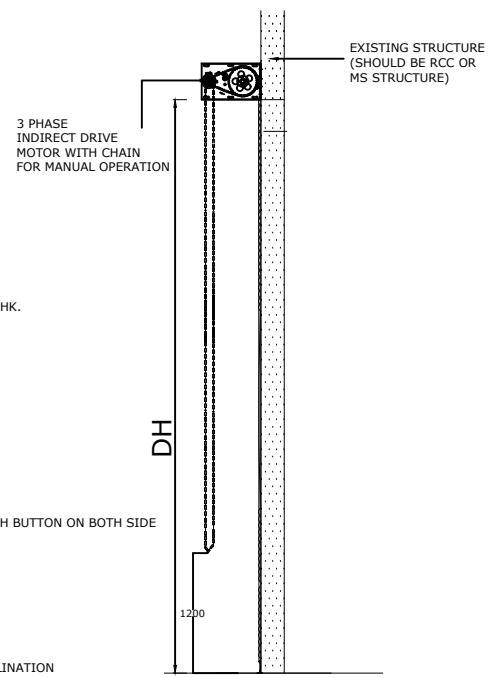

SIDE VIEW

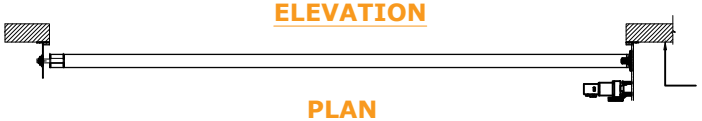

PLAN

Sr .No.	Specification	2 Hour Fire Rated Rolling Shutter
1	Certification	BS 476 Part 22 & MS 1073 Part 3 1988 Tested in Warrington Fire Reasearch Centre UK & Sirim Malasiya
2	Test	UL - 10B Tested
3	Shutter Slats	Zinc coated steel solid slats
4	Shutter Curtain	Roll formed from 1st grade BHP Zincalume steel SKB-A7 curve slat curtain
5	Guide Rail	Fabricated from hot-dipped galvanised steel of 3.0 mm with one piece design surface mounted type.
6	Bottom Bar	Assembled of 2 Pieces of 38 x 38 x 3 mm galvanised steel angle bolted 800 mm pitch with galvanised bolts and nuts or 2 pieces of 40 x 40 x 6 mm steel flat bar.
7	Shutter Enclosure Box	Pressed Galvanised steel sheet to suite box size comply to fire test approved thickness.
8	Operation Control	Gear motor with Thermal protector, limit switches, manual overide, c/w push button switch with keys lockable.
9	Motor Drive Unit	Power Source: 110v 60Hz 1 phase 220v 60Hz 1 phase 230v 50Hz 1 phase 400v 50Hz 3 phase Manual Chain Override One unit push button switch Gravity drop level Auto close by relay switch after receive of 24vdc fire signal
10	Fire Mode	Fire Shutter will auto close via upon receiving of 24VDC fire signal

SIZE:-

DW	DH	QTY
4000	4000	1 No.

NOTE:-

1. All dimensions are in MM
2. Required civil work will be in client scope

NIHVA TECHNOLOGIES PVT. LTD.

CLIENT -TATA MOTORS

PROJECT-Fire Rated Rolling Shutter

	NAME	DATE	SITE -		
DRAWN	S.J	17/01/2024	DWG. NO. -NIHVA/SO/23-24/060		REV.00
CHECK	A.K	17/01/2024	SCALE: 01	WT:	SHEET: 01 OF 01
APPRD	V.T	17/01/2024	If any queries contact : design1@nihva.com		