

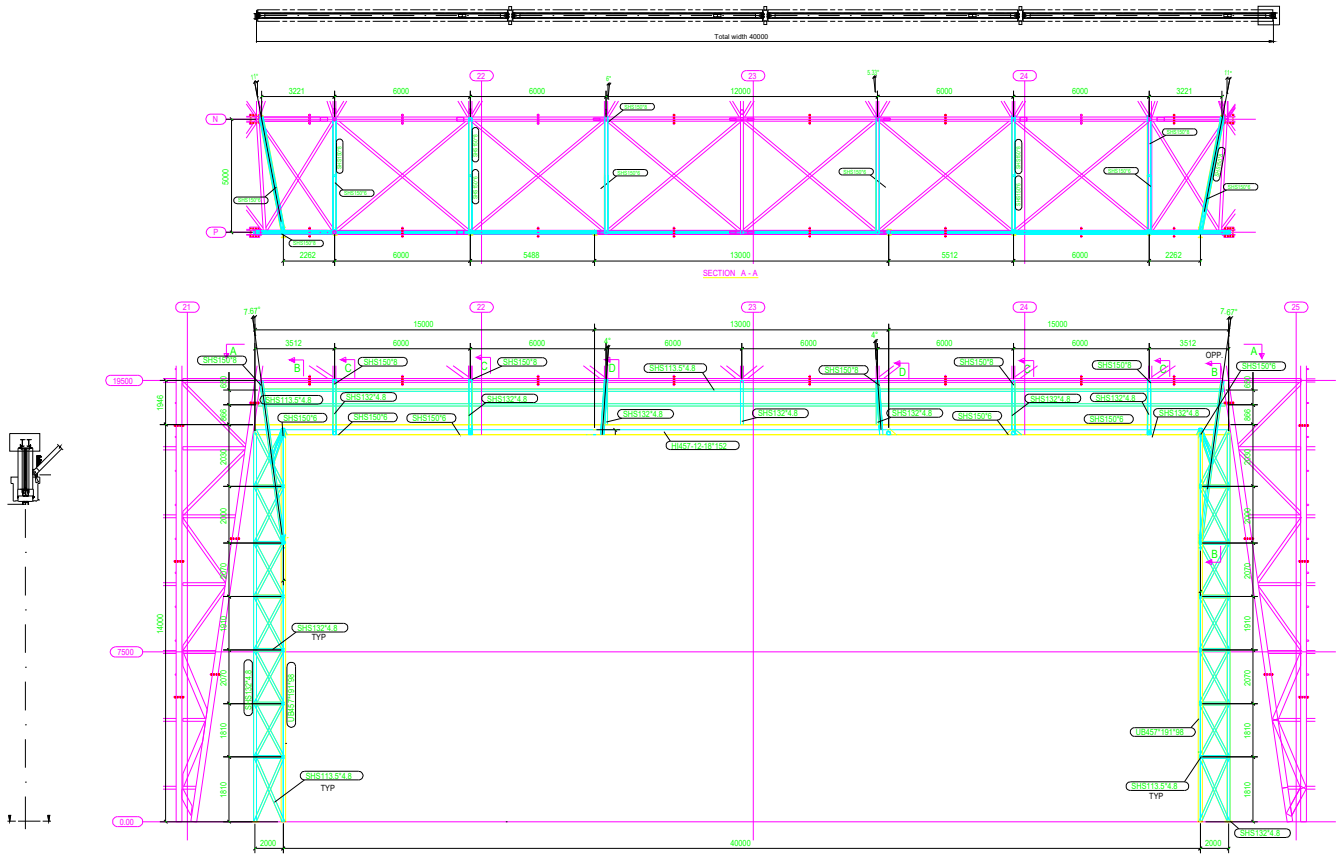




DETAIL I, SCALE (1:20)



NOTES :–

1. ALL DIMENSIONS ARE IN MM & LEVEL ARE IN METER.
2. ALL STRUCTURAL STEEL AS PER IS:2062.
3. PROVIDE WELDING AS PER IS:816.
4. PROVIDE MIN. 6MM SHOP WELD AND 8MM SITE WELD
5. USE ELECTRODS AS PER IS:814 (PT.–I).
6. FILLET/ BUTT WELD SHALL BE OF 6MM SIZE AND SHALL BE CONTINUOUS.
7. FABRICATION AND ERECTION SHALL BE AS PER IS:800 AND IS:803.
8. WELD SHALL BE GROUND SMOOTH.
9. ALL GUSSET PLATES SHALL BE MIN. 8 THK.
10. ALL M.S. BLACK BOLTS AND NUTS SHALL CONFORM TO IS:1363(PT. 1 TO 3
11. LIVE LOAD ON ROOF = 75KG/SQM.
12. STRUCTURE SHALL BE APPLIED WITH ONE COAT OF RED OXIDE ZINC CROMATE PRIMER AFTER FABRICATION FOLLOWED ONE MORE COAT BEFORE ERECTION. FINALLY APPLY 2 COATS OF SYNTHETIC ENAMAL OF APPROVED QUALITY.
13. STRUCTURAL MEMBER SHALL BE OF 355N/MM^2 MIN STRENGTH.

This drawing & designing is the property of NIHVA TECHNOLOGIES. Not be sold or copy to any other concern.

TITLE	MEGA DOOR		NIHVA TECHNOLOGY PVT. LTD. PUNE
	SIGN	DATE	Email:- Sales@nihva.com Website :- www.nihva.com
DRAWN	J.P	06/11/25	CLIENT - xyz
CHECK	B.S	07/11/25	PROJECT -MEGA DOOR
REV.	00		SITE - XYZ
APPROVAL	V.T	07/11/25	DWG. NO. : NIHVA/15-16/178
If any queries contact : projects@nihva.com			SCALE: 01 / WT: / SHEET: 01 OF 01
ALL DIMENSION ARE IN mm			