

REV.	DESCRIPTION.	REVISED BY	SIGN	DATE
000	RELEASED GA DWG FOR APPROVAL	A.B		28.01.23

PROPOSED PLAN LAYOUT

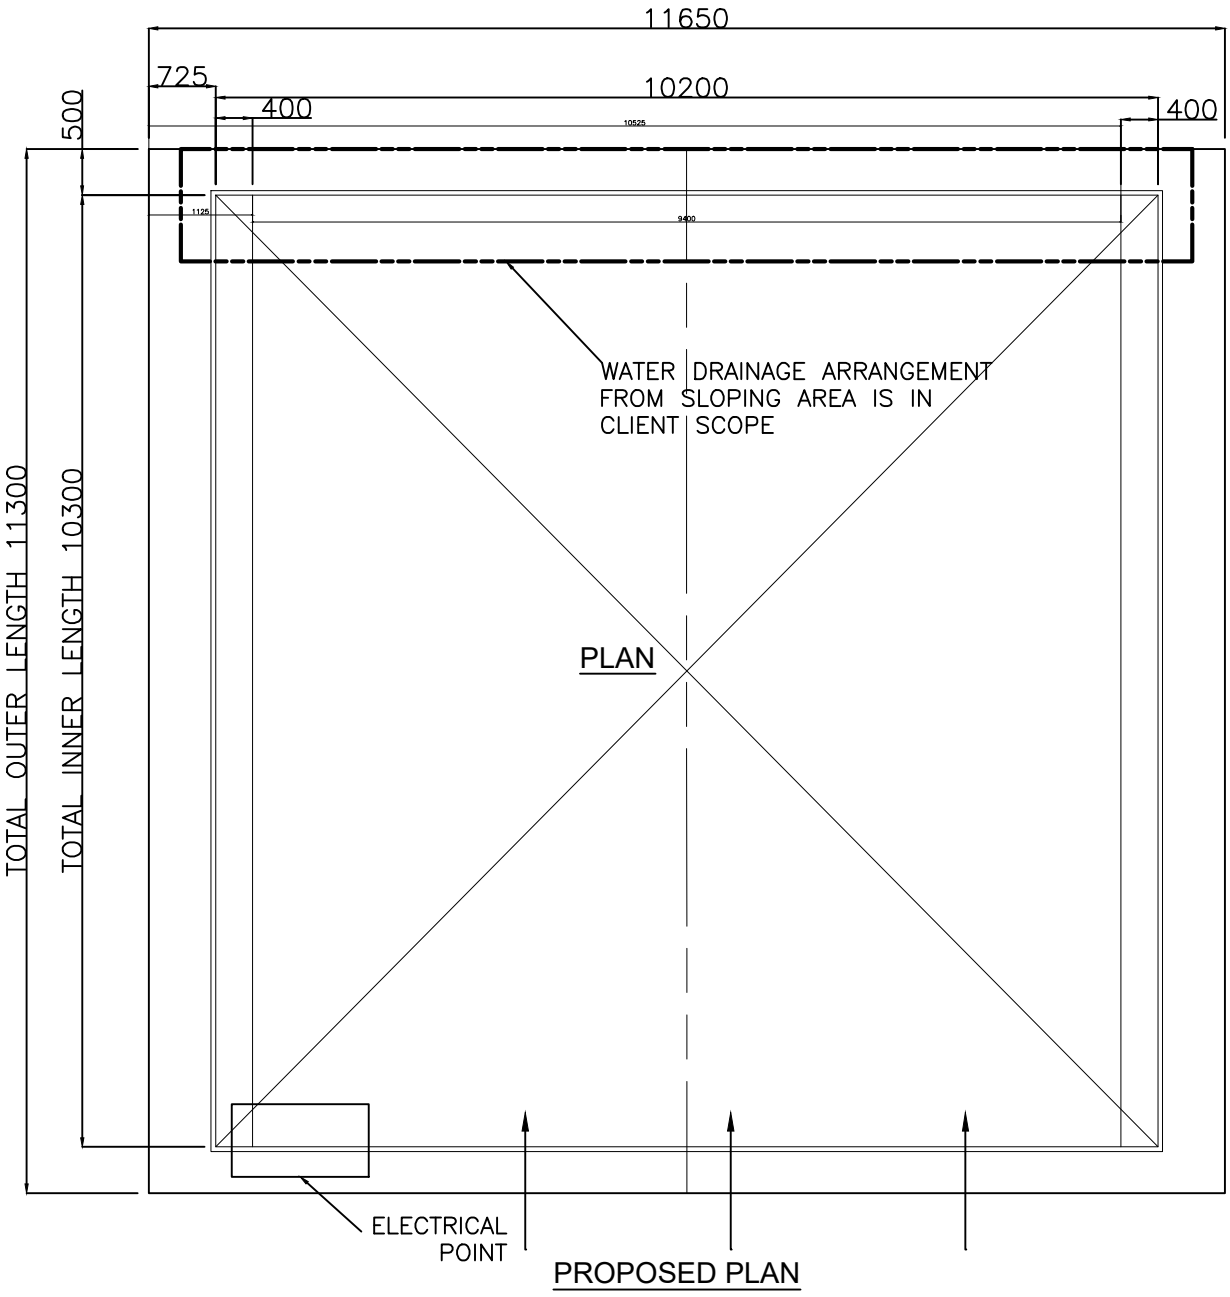

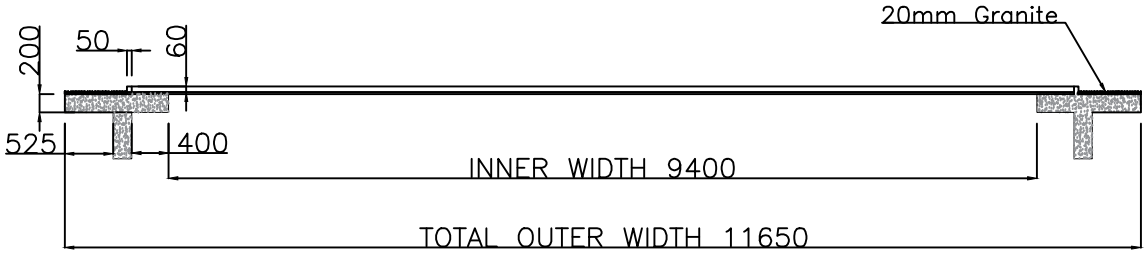

SECTION VIEW

1. THE STRUCTURE AROUND THE CUT OUT SHOULD BE OF CONCRETE FOR FOR PROPER FASTENING OF ROOF.
2. TOP SURFACE SHOULD BE OF GRANITE 20MM FOR SMOOTH FUNCTIONING OF ROOF.
3. ROOF EXTENSION IS SHOWN FOR ONLY REFERENCE. IT CAN BE MODIFIED AS PER THE WORK UNDERTAKEN.
4. GRADIENT OF 80MM NEED TO BE PROVIDED ALONG THE OUTER LENGTH TO AVOID WATER STAGNANCY IN GUIDE RAIL.
5. AL PROFILE - POWDER COATED
6. GASKET - EPDM
7. MOTOR - ITALIAN/GERMAN MAKE
8. ELECTRICAL REQUIREMENT - .
9. ALL DIMENSION IN MM.
10. ALL CIVIL WORK IS IN CLIENT SCOPE

TITLE: PROPOSED PLAN LAYOUT (IN CLIENT SCOPE)			NIHVA TECHNOLOGIES PVT. LTD.
	NAME	SIGN	DATE
DRAWN	A.B.		28.01.23
CHECK	A.B.		28.01.23
APPRD.	VIJAY T.		28.01.23
If any queries contact : projectsautomation@nihva.com			CLIENT - RAVIRAJ REALTY
			LOCATION - PUNE_IN
			PRODUCT - RETRACTABLE ROOF
			NIHVA\22-23\02XX REV- 0
ALL DIMENSION ARE IN mm			SCALE: NTS SHEET: 01 OF 01