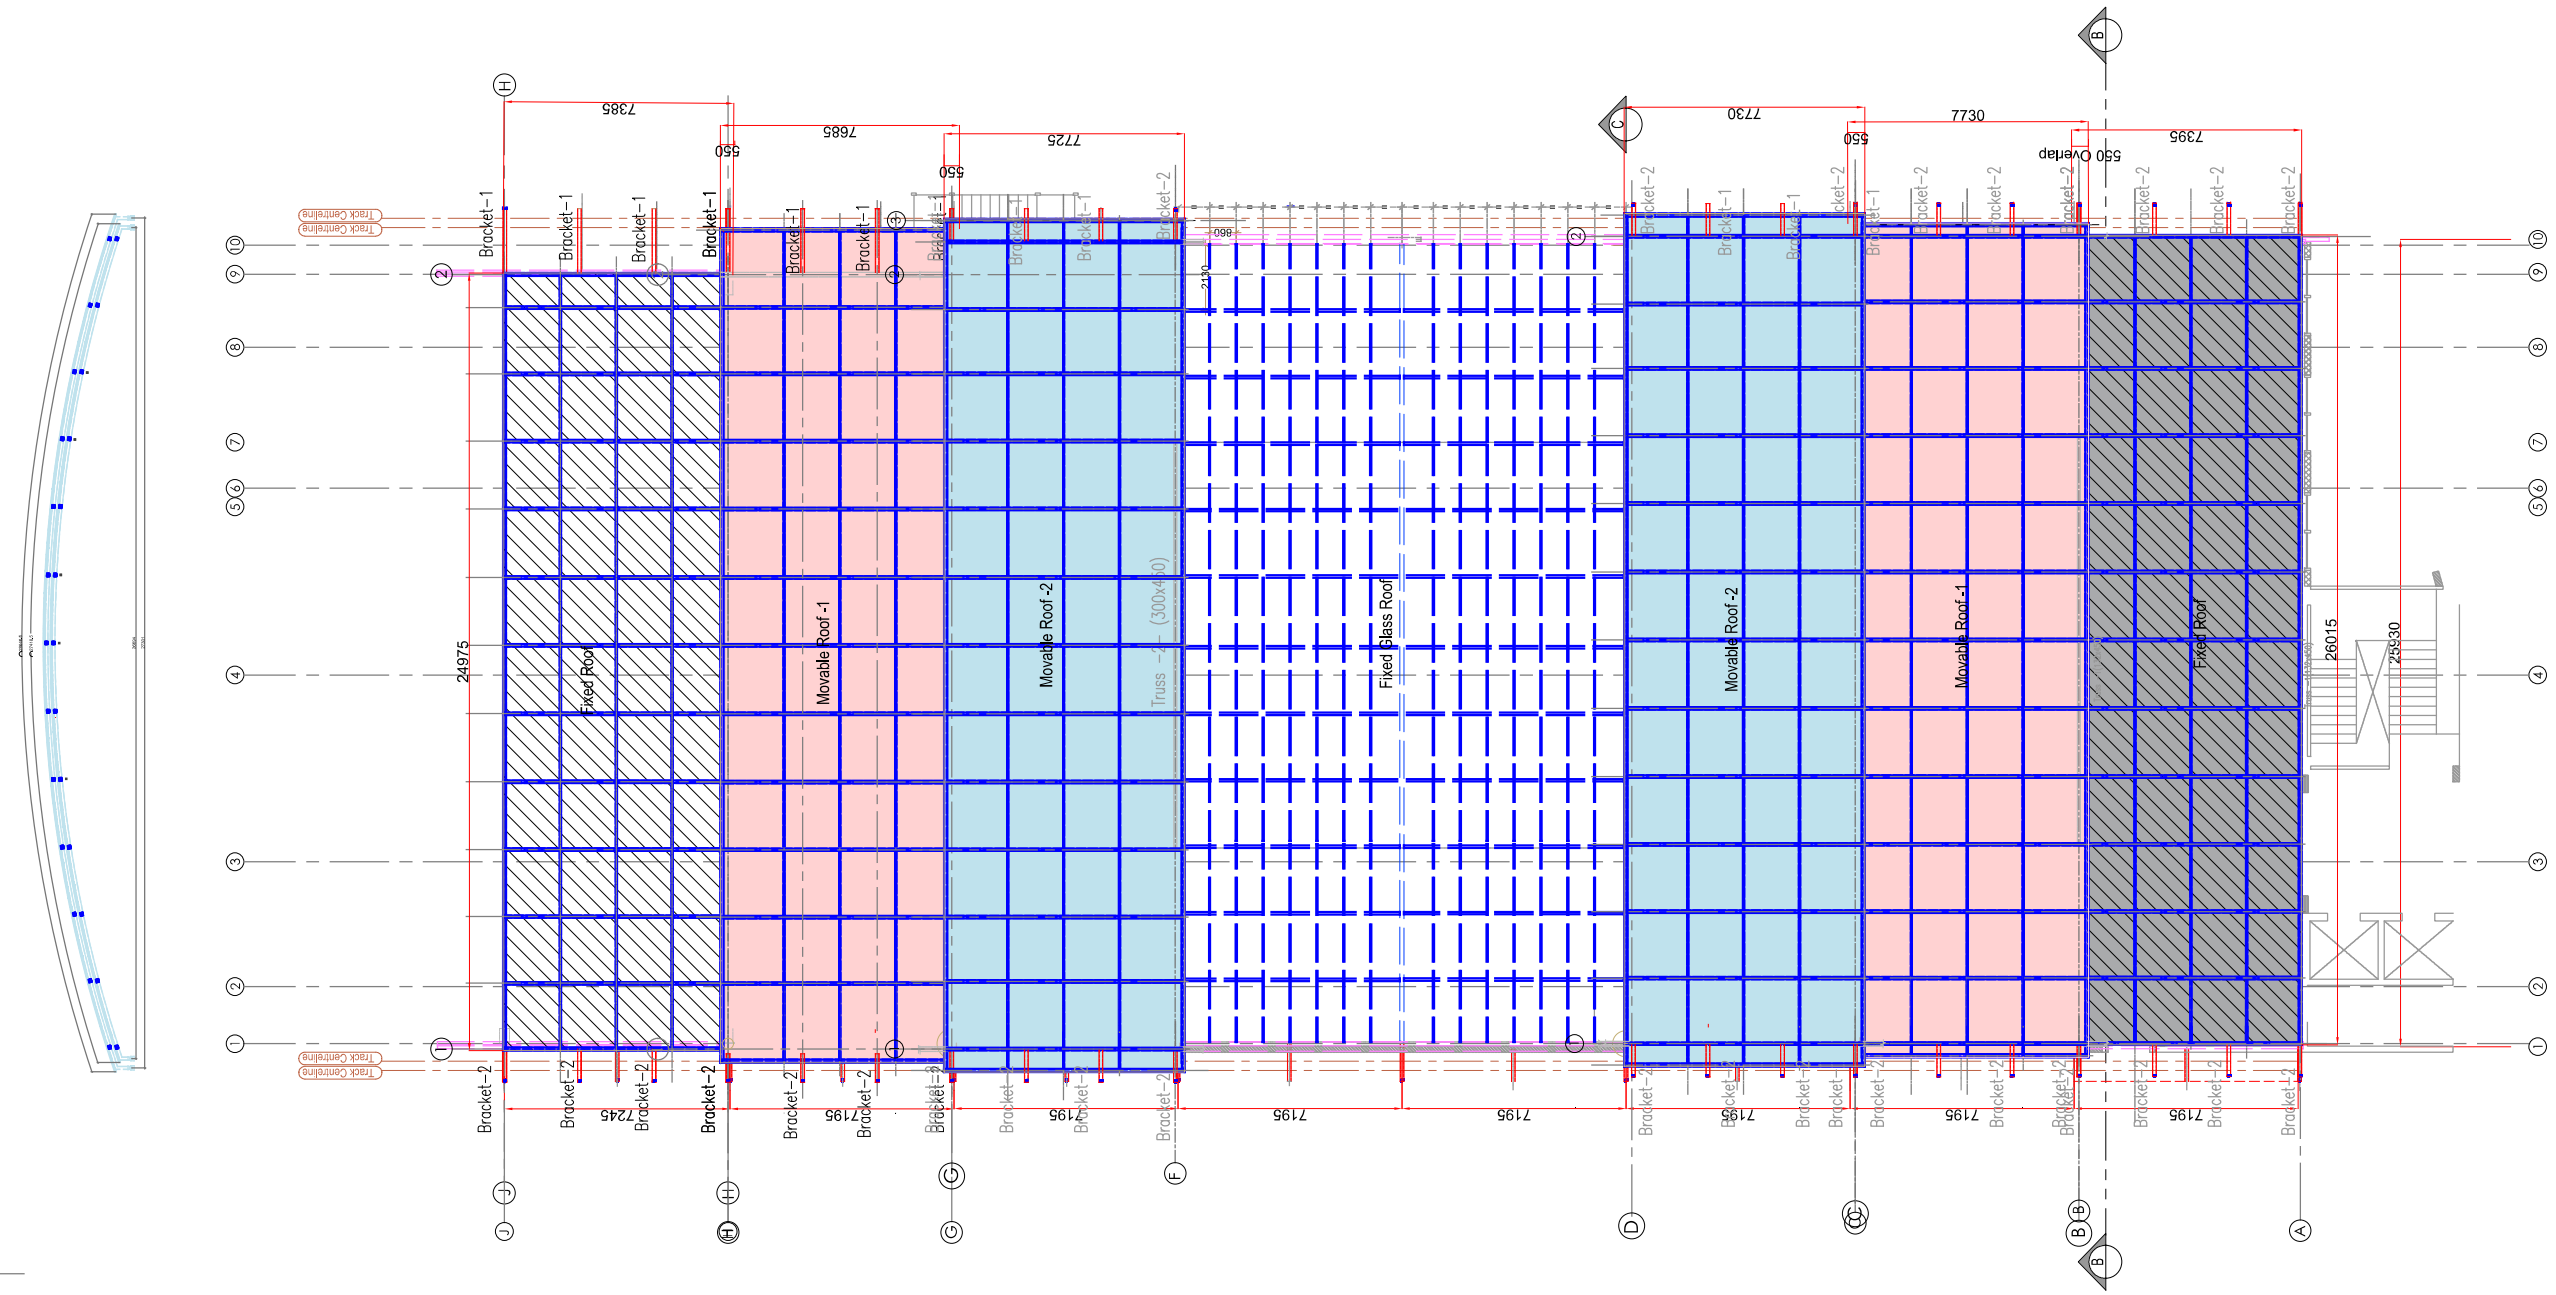


Retractable Roof System

01 -

Structural Steel NOTES:-

1. ALL DIMENSIONS ARE IN mm AND LEVELS ARE METER
2. READ THIS DRAWING IN CONJUNCTION WITH RESPECTIVE ARCH AND STRUCTURAL DRAWING.
3. DO NOT SCALE THE DRAWING.
4. ALL WELD 8mm Thk UNLESS NOT MENTIONED.
5. STEEL GRADE MIN TO BE 310 N/mm^2 FOR BUILTUP SECTIONS.
6. GENERAL PROCEDURE OF WELDING SHALL CONFIRM TO IS816 AND IS823.
8. GENERAL PROCEDURE OF WELDING SHALL CONFIRM TO IS226-1975 ,IS2062-1992
9. 8mm thk FILLET CONTINOUS WELD SHALL BE USED FOR ALTERNATIVELY TACK WELDING ON OTHER SIDE FOR FLANGE AND WEB JOINT.
10. DRAWING DIMENSIONS SHALL BE VERIFIED AT SITE BEFORE FABRICATION.
11. MATERIAL GRADES TO BE USED FOR :
    STEEL:- YST 310 (310N/mm^2)- For Built-up sections
    CONCRETE:- M25
    BOLT:- GRADE 10.9 (min) UNO
    STANDARD STEEL SECTIONS:- YST 310 TO 355 N/mm^2
12. MIN BOLT DIA TO BE USED AS 16mm UNO.
13. THE TERMINATED COLUMN LENGTH ABOVE THIRD FLOOR IS NOT ACHIEVED WHILE DEMOLITION ABOVE THE THIRD (1METER) THEN THE COLUMN TO BE RECASTED WITH FIXING INSERT PLATE AS MENTIONED IN THE DETAIL-1 OR DETAIL-3

Sr.	REVISION	BY

STEM
Structural Consultants

Project Title: BYG VENTURES
Steel Roof Extension for JollyGunj
JP Nagar Bangalore

SCALE:-	DWG BY: RV	CHECKED BY: PV
DATE:- 01-08-2023	DWG No: ST-BV-JP-106A	REV: R0

DWG TITLE:
Glass and Retractable Roof Truss Details and Connections

STRUCTURAL CONSULTANT:
Mr. Prasad