

# PROPOSED PLAN LAYOUT

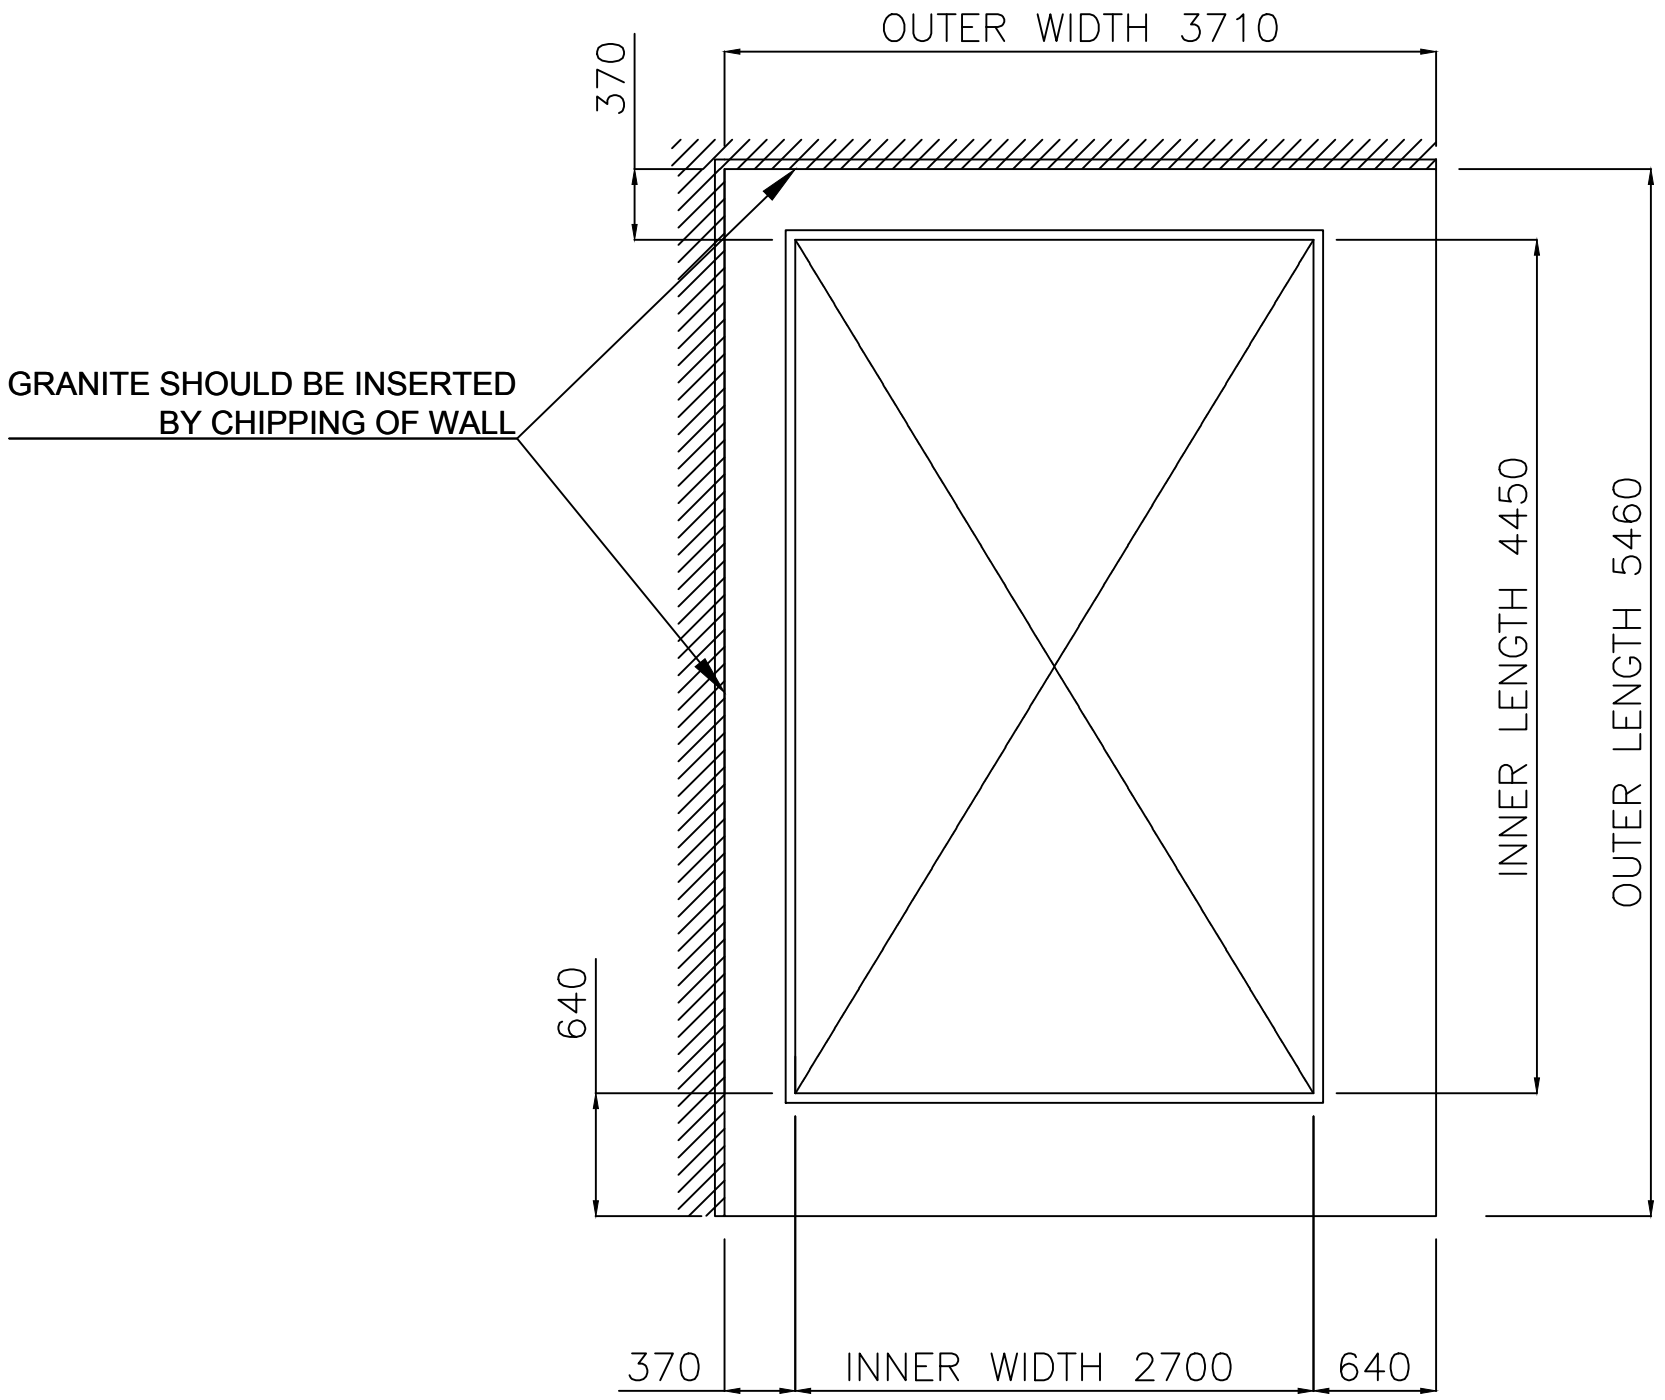


PLAN

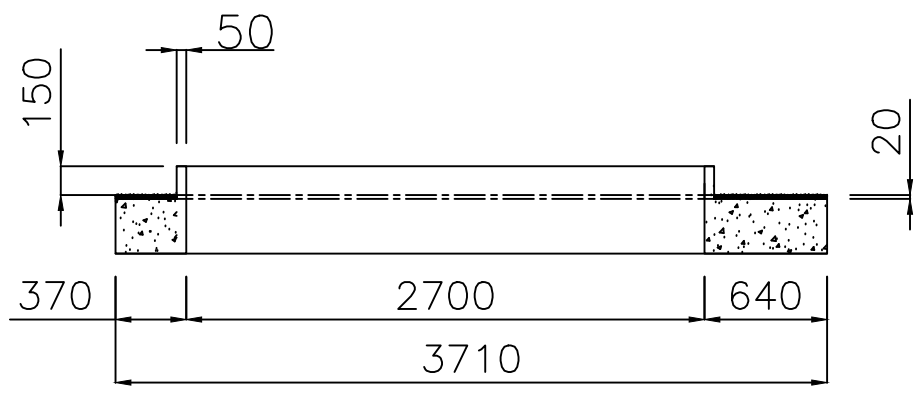


SECTION VIEW

1. THE STRUCTURE AROUND THE CUT OUT SHOULD BE OF CONCRETE FOR PROPER FASTENING OF ROOF.
2. TOP SURFACE SHOULD BE OF GRANITE 20MM FOR SMOOTH FUNCTIONING OF ROOF TOWARDS CONCRETE SIDE.
3. REQUIRED 50X150 MM CONCRETE ELEVATION ALONG THE CUTOUT.
4. GRADIENT OF 100MM NEED TO BE PROVIDED ALONG THE OUTER LENGTH TO AVOID WATER STAGNANCY IN GUIDE RAIL
5. GRANITE SHOULD BE INSERTED BY CHIPPING OF WALL.
6. ELECTRICAL REQUIREMENT - 220V 5AMP SINGLE PHASE CONNECTION.
7. ALL DIMENSION IN MM.

This drawing & design is the property of NIHVA TECHNOLOGIES. Not to be sold or copied to any other concern.

| TITLE: PROPOSED LAYOUT | | | | NIHVA TECHNOLOGIES PVT. LTD. PUNE<br>Tel : 020 66304033<br>Email:- info@nihva.com<br>Website:- www.nihva.com | |
|---|---|---|---|---|---|
| | NAME | SIGN | DATE | | |
| DRAWN | D.V. | | 17.03.2023 | CLIENT - AMOGH DEVELOPERS | |
| CHECK | P.M. | | 17.03.2023 | LOCATION - CHENNAI_TN_IN | |
| APPRD. | V.T. | | 17.03.2023 | PRODUCT - RETRACTABLE ROOF | |
| If any queries contact : supportautomation@nihva.com | | | | NIHVA\20-21\0329 | REV- 1 |
| ALL DIMENSION ARE IN mm | | | | SCALE: NTS | SHEET: 01 OF 01 |