

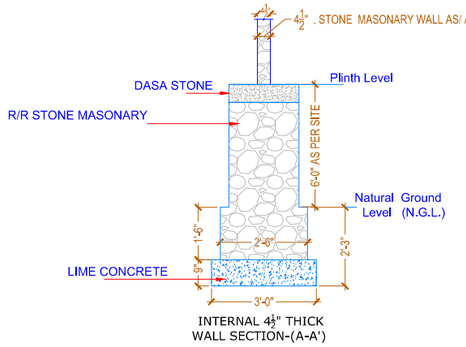



INTERNAL 4½" THICK
WALL SECTION-(A-A')

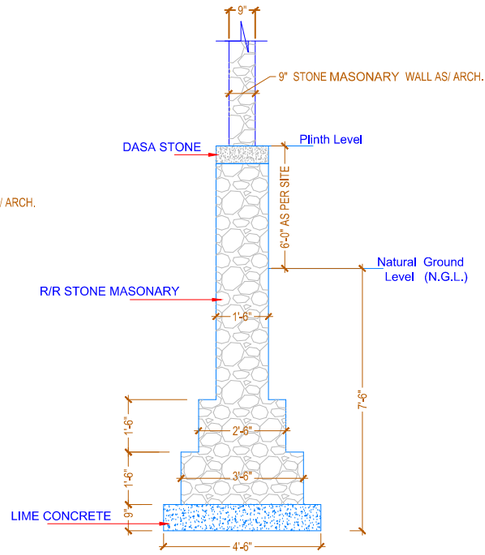


INTERNAL 9" THICK
WALL SECTION-(B-B')

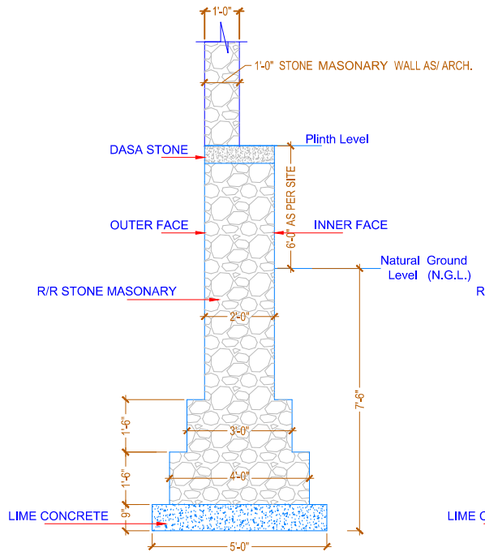


EXTERNAL 1'-0" THICK
WALL SECTION-(C-C')

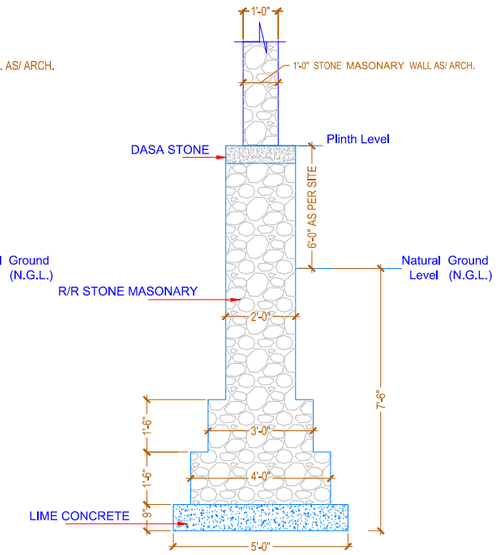


INTERNAL 1'-0" THICK
WALL SECTION-(D-D')

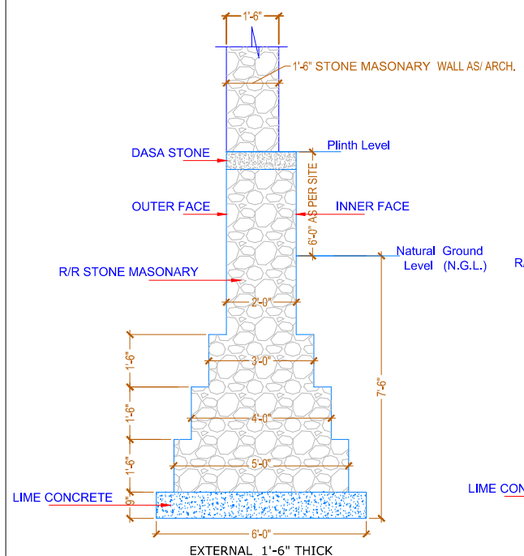


EXTERNAL 1'-6" THICK
WALL SECTION-(E-E')

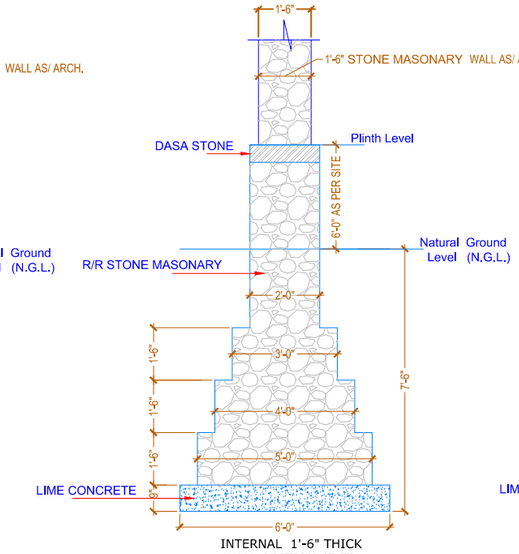

INTERNAL 1'-6" THICK
WALL SECTION-(F-F')

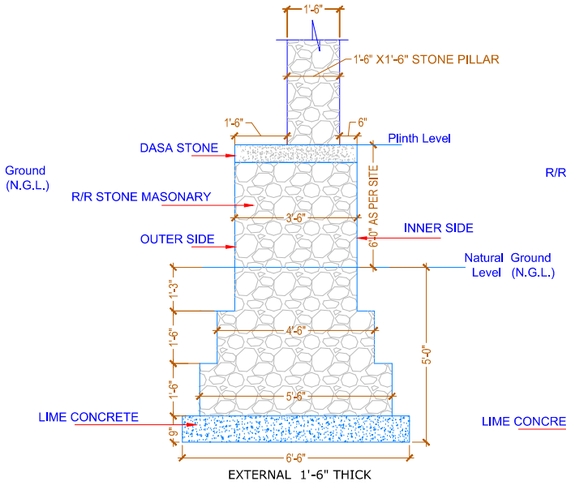

EXTERNAL 1'-6" THICK
WALL SECTION-(G-G')

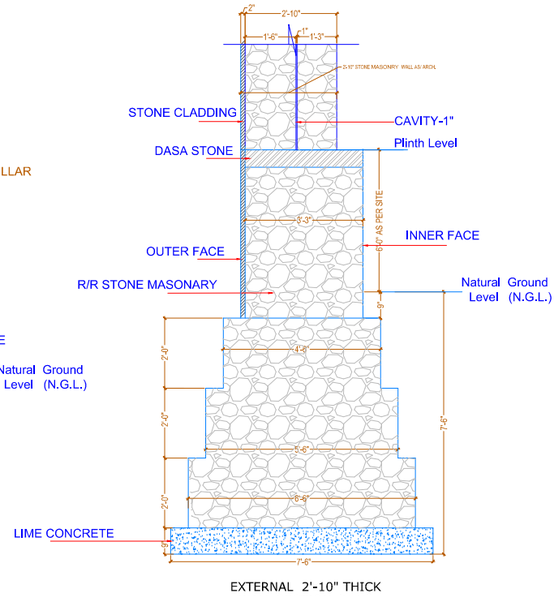

EXTERNAL 2'-10" THICK
WALL SECTION-(H-H')

NOTE - ADVANCE COPY FOR STUDY

PROJECT DETAILS

GENERAL NOTES:-

1. ALL DIMENSION AND LEVEL ARE IN INCH & FEET.
2. DO NOT SCALE THIS DRAWING FOLLOW WRITTEN DIMENSION ONLY.
3. THIS DRAWING SHOULD BE READ IN CONJUNCTION WITH RELEVANT ARCHITECTURAL AND SERVICE DRAWING ANY DISCREPANCY SHOULD BE IMMEDIATELY BROUGHT TO NOTICE.
4. ONLY LOAD BEARING WALLS ARE SHOWN IN PLAN OTHERWISE WALLS SHALL BE STOPPED 1/2" BELOW SOFFIT OF BEAM/SLAB AND GAP FILLED WITH LEAN CEMENT MORTAR UNLESS OTHERWISE SHOWN IN ARCHITECTURAL DRAWING.

REINFORCEMENT DETAILS:-

1. HIGH YIELD STRENGTH DEFORMED BARS MARK WITH, CHARACTERISTIC STRENGTH 500 N/MM² CONFORMING TO IS 1786-1985 SHALL BE USED.,
2. LAP IN SLAB & BEAMS OF SUPER STRUCTURE CLOSE TO MID SPAN FOR BOTTOM BARS & CLOSE TO SUPPORT FOR TOP BARS SHALL BE AVOIDED.
3. LAP SHALL BE STAGGERED SO THAT NO MORE THAN 1/3 OF BARS,SHALL BE LAPPED AT ANY SECTION
4. TIES OR DISTRIBUTION REINFORCEMENT IN THE SLAB SHALL BE PROVIDED OF 8Ø@200mm C/C UNLESS OTHERWISE MENTIONED.
5. LAP LENGTH FOR HIGH YIELD STRENGTH DEFORMED BARS SHALL BE AS FOLLOW.

CONC. GRADE	Ldt	Ldc
M-20	47Ø	38Ø
M-25	41Ø	33Ø
M-30	38Ø	30Ø

CONCRETE DETAILS:-

1. NOMINAL SIZE OF CRUSHED STONE GRADED AGGREGATE SHALL BE 3/4" UNLESS OTHERWISE STATED.
2. GRADE OF CONCRETE SHALL BE M-20CONFORMING TO UNLESS IS 456-2000 OTHERWISE NOTED.
3. CLEAR COVER OF CONCRETE IN INCHES TO THE MAIN REINFORCEMENT UNLESS SPECIFIED OTHERWISE SHALL BE

PRTICULAR	BOTTOM	TOP	SIDES
SLAB	3/4"(20MM.)	2/3"(15MM.)	
FOOTING	3"(50MM.)	2"(50MM.)	2"(50MM.)
RETAINING WALL		1"(25MM.)	1 1/2"(40MM.) (EARTH SIDE) ¾"(20MM.) (IN SIDE)
COLUMNS			1 1/2"(40MM.)
BEAMS, LINTEL	1"(25MM.)	1"(25MM.)	1"(25MM.)
WALLS,FLOOR SLAB & ROOF SLAB OF WATER TANK.			1"(25MM.) ON WATER FACE ¾"(20MM.) 1½"(40MM.) (ON EARTH SIDE) WHERE APPLICABLE

REV.NO	DATE	DESCRIPTION
01	06.05.21	OUTER WALL SECTION REVISED

DRAWING STATUS :

ISSUED FOR CONSTRUCTION

PROJECT NAME :

MERAABIKA BHAWAN
JAIPUR

STRUCTURAL CONSULTANT :

CREATIVE CONSULTANT
ISKCON ROAD,MANSAROVER,JAIPUR
(MO. 99289-78426)

ARCHITECT:

SPACES™
ARCHITECTS, INTERIORS & ALLIED SERVICES
SPACES PRIME REALTY (PVT.) LTD.
23- KRISHNA VIHAR GOPALPURA BYPASS JAIPUR
MO-9351327891 ,spaces.jpr@gmail.com
CONSULTANT- CONSTRUCTION - REAL ESTATE

DESIGN BY:	P.Y.	DRAWN BY:	P.K.
CHECKED BY:	D.S.	APPROVED BY:	A.M.
PROJECT NO:	.....		
PROJECT START:	.....		
DATE OF REF. DRAWING	06-05-2021		

SHEET TITLE :

FOUNADATION WALL SECTION

SHEET NO :

DISCLAIMER :

THIS DRAWING BELONGS TO THE PROPERTY OF CREATIVE CONSULTANT AND MUST NOT BE COPIED DUPLICATED NOR DISCLOSED TO ANY THIRD PARTY, NOR USED IN ANY MANNER WITHOUT PRIOR WRITTEN CONSENT OF CREATIVE CONSULTANT .