


REPRESENTATION DRAWING

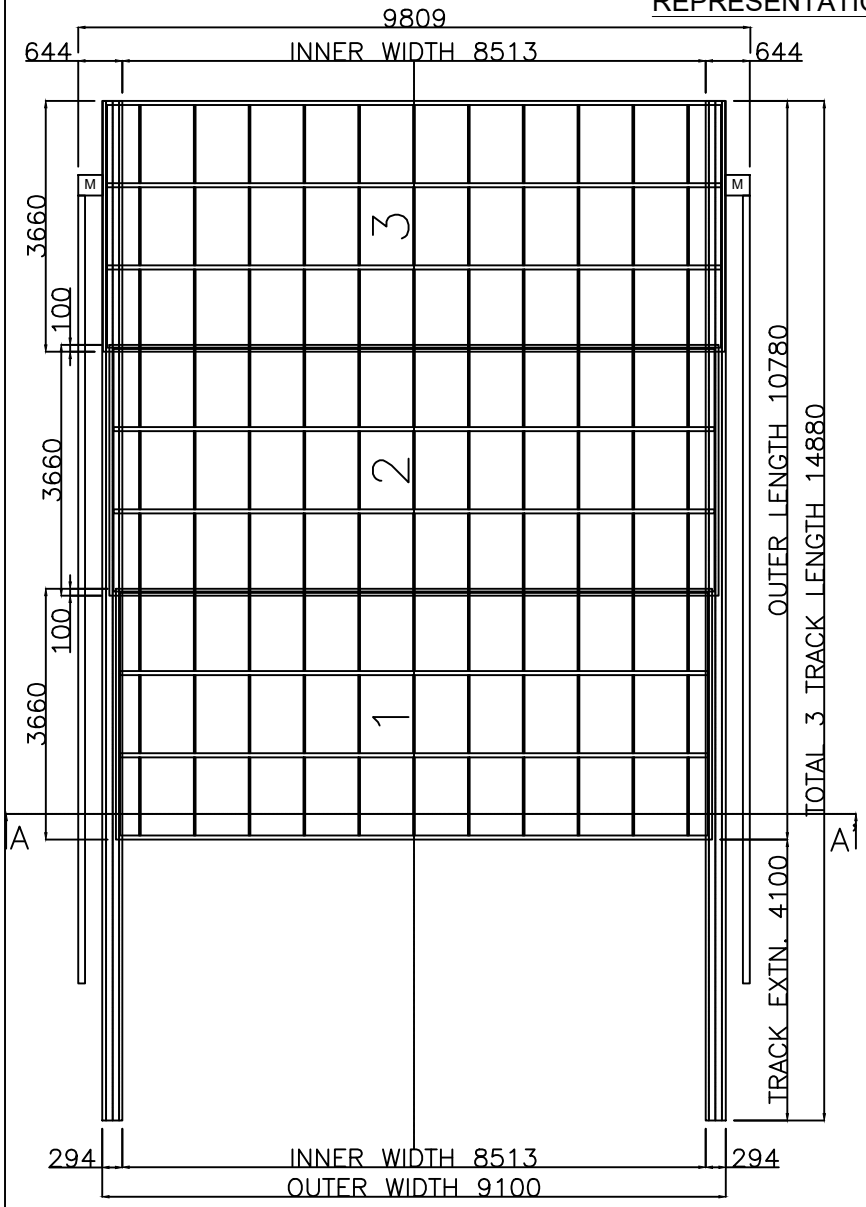

ENCLOSED PLAN

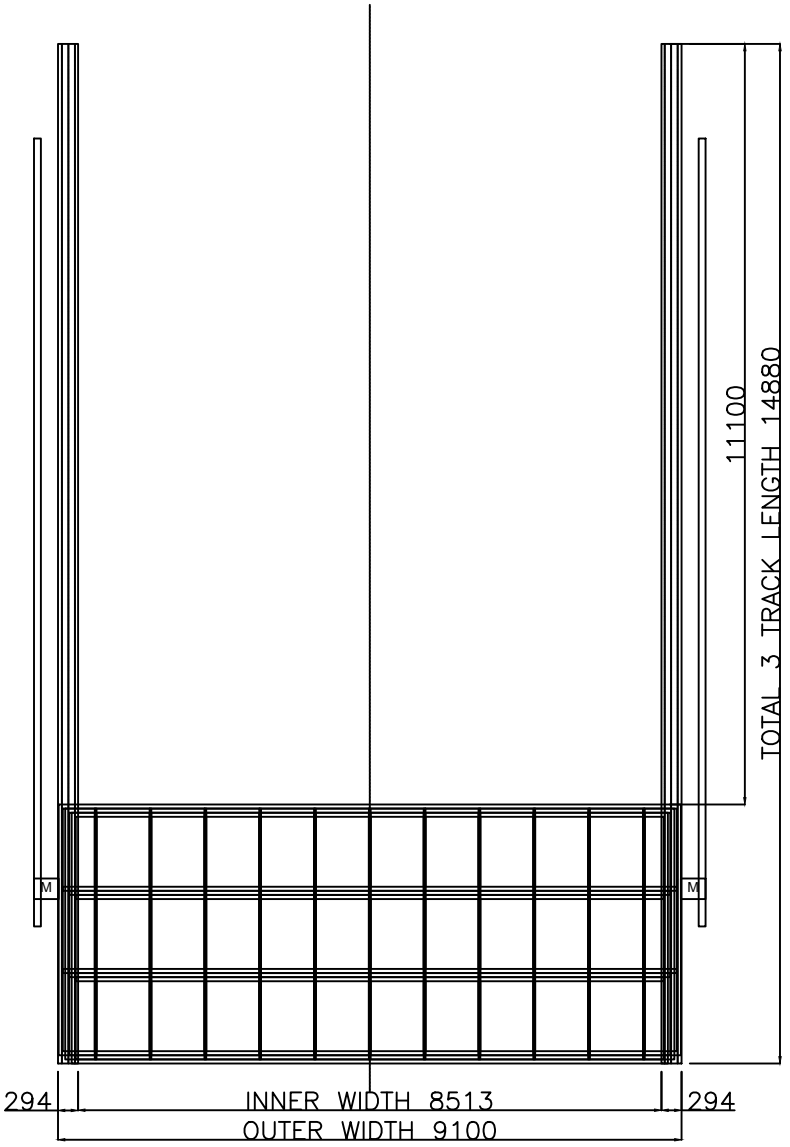

STACKED PLAN

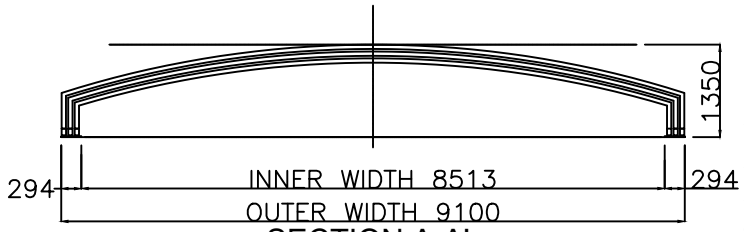

SECTION A-A'

1. THE STRUCTURE AROUND THE CUT OUT SHOULD BE OF CONCRETE FOR FOR PROPER FASTENING OF ROOF.
2. TOP SURFACE SHOULD BE OF GRANITE 20MM FOR SMOOTH FUNCTIONING OF ROOF.
3. ROOF EXTENSION IS SHOWN FOR ONLY REFERENCE. IT CAN BE MODIFIED AS PER THE WORK UNDERTAKEN.
4. GRADIENT OF 50MM NEED TO BE PROVIDED ALONG THE OUTER LENGTH TO AVOID WATER STAGNANCY IN GUIDE RAIL.
5. AL PROFILE - POWDER COATED 60X63 MM
6. GASKET - EPDM
7. MOTOR - ITALIAN/GERMAN MAKE
8. ELECTRICAL REQUIREMENT - 220V 5AMP SINGLE PHASE CONNECTION.
9. ALL DIMENSION IN MM.