
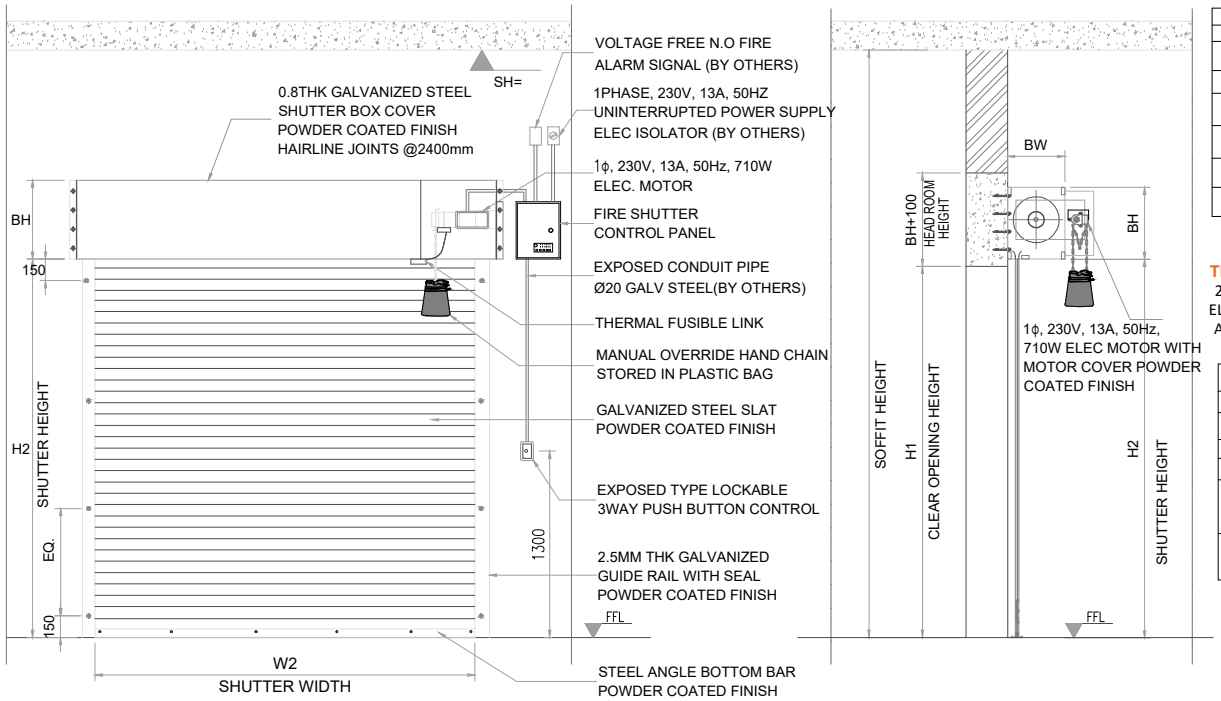




| | | | OPENING SIZE | | SHUTTER SIZE | | HEAD BOX SIZE | | MOTOR LOCATION | SHUTTER FINISH |
|---|---|---|---|---|---|---|---|---|---|---|
| | LOCATION | QTY | W1 | H1 | W2 | H2 | BW | BH | | |
| 1 | PLANT1 & 2 | 14 | 2700 | 3500 | 2750 | 3550 | 500 | 600 | TBC | EXPLOSION PROOF ELECTRICAL SYSTEM AS PER ZONE 1 |
| 2 | RM+FG STORE+IBC STORE+DRUM STORAGE | 6 | 2700 | 3500 | 2750 | 3550 | 500 | 600 | TBC | EXPLOSION PROOF ELECTRICAL SYSTEM AS PER ZONE 1 |
| 3 | RM+FG STORE+IBC STORE+DRUM STORAGE | 3 | 2700 | 4000 | 2750 | 4050 | 500 | 600 | TBC | EXPLOSION PROOF ELECTRICAL SYSTEM AS PER ZONE 1 |
| 4 | PACKING MATERIAL STORE+WMB RM STORE | 3 | 2700 | 3500 | 2750 | 3550 | 500 | 600 | TBC | WITHOUT EXPLOSION PROOF ELECTRICAL SYSTEM |
| 5 | PACKING MATERIAL STORE+WMB RM STORE | 1 | 2700 | 6000 | 2750 | 6050 | 550 | 650 | TBC | WITHOUT EXPLOSION PROOF ELECTRICAL SYSTEM |


## TECHNICAL SPECIFICATION :

2 HRS FIRE RATED MOTORISED ROLLING SHUTTER WITH EXPLOSION-PROOF ELECTRICAL SYSTEM (ATEX ZONE 1) FOR QTY 23 NOS AND BALANCE 4NOS ARE 2 HRS FIRE RATED

| SR. | SPECIFICATIONS | DETAILS |
|---|---|---|
| 1 | OPERATING MODE | MOTORISED |
| 2 | CERTIFICATION TYPE | BS EN1634-1 2014 + A1 : 2018 |
| 3 | FIRE RATING HRS | 2 HOUR FIRE RATED FERCO MOTORISED ROLLING SHUTTER |
| 4 | RAL COLOUR | RAL 3020 |
| 5 | CONSIDER FOR MOUNTING AREA = 2HRS FIRERATED SHUTTER SIZES WITH EXPLOSION PROOF ELECTRICAL SYSTEM AS PER ZONE 1 | 1. PLANT 1 & 2 SIZE : 2.7M X 3.5M – 14 NOS<br>2. FOR W/H ( RM+FG STORE; IBC STORE; DRUM STORAGE) = SIZE : 2.7M X 3.5M – 6 NOS + SIZE 2.7M X 4.0M – 3 NOS |
| 6 | CONSIDER FOR MOUNTING AREA = ONLY 2HRS FIRE RATED SHUTTER SIZES WITHOUT EXPLOSION PROOF ELECTRICAL SYSTEM | 1. FOR W/ H ( PACKING MATERIAL STORE AND WB RM STORE) = SIZE : 2.7M X 3.5M – 3 NOS + SIZE : 2.7M X 6.0M – 1 NO |

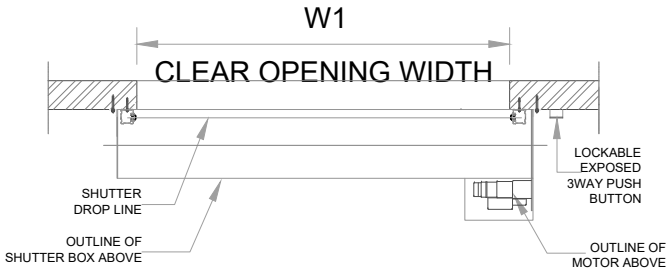



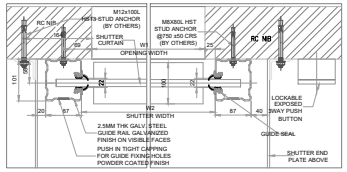NOTE :-
1. All DIMENSIONS ARE IN MM.

This drawing & designing is the property of NIHVA TECHNOLOGIES. Not be sold or copy to any other concern.

| | | | |
|---|---|---|---|
| TITLE | DOOR AUTOMATION | NIHVA TECHNOLOGY PVT. LTD. PUNE | |
| | | Email:- Sales@nihva.com<br>Website:- www.nihva.com | |
| | SIGN | DATE | |
| DRAWN | J.P | 13/02/26 | CLIENT - SIEGWERK INDIA PVT. LTD. |
| CHECK | B.S | 13/02/26 | PROJECT - 2 HRS. FIRE RATED ROLLING SHUTTERS |
| APPROVAL | V.T | 13/02/26 | |
| REV | 00 | | SITE - BHIWADI |
| If any queries contact : Design@nihva.com | | | SCALE: - WT: SHEET: 01 OF 01 |
| ALL DIMENSION ARE IN mm | | | DWG. NO. : NIHVA/25-26/178 |