Be ahead

NIHVA
NIHVA TECHNOLOGIES PVT. LTD.

GIOTTO 60 BT

Barrier with 24V power supply for clear opening up to 6m and opening time 5 sec . Impact Resistance by means of encoder. Grey RAL 7015

TECHNICAL SPECIFICATIONS:

MOTOR:

Power supply	230V±10% 50Hz(*)
Power absorbed	250W (GIOTTO BT 60)
Internal lubrication	permanent grease
Max torque	350 Nm (GIOTTO BT 60)
Opening time	5s (GIOTTO BT 60)
Boom length	6 m (GIOTTO BT 60)
Manual mechanical release	customised key
Type of boom	Round
Limit devices	electrical incorporated and electronically adjustable
Type of use	semi intensive (GIOTTO BT 60)
Working temperature	from -20°C to +55°C
Degree of protection	IP 54
Operator weight (without boom)	41 Kg (GIOTTO BT 60)

SEMAC CONSULTANTS PRIVATE LIMITED

Approved

Be ahead


NIHVA
NIHVA TECHNOLOGIES PVT. LTD.

CONTROL UNIT:

Mains/low voltage insulation	> 2MOhm 500V
Dielectric strength mains/low voltage	3750V~ for 1 minute
Supply to accessories	24V~ (180 mA max absorption)
Barrier-open warning light	24V~ 3W max
Blinker	24V~ 25W max
N° of combinations	4 billion
Built-in Rolling-Code radio-receiver	frequency 433.92MHz
Max. n° of remotes that can be memorized	63

SEMAC CONSULTANTS PVT. LTD.

Approved

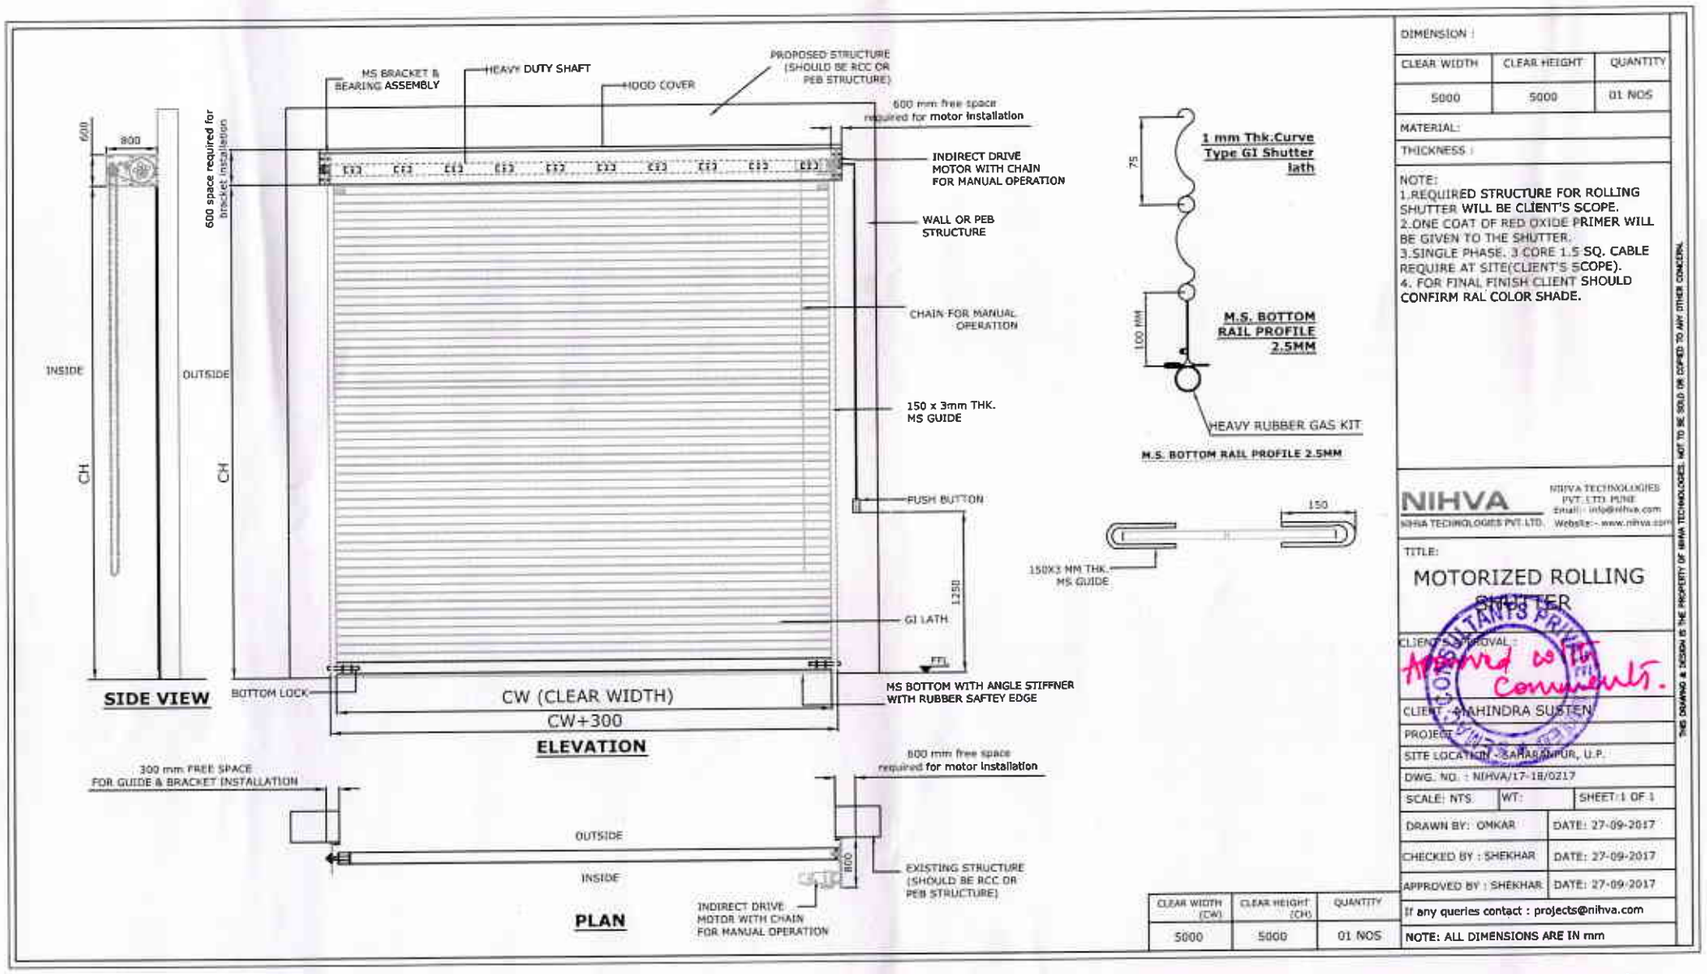

DIMENSION :		
CLEAR WIDTH	CLEAR HEIGHT	QUANTITY
5000	5000	01 NOS

MATERIAL:

THICKNESS :

NOTE:
1.REQUIRED STRUCTURE FOR ROLLING SHUTTER WILL BE CLIENT'S SCOPE.
2.ONE COAT OF RED OXIDE PRIMER WILL BE GIVEN TO THE SHUTTER.
3.SINGLE PHASE, 3 CORE 1.5 SQ. CABLE REQUIRE AT SITE(CLIENT'S SCOPE).
4. FOR FINAL FINISH CLIENT SHOULD CONFIRM RAL COLOR SHADE.

NIHVA

NIHVA TECHNOLOGIES PVT. LTD. PUNE
Email:- info@nihva.com
Website:- www.nihva.com

TITLE:
MOTORIZED ROLLING SHUTTER

CLIENT'S APPROVAL :
Approved with Comments.

CLIENT : MAHINDRA SUSTEN

PROJECT :

SITE LOCATION : SAHARANPUR, U.P.

DWG. NO. : NIHVA/17-18/0217

SCALE: NTS	WT:	SHEET:1 OF 1
DRAWN BY: OMKAR		DATE: 27-09-2017
CHECKED BY : SHEKHAR		DATE: 27-09-2017
APPROVED BY : SHEKHAR		DATE: 27-09-2017

If any queries contact : projects@nihva.com

NOTE: ALL DIMENSIONS ARE IN mm

CLEAR WIDTH (CW)	CLEAR HEIGHT (CH)	QUANTITY
5000	5000	01 NOS

THIS DRAWING & DESIGN IS THE PROPERTY OF NIHVA TECHNOLOGIES. NOT TO BE SOLD OR COPIED TO ANY OTHER CONCERN.

① Max. Wind load/Resistance to be submitted.
② Shutter dimension to be as per GFC. drawing.

SEMAC CONSULTANTS PRIVATE LIMITED

ON :

IDTH	CLEAR HEIGHT	QUANTITY
10	3000	02 NOS
10	4000	01 NOS
10	4000	01 NOS

L:

SS :

RED STRUCTURE FOR ROLLING
R WILL BE CLIENT'S SCOPE.
OAT OF RED OXIDE PRIMER WILL
N TO THE SHUTTER.
E PHASE, 3 CORE 1.5 SQ. CABLE
E AT SITE(CLIENT'S SCOPE).
INAL FINISH CLIENT SHOULD
M RAL COLOR SHADE.

HVA
NIHVA TECHNOLOGIES PVT. LTD. PUNE
Email:- info@nihva.com
NOLOGIES PVT. LTD. Website:- www.nihva.com

TORIZED ROLLING SHUTTER

APPROVAL :

MAHINDRA SUSTEN

CATION - SAHARANPUR, U.P.

. : NIHVA/17-18/0216

VTS	WT:	SHEET:1 OF 1
BY: OMKAR	DATE: 27-09-2017	
) BY : SHEKHAR	DATE: 27-09-2017	
D BY : SHEKHAR	DATE: 27-09-2017	

eries contact : projects@nihva.com

LL DIMENSIONS ARE IN mm


THIS DRAWING & DESIGN IS THE PROPERTY OF NIHVA TECHNOLOGIES. NOT TO BE SOLD OR COPIED TO ANY OTHER CONCERN.

roved with comments


nce to be Submitted.

to be as per our GFC drawing.


OPTION 1

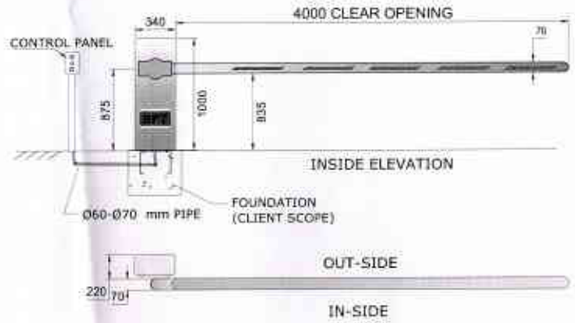


OPTION 2

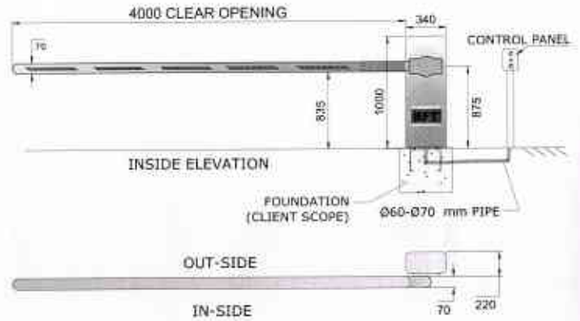


OPTION 3

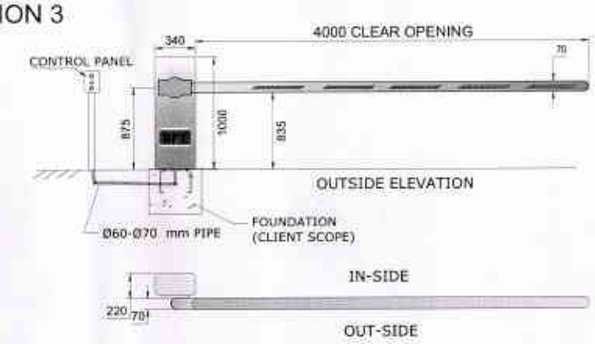

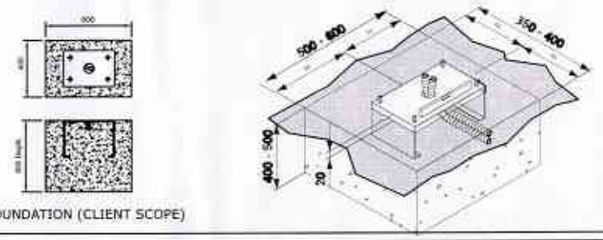

FOUNDATION (CLIENT SCOPE)

OPTION 4

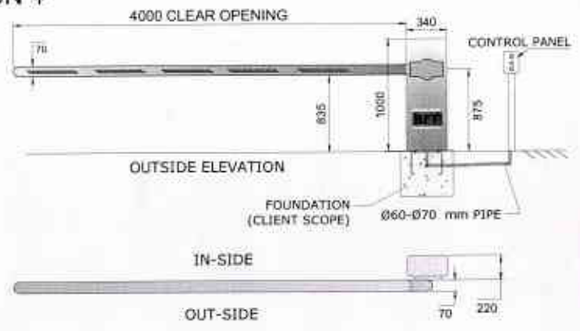

NOTE- CLIENT SHOULD SELECT POSITION OF BOOM BARRIER OUT OF OPTIONS.

This drawing & design is the property of NIHVA TECHNOLOGIES. Not to be sold or copied to any other concern.

TITLE	BOOM BARRIER		NIHVA TECHNOLOGIES PVT. LTD.	NIHVA TECHNOLOGIES PVT. LTD. PUNE Tel : 020 66204033 Email:- info@nihva.com Website:- www.nihva.com
	SIGN	DATE		
DRAWN	SURAJ	27/09/2017	CLIENT -MAHINDRA SUSTEN	
CHECK	SHEKHAR	27/09/2017	PROJECT -	
REV.			SITE LOCATION -SAHARANPUR, U.P	
APPROVAL	SHEKHAR	27/09/2017	DWG. NO. : NIHVA/17-18/0214	
If any queries contact : projects@nihva.com			SCALE: NTS	WT: SHEET: 01 OF 01
ALL DIMENSION ARE in mm				

Approved