


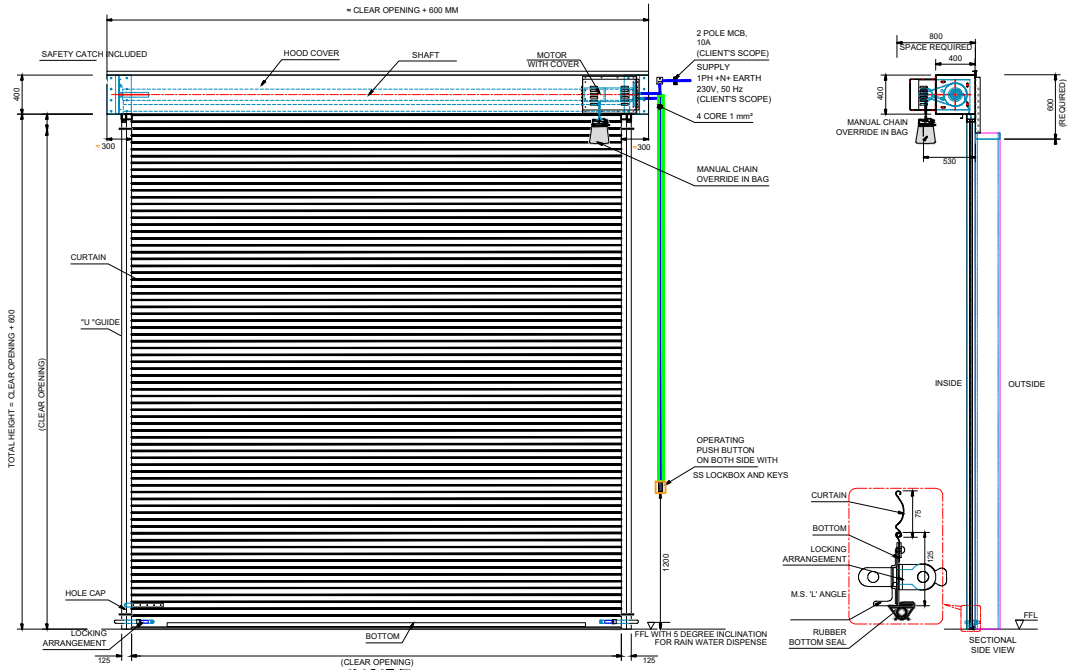

INSIDE

ELEVATION

TECHNICAL SPECIFICATION:-

SR.	SPECIFICATION	DETAILS
1.	Description & Drive	2 hrs Fire Rated Rolling Shutter
2.	Warrington Approved	Fire Rated Shutter Complies to BS 476 Part 22.
3.	Slat Curtain	high grade special quality galvanised steel interlocked slats as per BS standards & designed edge endlock
4.	Bottom Plate	Structured galvanised steel L Shaped section welded with angle stiffener 35x35x5 mm.
5.	Side Guides	Specially designed box type galvanised steel side guides 3.0 mm thick surface mounted type should guide the slat curtain smoothly.
6.	Bracket Plate	Mild Steel bracket plate minimum 3.0 mm thick. Bracket plate dimensions vary as per size of shutter.
7.	Roller Shaft	Heavy duty Mild Steel hollow tubular pipe Diameter vary as per width of shutter.
8.	Hood Cover	GI sheet Hood cover of 0.8 mm thickness.
9.	Automation System	Indirect Drive: Electric Motor-Imported Make.230V,50Hz,1 phase Gear motor with thermal protector.
10.	Control	In built basic control card with integrated limit switch and autoclosing feature.
11.	Standard Accessories	Thermal fusible link for actuating auto close feature when temprerature reaches 70°C.
12.	Push Botton	3 way push button standard with automation system.

SHUTTER SIZES :-

SR.	CLEAR WIDTH	CLEAR HEIGHT	QTY.
01	2800	3360	01
02	2510	3120	01

This drawing & designing is the property of NIHVA TECHNOLOGIES. Not to be sold or copied to any other concern

TITLE :-
FIRE RATED ROLLING SHUTTER

NIHVA TECHNOLOGIES PVT. LTD. PUNE
Tel : 020 66304033
Email:- info@nihva.com
Website:- www.nihva.com

	NAME	DATE
DRAWN	B.S.	06/08/2025
CHECK	V.T.	06/08/2025
APPROVAL	V.T.	06/08/2025

CLIENT - TATA MOTORS

PROJECT -FIRE RATED ROLLING SHUTTER

DWG. NO. : NIHVA-23-24-CLT-102 | REV-00

SCALE: NTS | WT: | SHEET: 01 OF 01

ALL DIMENSION ARE IN mm

If any queries contact : design@nihva.com