






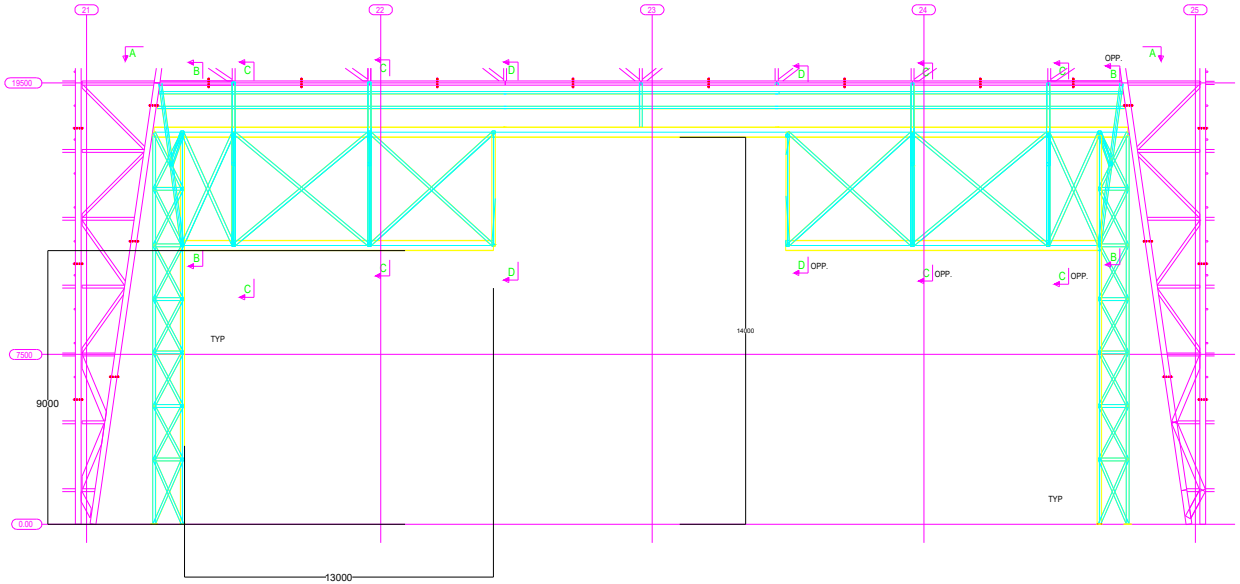



DETAIL I, SCALE (1:20)



NOTES :–

1. ALL DIMENSIONS ARE IN MM & LEVEL ARE IN METER.
2. ALL STRUCTURAL STEEL AS PER IS:2062.
3. PROVIDE WELDING AS PER IS:816.
4. PROVIDE MIN. 6MM SHOP WELD AND 8MM SITE WELD
5. USE ELECTRODS AS PER IS:814 (PT.–I).
6. FILLET/ BUTT WELD SHALL BE OF 6MM SIZE AND SHALL BE CONTINUOUS.
7. FABRICATION AND ERECTION SHALL BE AS PER IS:800 AND IS:803.
8. WELD SHALL BE GROUND SMOOTH.
9. ALL GUSSET PLATES SHALL BE MIN. 8 THK.
10. ALL M.S. BLACK BOLTS AND NUTS SHALL CONFORM TO IS:1363(PT. 1 TO 3
11. LIVE LOAD ON ROOF = 75KG/SQM.
12. STRUCTURE SHALL BE APPLIED WITH ONE COAT OF RED OXIDE ZINC CROMATE PRIMER AFTER FABRICATION FOLLOWED ONE MORE COAT BEFORE ERECTION. FINALLY APPLY 2 COATS OF SYNTHETIC ENAMAL OF APPROVED QUALITY.
13. STRUCTURAL MEMBER SHALL BE OF 355N/MM^2 MIN STRENGTH.

This drawing & designing is the property of NIHVA TECHNOLOGIES. Not be sold or copy to any other concern.

TITLE	MEGA DOOR		NIHVA TECHNOLOGY PVT. LTD. PUNE
	SIGN	DATE	NIHVA TECHNOLOGIES PVT. LTD. Email:- Sales@nihva.com Website :- www.nihva.com
DRAWN	J.P	06/11/25	CLIENT - xyz
CHECK	B.S	07/11/25	PROJECT -MEGA DOOR
REV.	00		SITE - XYZ
APPROVAL	V.T	07/11/25	DWG. NO. : NIHVA/15-16/178
If any queries contact : projects@nihva.com			SCALE: 01 | WT: | SHEET: 01 OF 01
ALL DIMENSION ARE IN mm			