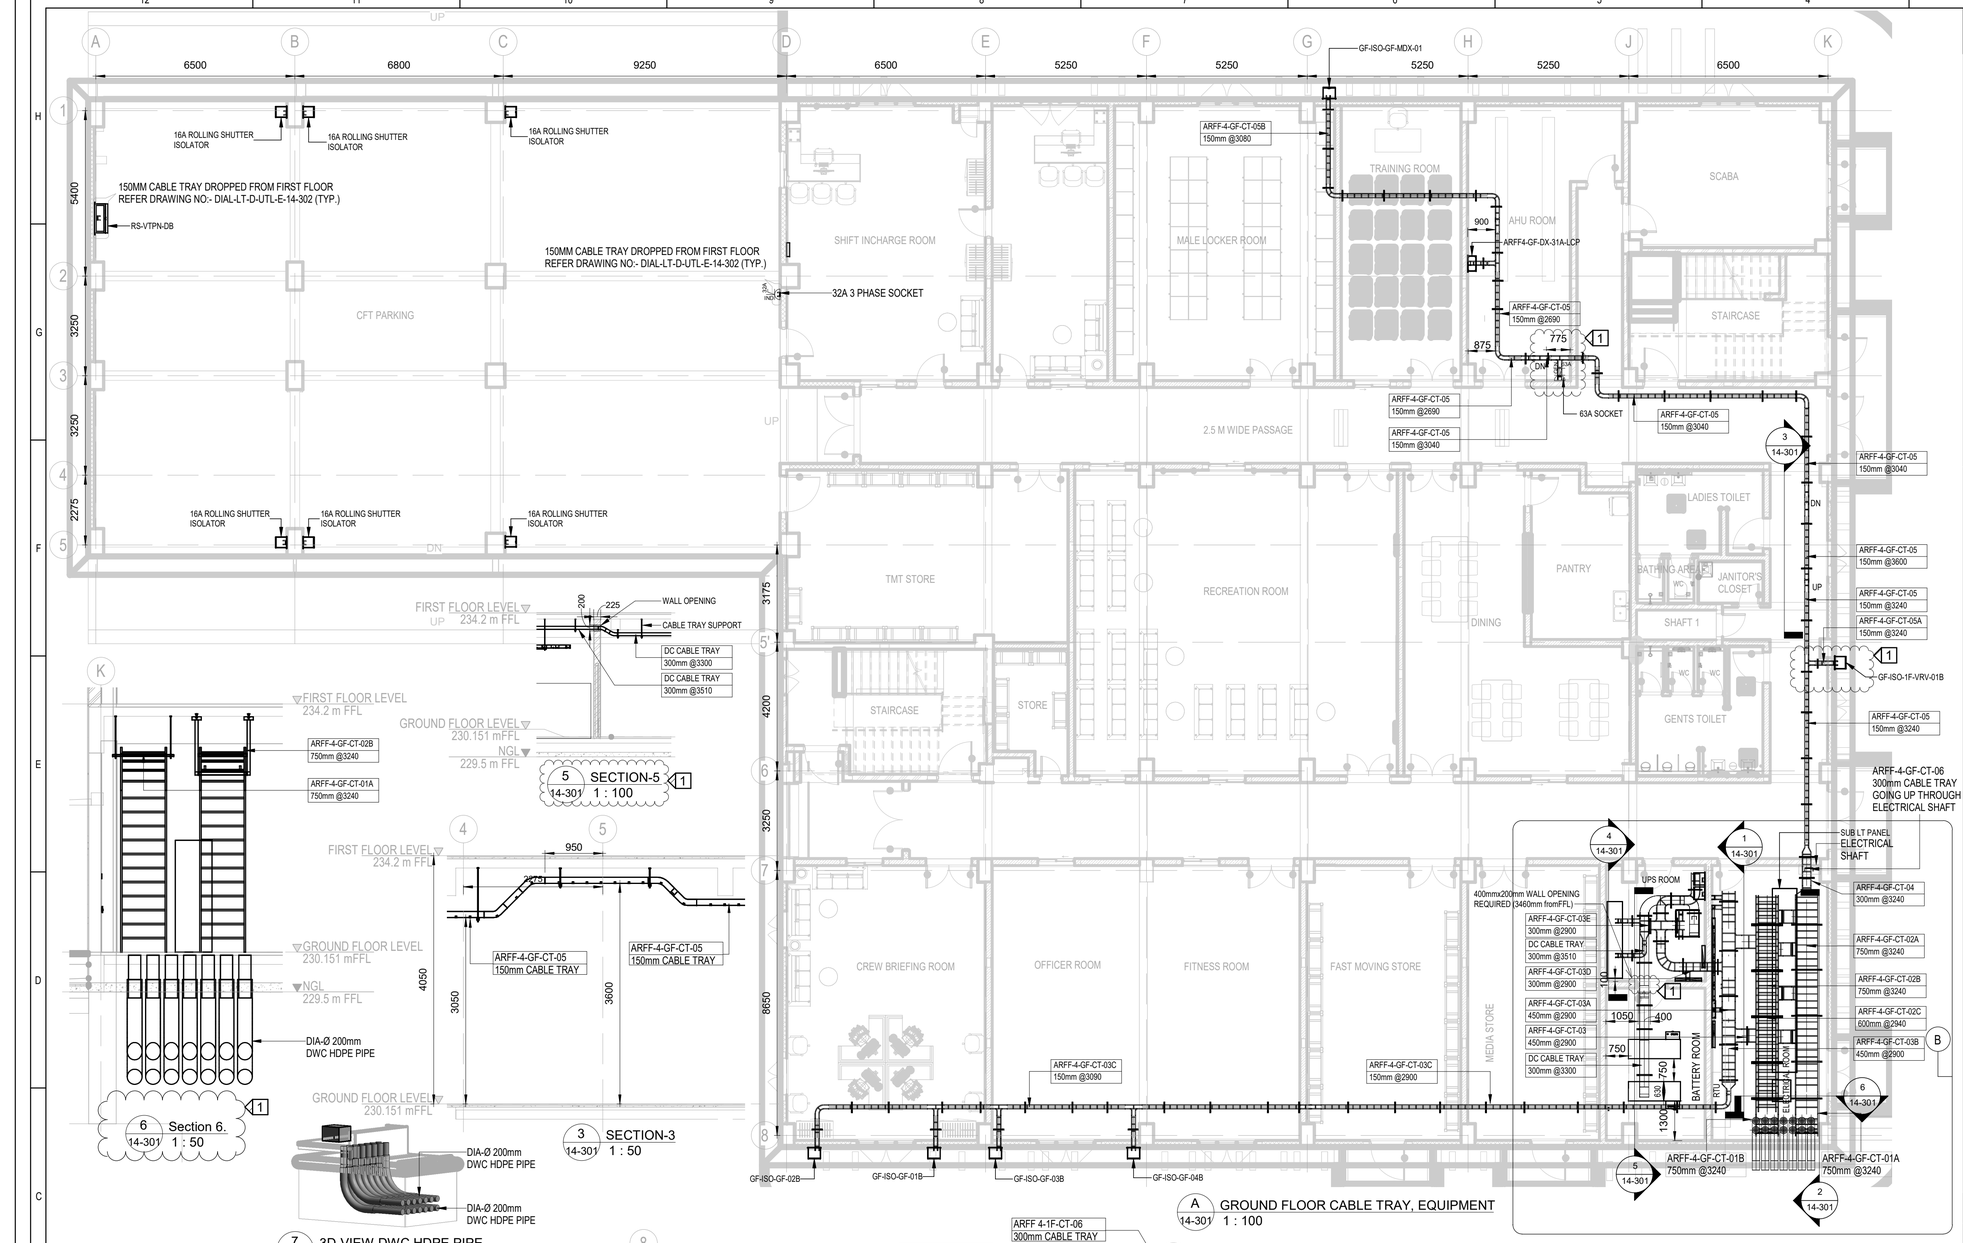
This drawing is the property of L&T Construction, B&F-EDRC and must not be passed on to any person or body not authorised by us to receive it nor be copied or otherwise made use either in full or in part by such person or body without our prior permission in writing.




A 14-301 GROUND FLOOR CABLE TRAY, EQUIPMENT 1 : 100




6 14-301 Section 6. 1 : 50



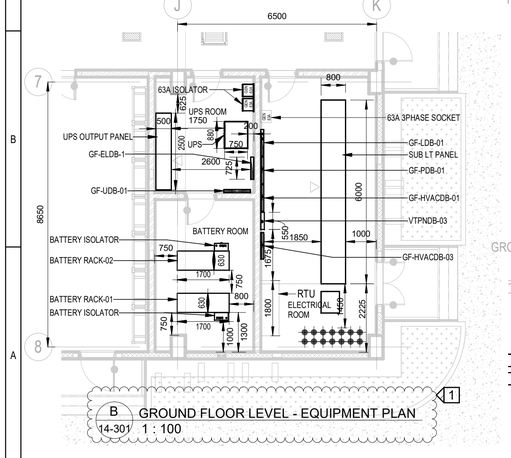

5 14-301 SECTION-5 1 : 100



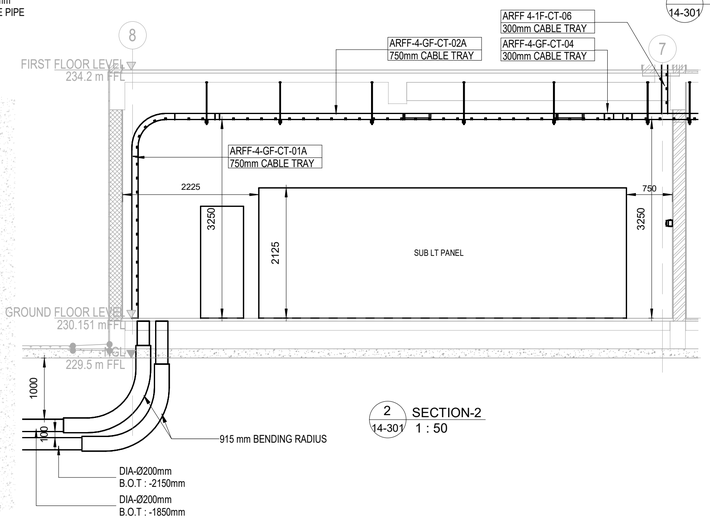

3 14-301 SECTION-3 1 : 50



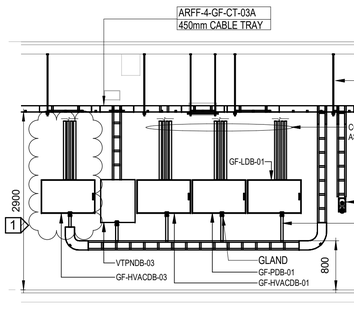

7 14-301 3D-VIEW DWC HDPE PIPE



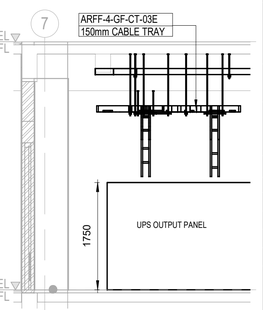

B 14-301 GROUND FLOOR LEVEL - EQUIPMENT PLAN 1 : 100




2 14-301 SECTION-2 1 : 50




1 14-301 SECTION-1 1 : 50



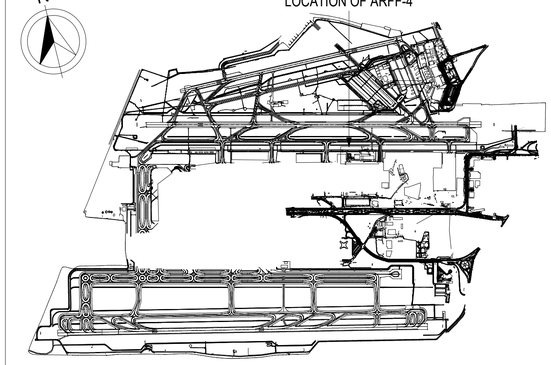

4 14-301 SECTION-4 1 : 50

REFERENCE DRAWINGS/DOCUMENTS (LATEST REVISIONS)

1. ARCHITECTURAL LAYOUT, DIAL-LT-D-UTL-A-10-300
2. STRUCTURE LAYOUT, DIAL-LT-D-UTL-S-40-101, DIAL-LT-D-UTL-S-10-102
3. PHE LAYOUT, DIAL-LT-D-UTL-D-12-301, DIAL-LT-D-UTL-P-13-301.
4. FPS LAYOUT, DIAL-LT-D-UTL-F-12-301, DIAL-LT-D-UTL-F-13-301.
5. ELV LAYOUT, DIAL-LT-D-UTL-K-12-301.
6. HVAC LAYOUT, DIAL-LT-D-UTL-M-12-301.

L&T Construction
GOOD FOR CONSTRUCTION
25 AUG 2021
CONTROL COPY NO.
Name/Designation: Sanjiv Sabharwal, Design Head- ASEP
Signature
To

LOCATION OF ARFF-4



KEY PLAN (NOT TO SCALE)

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE MENTIONED.
2. THE DIMENSION OF PANELS & OTHER ELECTRICAL EQUIPMENT SHOWN HERE ARE INDICATIVE ONLY. EXACT DIMENSIONS SHALL BE AS PER APPROVED G.A DRAWINGS.
3. THE CABLE TRAYS SUPPORTS SHALL BE PROVIDED AT INTERVAL OF 1500 mm.
4. ALL EDGES, FITTINGS OR ANY PARTS SHALL BE FINISHED FREE FROM BAR, SHARP EDGES, (OR) PROJECTIONS CHANGING TO THE INSTALLATION (OR) JACKET OF THE CABLES.
5. WHEREVER POWER & LV CABLES ARE RUNNING IN PARALLEL ,SHALL BE SEPERATED BY A DISTANCE OF MINIMUM 300 mm.HT& LV CABLE BY 700 mm,HT &LT POWER CABLE BY 300mm.
6. THE CABLE TRAY ON HORIZONTAL RUNS SHALL BE INSTALLED WITH A 20 mm GAP AT THE EXPANSION JOINT AND SUPPORTS SHALL BE INSTALLED WITH IN 150 mm ON EITHER SIDE OF THE JOINT.
7. DB DIMENSIONS SHOWN IS INDICATIVE ONLY. EXACT DIMENSIONS SHALL BE AS PER APPROVED G.A DRAWINGS.
8. ALL 3 PHASE ELECTRICAL EQUIPMENT SHALL BE EARTHED AT TWO POINTS BY TWO SEPARATE EARTH LEADS.
9. 2 RUNS OF GI EARTH STRIPS SHALL RUN ON FLOOR FOR EQUIPMENT EARTHING .FOR EARTH STRIP SIZES , REFER TO EARTHING SCHEMATIC / EARTHING LAYOUT.
10. CABLE TRAYS IN ELECTRICAL ROOMS, HVAC ROOMS SHALL BE ADJUSTED ACCORDING TO THE PANEL LOCATION UNDER SUPERVISION OF THE SITE ENGINEERS AS PER SITE CONDITIONS.
11. ALL HORIZONTAL & VERTICAL DISTRIBUTION CABLE TRAYS SHALL BE LADDER TYPE.IF NOT SPECIFIED OTHERVISE.
12. CABLE TRAY MOUNTING HEIGHT MAY SUBJECT TO VARY BASED ON SITE LOCATION. 13.CABLE TRAY DROP TO PANELS SHALL BE MODIFIED AS PER POSITION OF CABLE ALLIES AT SITE IN SUPERVISION WITH SITE ENGINEER.
14. IN CASE OF MULTIPLE LAYER OF CABLE TRAY ,25x3mm GI. EARTH STRIP (2NOS.) SHALL BE LAID ALONG THE CABLE TRAYS ON TOP MOST TRAY), AND OTHER TRAYS SHALL BE INTERCONNECTED WITH A 25x3mm GI.EARTH STRIP AT EVERY 30mt. DISTANCE.
15. TYPICAL FIXING DETAIL OF CABLE TRAY & EARTH STRIPS SHALL BE DETAILED IN SHOP DRAWINGS.
16. EARTHING CONDUCTORS SHALL BE BURIED IN GROUND SHALL BE LAID IN MINIMUM 600mm BELOW GROUND LEVEL.

LEGEND:-

| SI.NO. | SYMBOL | DESCRIPTION | MOUNTING HEIGHT |
|---|---|---|---|
| 1 | | LIGHTING DISTRIBUTION BOARD (LDB) | TOP OF THE DB 1800mm FROM FFL |
| 2 | | POWER DISTRIBUTION BOARD (PDB) | TOP OF THE DB 1800mm FROM FFL |
| 3 | | EMERGENCY LIGHTING DISTRIBUTION BOARD (ELDB) | TOP OF THE DB 1800mm FROM FFL |
| 4 | | UPS DISTRIBUTION BOARD (UDB) | TOP OF THE DB 1800mm FROM FFL |
| 5 | | HVAC DISTRIBUTION BOARD (HVAC DB) | TOP OF THE DB 1800mm FROM FFL |
| 6 | | UPS OUTPUT PANEL | TOP OF THE DB 1800mm FROM FFL |
| 7 | | 16/32/63 A ISOLATOR (WEATHER PROOF) | - |
| 8 | | 63A SOCKET FOR GENERAL PURPOSE | - |
| 9 | | CABLE TRAY | - |
| 10 | | PERFORATED TYPE CABLE TRAY | - |
| 11 | | DWC HDPE PIPE | |

ABBREVATIONS
RS- ROLING SHUTTER

| REV.NO. | DESCRIPTION | DESIGNED | DRAWN | CHECKED | APPROVED |
|---|---|---|---|---|---|
| 1 | REVISED AS GOOD FOR CONSTRUCTION REVISED AS MARKED(REFER RFI NO.L&T/DIAL/GFC/RFI/0490) | VMT 20.08.2021 | GK 21.08.2021 | SRJ 23.08.2021 | SS 24.08.2021 |
| 0 | ISSUED AS GOOD FOR CONSTRUCTION | VMT 22.08.2020 | PK 24.08.2020 | SRJ 25.08.2020 | SS 26.08.2020 |

REVISIONS

| CHECKED BY | SIGN | DATE | CHECKED BY | SIGN | DATE | CHECKED BY | SIGN | DATE |
|---|---|---|---|---|---|---|---|---|
| ARCHITECTURE | | | HVAC | | | GIS | | |
| CIVIL & STRUCTURAL | | | FPS | | | GEOTECH | | |
| ELECTRICAL | | | PIPING | | | AIRPORT SYSTEMS | | |
| ELV SYSTEM | | | PHE | | | VHT | | |

DELHI INDIRA GANDHI INTERNATIONAL AIRPORT GMR

L&T Construction

**CLIENT :** DELHI INTERNATIONAL AIRPORT LIMITED

**PROJECT:** INDIRA GANDHI INTERNATIONAL AIRPORT PHASE-3A DEVELOPMENT WORKS

**CONCEPT :** AECOM India Private Limited

**PROJECT CONSULTANT:** Engineering Design and Research Center (EDRC), L&T Construction

**JOB No :** O19040

| | NAME | SIGN | DATE |
|---|---|---|---|
| DSGN | VMT | VMT | 22.08.2020 |
| DRWN | PK | PK | 24.08.2020 |
| CHKD | SRJ | SRJ | 25.08.2020 |
| APPD | SS | SS | 26.08.2020 |

**TITLE:** GROUND FLOOR CABLE TRAY, EQUIPMENT & EARTHING LAYOUT - ARFF 4

SECTION/ ELEVATION MARKING / DRAWING NUMBER

SCALE 1:100,50

**DRAWING No.** DIAL- LT- D- UTL- E- 14-301

PROJECTION: FIRST ANGLE

SIZE A1

REV 1

RELEASED FOR: ☐ PRELIMINARY ☐ TENDER ☐ INFORMATION ☐ APPROVAL ☑ CONSTRUCTION