

PRODUCED BY AN AUTODESK EDUCATIONAL PRODUCT

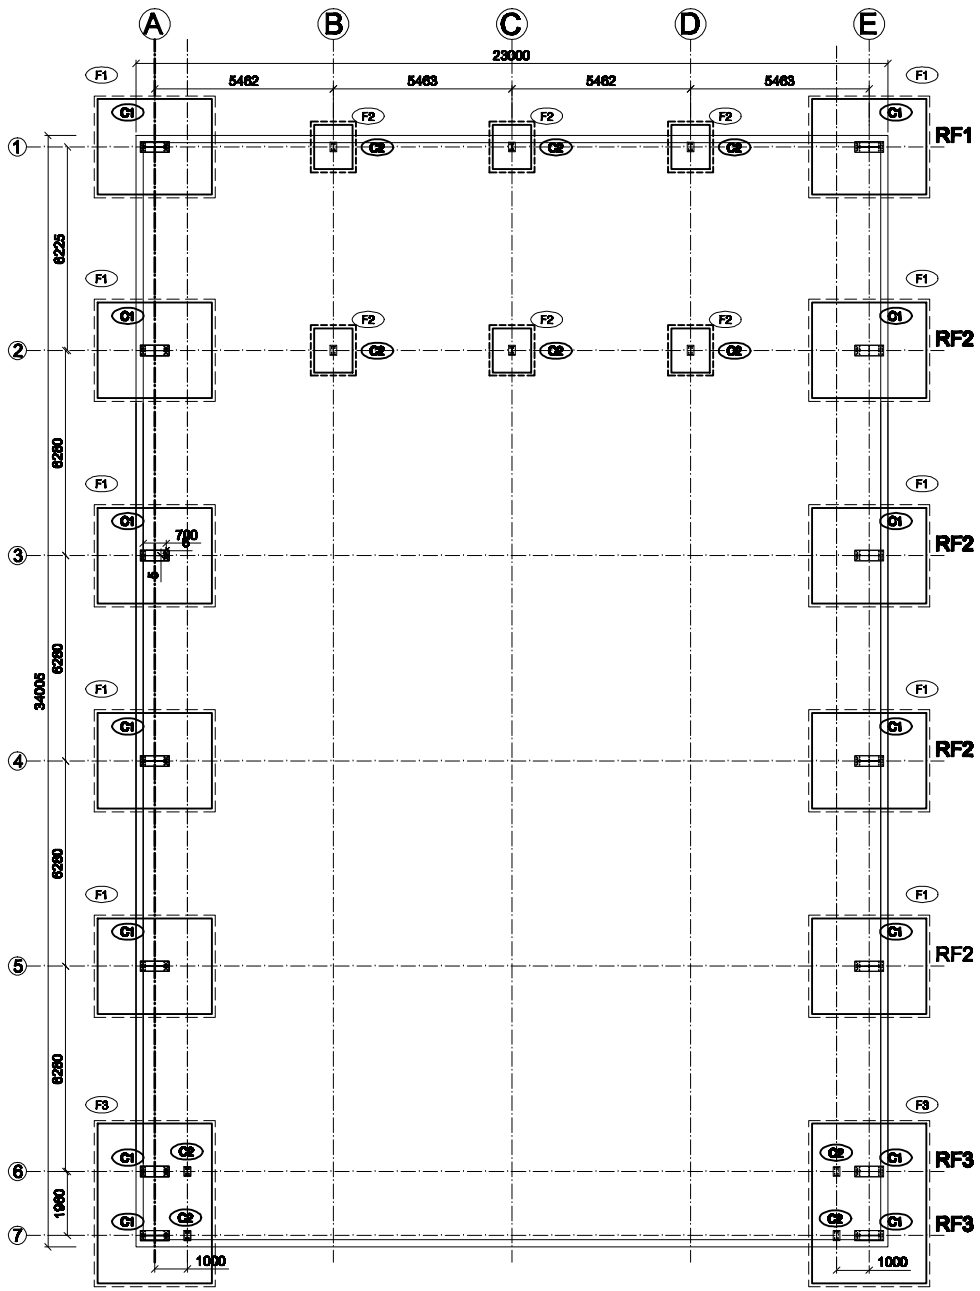

GROUND FLOOR PLAN

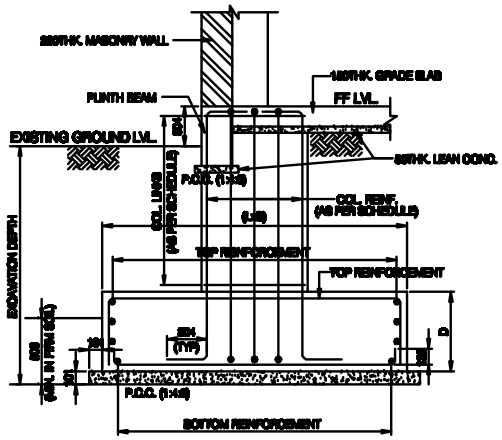


TYPICAL DETAILS OF COLUMN & FOOTING


(SCALE 1:25)

SCHEDULE OF R.C. FOOTINGS (M25:Fe500)

FOOTING GROUP	SIZE	DEPTH	BOTTOM REINFORCEMENT		TOP REINFORCEMENT		EXCAVATION DEPTH
			SHORT SPAN STEEL	LONG SPAN STEEL	SHORT SPAN STEEL	LONG SPAN STEEL	
F1	2000x2000	600	16T @ 150 c/c	16T @ 150 c/c	8T @ 200 c/c	8T @ 200 c/c	2100
F2	1525x1175	600	16T @ 175 c/c	16T @ 175 c/c	----	----	600
F3	2000x4000	750	16T @ 150 c/c	16T @ 150 c/c	16T @ 300 c/c	16T @ 300 c/c	2100



T8 @ 200
(4NOS.-LINKS/SET)




COL. C1

(SCALE 1:25)



T8 @ 200
(2NOS.-LINKS/SET)



COL. C2

(SCALE 1:25)

KEY PLAN :-

LEGEND :-
- REINFORCED CONCRETE
- 230MM THK BRICK WALL
- STRUCTURAL GLAZING

N

GENERAL NOTES :

ALL DIMENSIONS ARE IN MILLIMETERS AND ARE WITHOUND ENGINEERING UNLESS OTHERWISE SPECIFIED.

ALL LEVELS ARE IN METERS AND ARE WITHOUND LEVELS UNLESS OTHERWISE SPECIFIED.

DO NOT SCALE DRAWING, ONLY WRITTEN DIMENSIONS SHALL BE FOLLOWED, ANY DISCREPANCIES NOTED SHALL BE BROUGHT TO THE NOTICE OF THE ARCHITECT PRIOR TO EXECUTION.

SCHEDULE OF JOINERY

TYPE	DESCRIPTION	SIZE	NO.
HD	HANGER DOOR	24000 x 6000	01
W	WINDOW	1500 x 1200	20
D	DOOR	1200 x 2200	8

GENERAL NOTES :

1. ALL DIMENSIONS ARE IN MM UNLESS NOTED OTHERWISE.
2. READ THIS DRG ALONG WITH RELEVANT ARCH. DRG.
3. CONCRETE GRADE M25 FOR ALL EXCEPT NOTED OTHERWISE.
4. DO NOT SCALE THE DRG, FOLLOW WRITTEN DIMENSIONS. ANY MISMATCH IN ARCH OR SERVICES DRGS TO BE CLARIFIED FROM ENGINEER.
5. 'Y' DESIGNATES STEEL REINFORCEMENT DIA, AND SHALL CONFORM TO IS-1786 WITH MINIMUM YIELD STRENGTH OF 500 N/SQ.MM.
6. DO NOT PROVIDE MORE THAN 50% LAPPING AT ANY SECTION, AND AVOID LAPS AT LOCATIONS OF MAXIMUM BENDING MOMENTS. LAP LENGTH/DEVELOPMENT LENGTH SHALL BE AS FOLLOWS: 40xBAR DIA FOR M20 CONCRETE; 40xBAR DIA FOR M25 CONCRETE
7. NOMINAL COVER SHALL BE AS FOLLOWS: BEAMS--30MM, SLABS--25MM, COLUMNS--40MM, FOUNDATION--50MM.
8. WATER CEMENT RATIO FOR CONCRETE MIX SHALL NOT BE MORE THAN 0.45. IF REQUIRED USE PLASTICISER TO CONTROL SAME.
9. DISTRIBUTION STEEL WHEREVER NOT SHOWN SHALL BE 8Y--200 C/C
10. FOR DETAILS TO THIS DRG REFER OTHER STR DRGS.
11. THE FDN IS DESIGNED CONSIDERING 30T/SQM NET BEARING CAPACITY AT FOUNDING LEVEL
12. ALL LAYOUT DIMS TO MATCH ARCHT DRGS AND ALL MEMBER SIZES AND REINFT TO MATCH STRUCTURAL DRGS.

REV.	DESCRIPTION	DATE	BY	CHD.
R0	ISSUED FOR APPROVAL	20-07-17	CMF	SSY

AMENDMENT

GRAPHIC SCALE: 0 0.5M 2M 4M / 0.5M 0 1M 3M 5M

ANDHRA

CLIENT:
HANGER
AT PUNE

PROJECT LOCATION:
PUNE

DRAWING TITLE:
COLUMN FOOTING DRAWINGS

SCALE : NTS | DRAWN : CMF | DATE : 06-09-2016 | CHKD : SNK | R0

PROJECT ID: 1718-AI-052-PEB | DRAWING NO: PD: 01

Astre Infra
Private Limited
imagine and its done
691, Bensalal Indl. Estate,
Khanapur Rd,
Udyambag, Belgaum- 590008.
www.astreinfra.com

THESE DRAWINGS & SPECIFICATIONS ARE AND SHALL REMAIN THE PROPERTY OF ASTRE INFRA PVT. LTD. AND ARE NOT TO BE USED IN ANY WAY WHATSOEVER WITHOUT THE WRITTEN PERMISSION OF ASTRE INFRA PVT. LTD. ALL RIGHTS RESERVED UNDER COPYRIGHT ACT.

PRODUCED BY AN AUTODESK EDUCATIONAL PRODUCT