
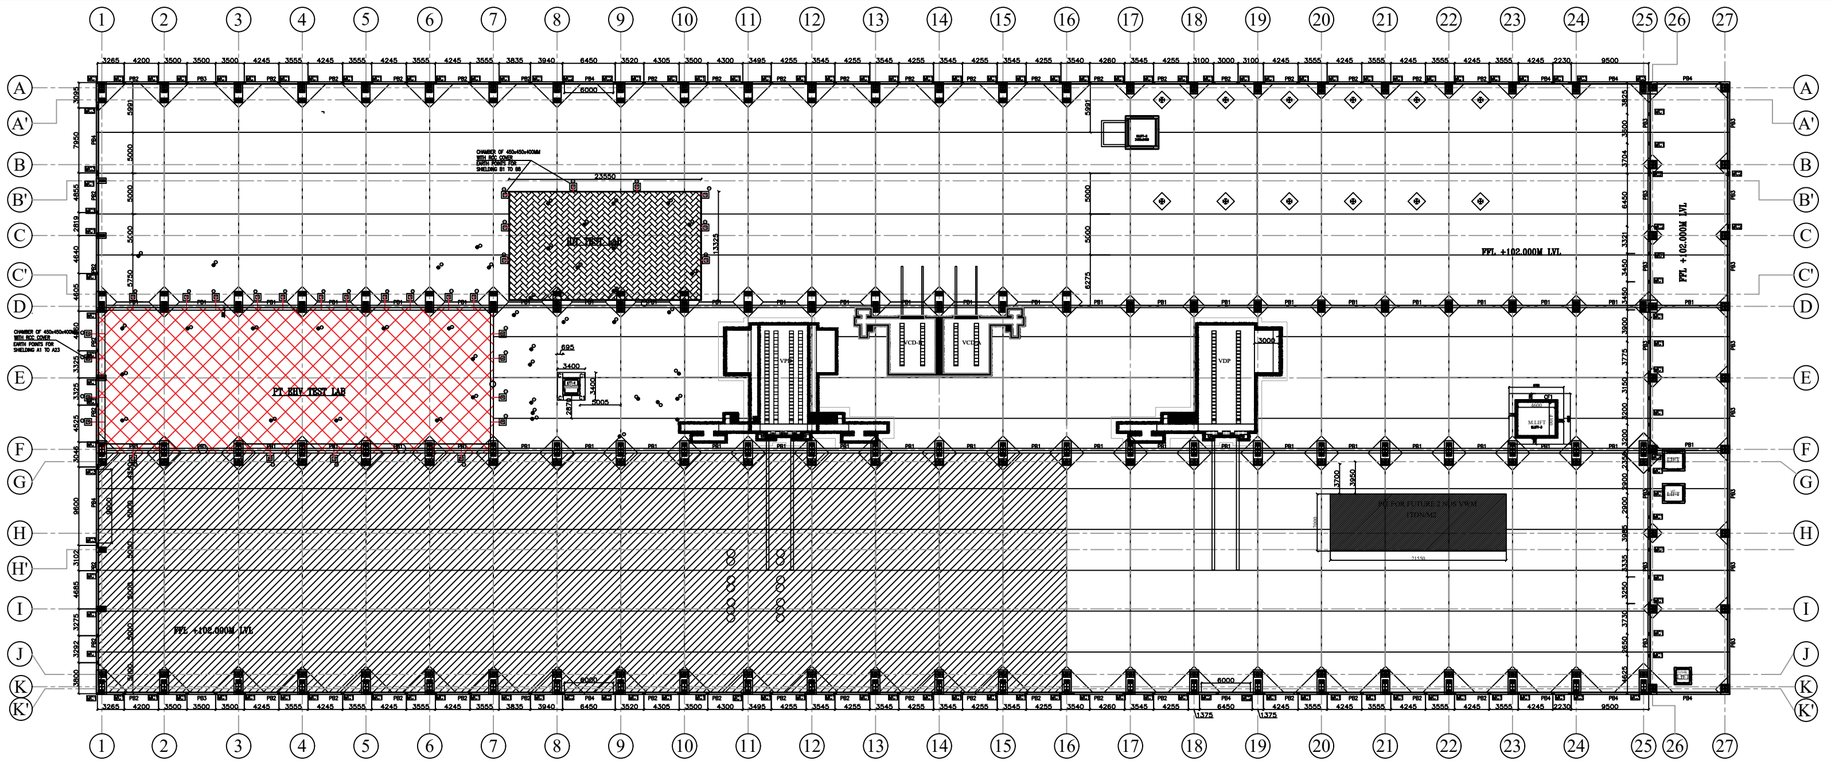


600MM THK FLOORING


200MM THK FLOORING

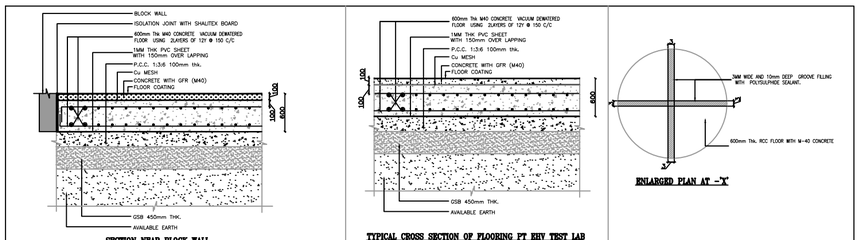


SECTION NEAR BLOCK WALL

TYPICAL CROSS SECTION OF FLOORING PT EHV TEST LAB


ENLARGED PLAN AT -'X'




DETAIL OF CONSTRUCTION JOINT (WITH TIE BARS)




TYP. CONSTRUCTION JOINT AROUND COLUMN




DOWEL BAR DETAIL FOR EXPANSION JOINT (DETAIL -A)

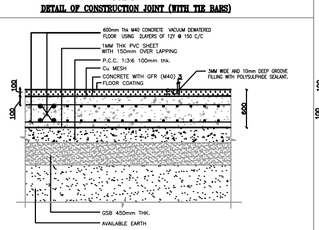


DETAIL OF GROOVE CUTTING AT CONTRACTION JOINT (WITH TIE BARS)



DETAIL OF GROOVE CUTTING AT CONTRACTION JOINT (WITH TIE BARS)




TYP. CONSTRUCTION JOINT AROUND COLUMN




TYP. DETAIL FOR ISOLATION JOINT


TYP. DETAIL FOR EXPANSION JOINT




SECTION NEAR BLOCK WALL




TYPICAL CROSS SECTION OF FLOORING IDT EHV TEST LAB




ENLARGED PLAN AT -'X'

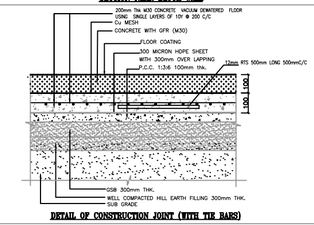


DETAIL OF CONSTRUCTION JOINT (WITH TIE BARS)




TYP. CONSTRUCTION JOINT AROUND COLUMN




DETAIL OF GROOVE CUTTING AT CONTRACTION JOINT (WITH TIE BARS)




TYP. CONSTRUCTION JOINT AROUND COLUMN

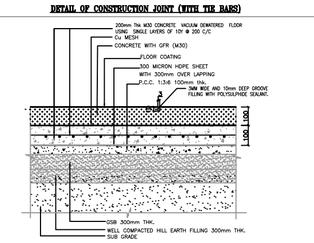

DETAIL OF GROOVE CUTTING AT CONTRACTION JOINT (WITH TIE BARS)




DOWEL BAR DETAIL FOR EXPANSION JOINT (DETAIL -A)



TYP. DETAIL FOR ISOLATION JOINT

TYP. DETAIL FOR EXPANSION JOINT

KEY PLAN



NOTES:

1. ALL DIMENSIONS ARE IN MM UNLESS NOTED OTHERWISE.
2. ONLY WRITTEN DIMENSIONS TO BE FOLLOWED AND DRAWING NOT TO BE SCALED.
3. EL. (±)0.00M SHALL CORRESPONDS TO FINISHED GROUND LEVEL (FGL)(±)101.50M ,
4. THIS DRAWING SHOULD BE READ IN CONJUNCTION WITH RELEVANT ARCHITECTURAL DRAWING ANY DISCREPANCY SHOULD BE IMMEDIATELY BROUGHT TO NOTICE.
5. UNLESS NOTED OTHERWISE LAP/DEVELOPMENT LENGTH OF BARS SHALL BE 50 TIMES THE DIA OF BARS.
6. DETAILING OF REINFORCEMENT SHALL BE AS PER IS13920(LATEST)
7. GRADE OF CONCRETE SHALL BE M-30.
8. HIGH STRENGTH DEFORMED STEEL BARS, PRODUCED BY THERMO MECHANICAL TREATMENT PROCESS, OF GRADES FE 550, HAVING ELONGATION MORE THAN 14.5% AND CONFORMING TO OTHER REQUIREMENTS OF IS 1786:1985 SHALL BE USED FOR THE REINFORCEMENT.
9. SBC CONSIDERED AS 35T/M2 AT FOUNDING LEVEL -3.50M FROM NGL
10. CLEAR COVER FOR THE MAIN REINFORCEMENT SHALL BE AS FOLLOWS:-

A) COLUMN - 40MM
B) RCC WALL -40MM
C) FOOTING -75MM
D) BEAM-25MM TOP & 40MM BOTTOM
E) SLAB-25MM

* IMPORTANT NOTES

1. Care should be taken to ensure that the copper (Cu) mesh is not interrupted or cut due to floor joints in both test lab areas.
2. Also note that the reinforcement in the floor should not be floating, earthing point of view. The reinforcement must be properly binded/connected throughout and then connected to independent earth pits at two test lab locations.
3. Reinforcement placed in the testing area shall not be binded or connected to the other grade slabs reinforcement surrounding it
4. The locations of earthing points shall be in accordance with the electrical drawings.

ABBREVIATIONS:

FGL - FINISHED GROUND LEVEL
GFL - GROUND FLOOR LEVEL
FFL - FINISHED FLOOR LEVEL
FRL - FINISHED ROAD LEVEL
NGL - NATURAL GROUND LEVEL
UNO - UNLESS NOTED OTHERWISE

REFERENCE DRAWINGS:

Rev	Description	Date	Drawn	Check
00	ISSUED FOR APPROVAL	04.04.2026	DK	AK

DRAWING REVISION STATUS

PROJECT NAME :- NEOTRAFO MANUFACTURING PLANT HYDERABAD, INDIA.

CUSTOMER:

NEOTRAFO SOLUTIONS INDIA PRIVATE LIMITED
HYDERABAD, INDIA - 500078

CONSULTANT:

SPARKDEL INFRA PRIVATE LIMITED.
CHENNAI, TAMILNADU.

DRAWING TITLE :-

FACTORY BUILDING- FLOORING LAYOUT & TYPICAL DETAILS AT TESTING LAB AREA

DRAWN :- DK	CHECKED :-AK	APPROVED :- AK
SIGN :-	SIGN :-	SIGN :-

SCALE :- 1:250

DWG NO. SPRK-2025 033-NT- ST-204B	Rev. 00
SHEET NO. 01 CON'T. ON : END	Size. A0

D:\ARKHISTRUCT\OneDrive - arkhistruct\2025 projects\2025 033 NEOTRAFO\FINAL DWG\201 STRUCTURAL\01 Factory Building\01 Civil\R5-2025 033 SPARK -NEOTRAFO FOUNDATION 04.04.2026.dwg