

PROPOSED PLAN

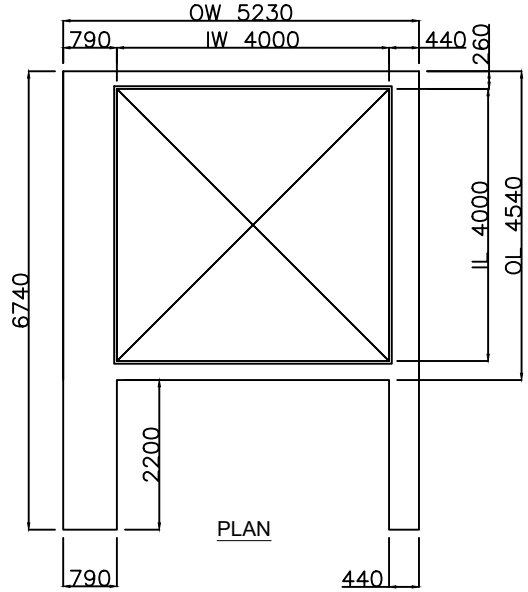


PLAN

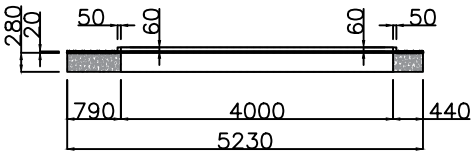


SECTION VIEW


RETRACTABLE ROOF

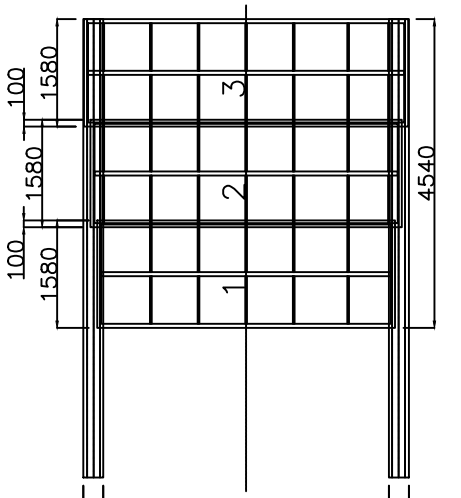


PLAN

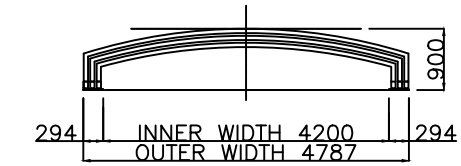


SECTION VIEW

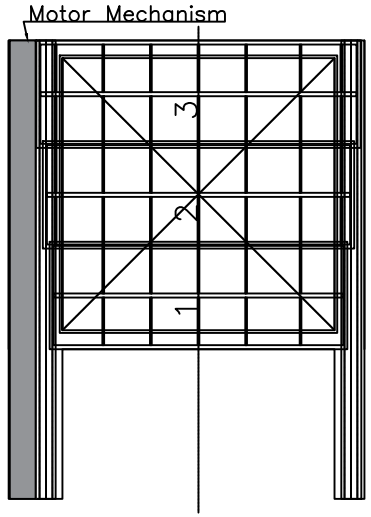

ENCLOSED PLAN

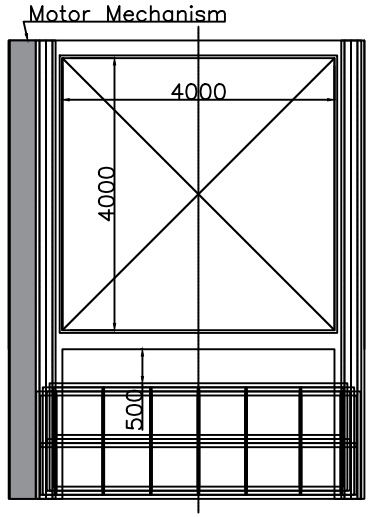

STACKED PLAN

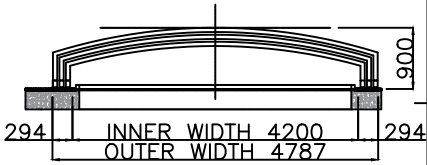

1. THE STRUCTURE AROUND THE CUT OUT SHOULD BE OF CONCRETE FOR FOR PROPER FASTENING OF ROOF.
2. INNER PROJECTION OF 50X60MM REQUIRED AS A SINGLE STRUCTURE WITHOUT ANY JOINT TO AVOID WATER SEEPAGE INSIDE.
3. TOP SURFACE SHOULD BE OF GRANITE 20MM FOR SMOOTH FUNCTIONING OF ROOF.
4. ROOF EXTENSION IS SHOWN FOR ONLY REFERENCE. IT CAN BE MODIFIED AS PER THE WORK UNDERTAKEN.
5. GRADIENT OF 50MM NEED TO BE PROVIDED ALONG THE OUTER LENGTH TO AVOID WATER STAGNANCY IN GUIDE RAIL.

This drawing & design is the property of NIHVA TECHNOLOGIES. Not to be sold or copied to any other concern.

TITLE
GA DRAWING-RR

	NAME	SIGN	DATE
DRAWN	G.J.		13.02.21
CHECK	A.K.		15.02.21
APPRD.	V.T.		17.02.21

If any queries contact : projectsautomation@nihva.com

ALL DIMENSION ARE IN mm

NIHVA
NIHVA TECHNOLOGIES PVT. LTD.

NIHVA TECHNOLOGIES PVT. LTD. PUNE
Tel : 020 66304033
Email:- info@nihva.com
Website:- www.nihva.com

CLIENT - MR. PHARANDE
LOCATION - NANDED, MH
PRODUCT - RETRACTABLE ROOF
NIHVA\20-21\0163 | REV- 0
SCALE: NTS | SHEET: 01 OF 01