


DETAIL VIEW "A-A"

NOTE :-
WALL OPENING TO BE MAINTAINED AT SITE.

ABBREVIATION
WALL OPENING WIDTH : WOW
WALL OPENING HEIGHT : WOH
FRAME OPENING WIDTH : FOW
FRAME OPENING HEIGHT : FOH
SHUTTER OPENING WIDTH : SOW
SHUTTER OPENING HEIGHT : SOH

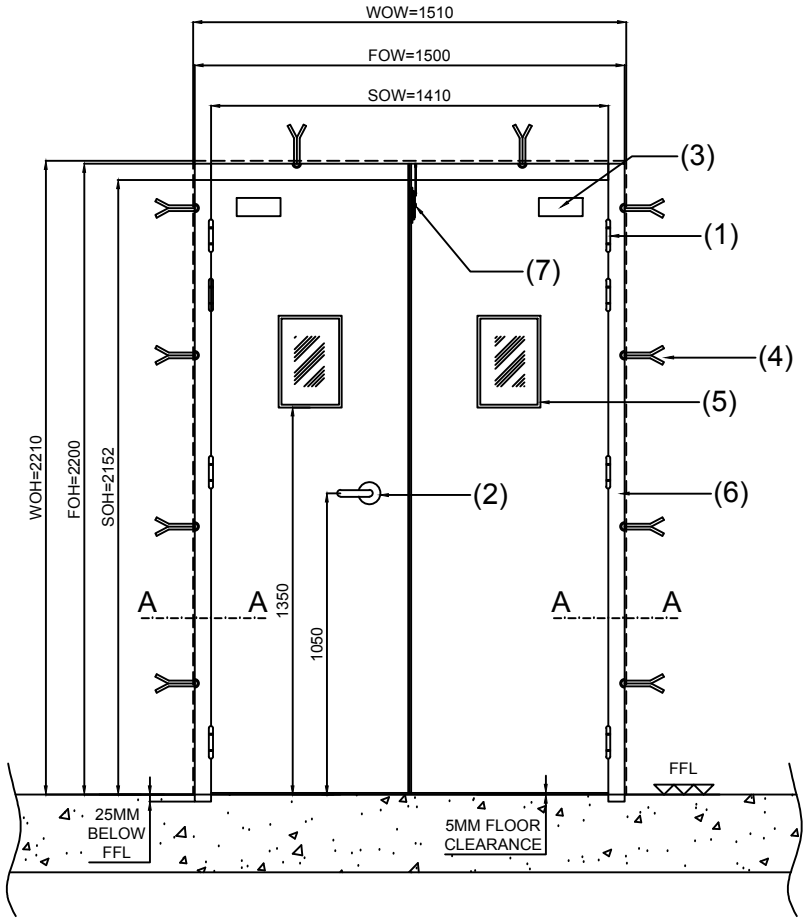

DOOR SIZE WITH FRAME 1500W X 2200H

MATERIAL OF CONSTRICTION
2HRS FIRE RATED AS PER AS 3614

FRAME : G.I 1.60 MM SHEET
SHUTTER : G.I 1.20 MM SHEET
THICKNESS : 40 MM
FRAME PROFILE : 100 X 57MM (SINGLE RIBET)

INFILL MATERIAL : MINERAL WOOL
DENSITY : 96kg/cm3

PAINT : AS PER APPROVED RAL
SHADE POWDER COATED (DFT 80 Microns min)

SCHEDULE OF HARDWARE

1. S.S.Ball Bearing Hinges - Yale / Geze Make - 8nos (Fire Rated)
2. Mortise Lock with Cylinder - Yale Make - 1 no
3. Heavy Duty Door Closer - Yale / Geze Make - 1 no
4. Anchor Fastener - 8 x 80mm
5. Vision Panel with Fire Rated Glass - 200 x 300mm Clear Glass (6mm) - 2 nos
6. Intumesce Fire / Smoke Seal on all 3 side
7. Concealed Flash Tower Bolt.

DOOR QTY : 2 Nos

TOLERANCE- ±5mm

This drawing & design is the property of NIHVA TECHNOLOGIES. Not to be sold or copied to any other concern.

TITLE
DOUBLE LEAF FIRE DOOR

NIHVA TECHNOLOGIES PVT. LTD.

NIHVA TECHNOLOGIES PVT. LTD. PUNE
Tel : 020 66304033
Email:- info@nihva.com
Website:- www.nihva.com

	NAME	SIGN	DATE
DRAWN	P.A		05.05.2020
CHECK	G.J		05.05.2020
APPRD.			

CLIENT - FERRERO INDIA PVT LTD
PROJECT -
SITE LOCATION - BARAMATI, PUNE
If any queries contact : design@nihva.com
DWG. NO. : NIHVA/20-21/0004
REV- R00
ALL DIMENSION ARE IN mm
SCALE: NTS
WT:
SHEET: