



(AS PER DISCUSSION WE HAVE TAKEN DIM
SAME AS C18
AVALIABLE SPACE ~600 MM)

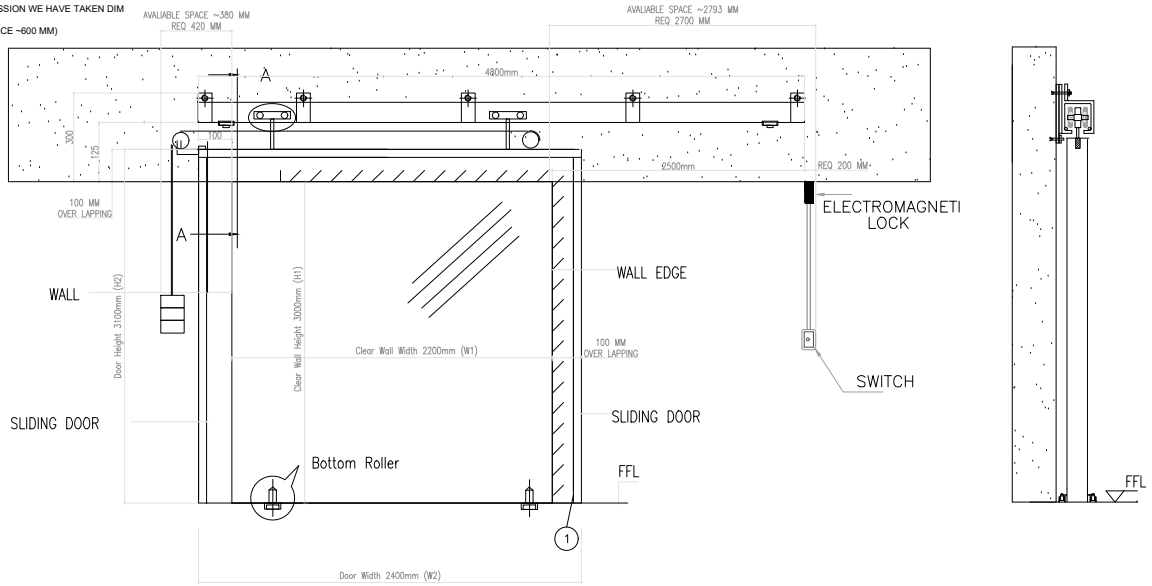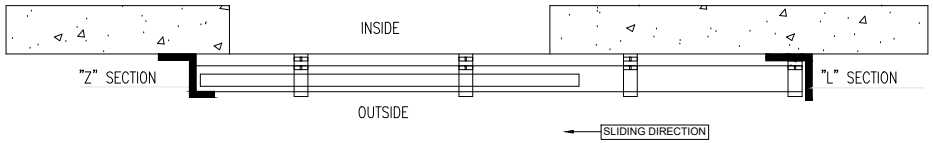





SECTION 'A–A'



DETAIL AT B'

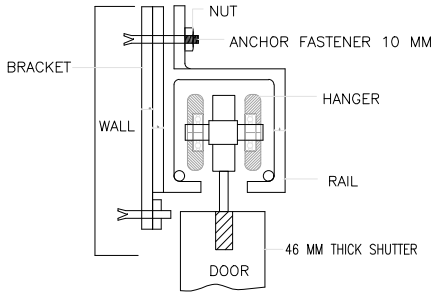

2 Hr FIRE RATED SLIDING DOOR								
				OPENING SIZE		DOOR SIZE		SLIDING DIRECTION
	LOCATION	MOUNTING	QTY	W1	H1	W2	H2	
1	PLANT 01 (SD 10)	OUTSIDE	01	2200	3000	2400	3100	RHS TO LHS

TECHNICAL SPECIFICATION :

2 Hr FIRE RATED SLIDING DOOR - AS PER BS STD. (INDIA)

SR.	SPECIFICATIONS	DETAILS
1	OPERATING MODE	MANUAL
2	CERTIFICATION TYPE	2 HRS FIRE CERTIFICATE (INDIA) + MAGNETIC LATCH AS PER ZONE 1
3	FIRE RATING HRS	2 HOUR FIRE RATED RADIENT SLIDING DOOR
4	STANDARD AS PER	BS 476 PART-20 & 22 & IS: 3614 PART II
5	INCLUDED ACCESSORIES	FUSIBLE LINK, WIRE ROPE, GUIDE RAIL, COUNTER WEIGHT WITH COVER , PULLEYS, HANGER ASSEMBLY
6	ADDITIONAL ACCESSORIES (AS PER ZONE 1)	1)ELECTROMAGNETIC LOCK 2)CONTROL PANEL-1 NOS 3)PUSH TO EXIT SWITCH
7	RAL COLOUR	RAL 3020
8	FIRE MODE CONTROL	A. BY EM B. HEAT-ACTIVATED FUSIBLE WIRE MELTS, USING A COUNTERWEIGHT SYSTEM TO PULL THE DOOR SHUT
9	RECESSES HANDLE	BOTH SIDES OF THE DOORS

NOTE :-
1. All DIMENSIONS ARE IN MM.

This drawing & designing is the property of NIHVA TECHNOLOGIES. Not be sold or copy to any other concern.

TITLE	DOOR AUTOMATION	NIHVA TECHNOLOGY PVT. LTD. PUNE Email:- Sales@nihva.com Website:- www.nihva.com	
	SIGN	DATE	
DRAWN	J.P	03/04/26	CLIENT - SIEGWERK INDIA PVT. LTD.
CHECK	B.S	03/04/26	PROJECT - 2 HRS. FIRE RATED SLIDING DOOR
APPROVAL	V.T	03/04/26	
REV	00		SITE - BHIWADI
If any queries contact : Design@nihva.com			SCALE: - WT: SHEET: 01 OF 01
ALL DIMENSION ARE IN mm			DWG. NO. : NIHVA/25-26/181