


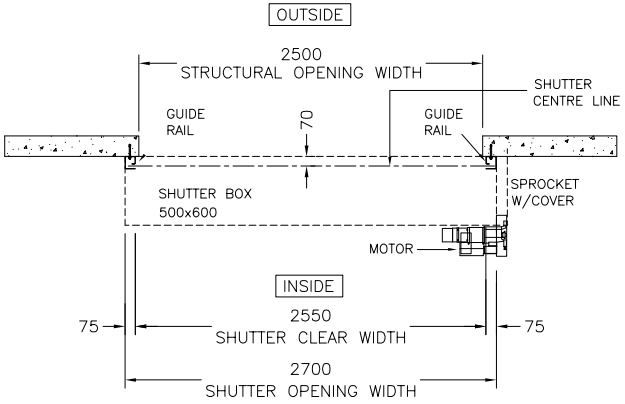


PLAN VIEW

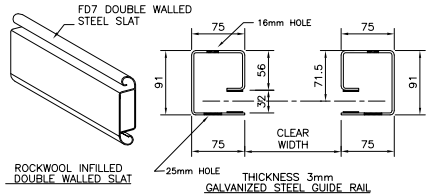


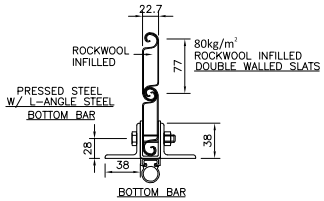




SHUTTER TYPE	STEEL INSULATED 2 HOURS FIRE RATED ROLLER SHUTTER (BS476)
SHUTTER SLATS	DOUBLE WALLED STEEL WITH ROCKWOOL INFILL
SLATS FINISHING	POWDER COATED TO STANDARD RAL COLOR
GUIDE RAIL	GALVANIZED STEEL
GUIDE RAIL FINISHING	POWDER COATED TO STANDARD RAL COLOR
BOTTOM BAR	STEEL INSULATED F7D WITH L-ANGLE BOTTOM BAR
BOTTOM BAR FINISHING	POWDER COATED TO STANDARD RAL COLOR
BOX DESIGN	MILD STEEL SECTION FRAME DESIGN
BOX & CASING COVER	0.8MM GALVANIZED STEEL
FINISHING OF COVER	POWDER COATED TO STANDARD RAL COLOR
OPERATION	MOTORISED WITH MANUAL OVERRIDE CHAIN
MOTOR POWER SOURCE	230 VOLTS, 1 PHASE, 50 Hz.
FIRE MODE	FIRE SHUTTER WILL AUTO CLOSE BY GRAVITY FORCE
	WHEN RECEIVED 24VDC FIRE SIGNAL FROM CONTROL ROOM-AUTO RESET
	TFL=THERMAL FUSIBLE LINK
	FIRE SIGNAL 24VDC 400mA BY CONTRACTOR
ADDITIONAL ITEM	.
	.
	.


SHUTTER NO.	LOCATION	CLEAR WIDTH	CLEAR HEIGHT	MOTOR POSITION	QTY
F7D-01	.	2550 mm	3100 mm	RIGHT	1

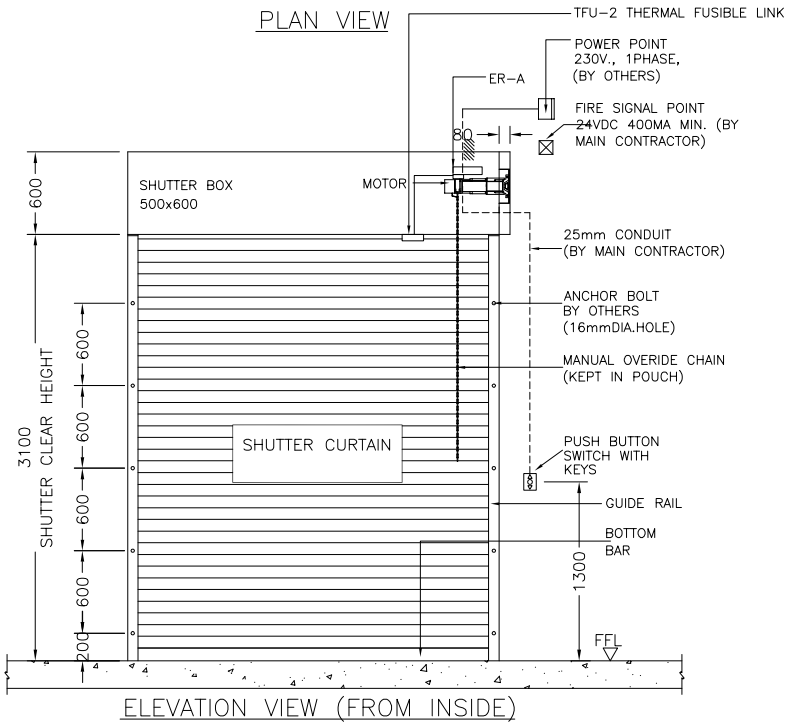


ELEVATION VIEW (FROM INSIDE)

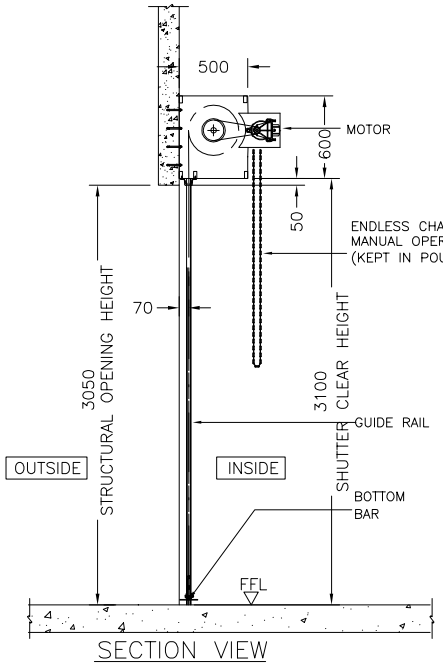

SECTION VIEW

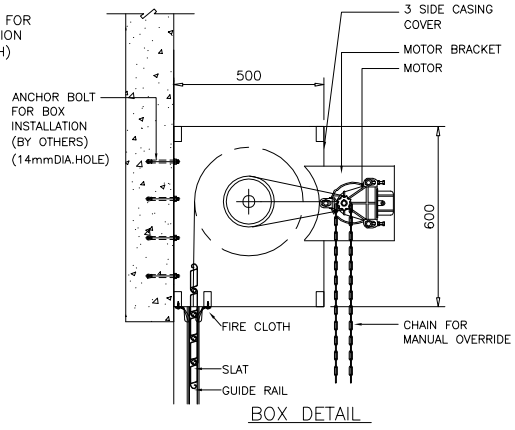

BOX DETAIL

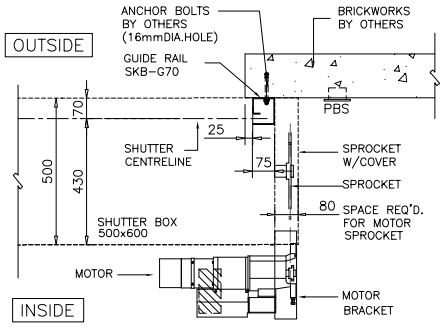

This drawing & design is the property of NIHVA TECHNOLOGIES. Not to be sold or copied to any other concern.

TITLE: 2HRS. FIRE RATED ROLLING SHUTTER

NIHVA
NIHVA TECHNOLOGIES PVT. LTD. PUNE
Tel : 020 66304033
Email:- info@nihva.com
Website:- www.nihva.com

	NAME	SIGN	DATE
DRAWN	P. A.		10/01/2020
CHECK	G.J		10/01/2020
APPRD.			

CLIENT - WANI

PROJECT - BRIDGESTONE

SITE LOCATION - CHAKAN

If any queries contact : design@nihva.com

DWG. NO. : NIHVA/19-20/0191 REV- 0

ALL DIMENSION ARE IN mm

SCALE: NTS WT: SHEET: 01 OF 01