

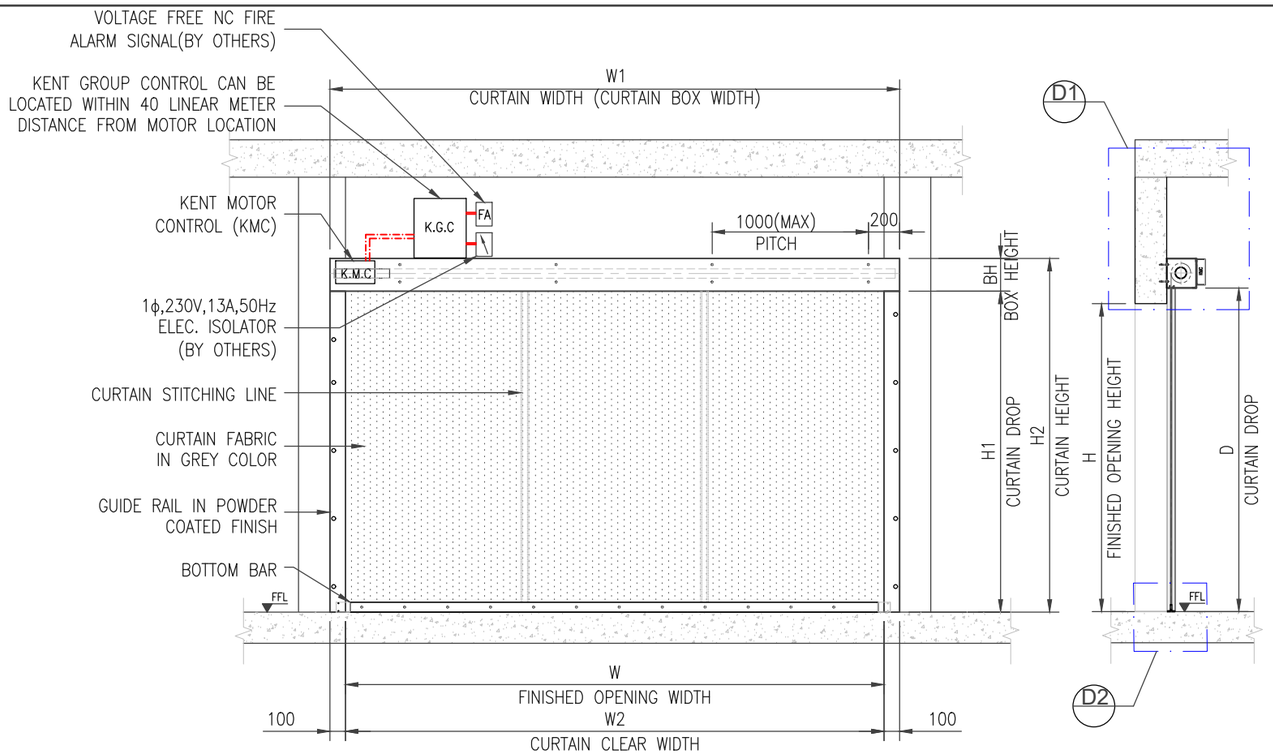


A
-
ELEVATION
SCALE: NTS


B
-
SECTION
SCALE: NTS

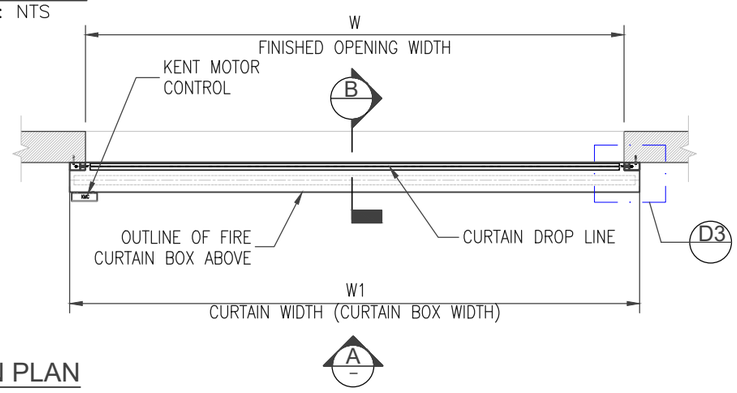


CURTAIN PLAN
SCALE: NTS

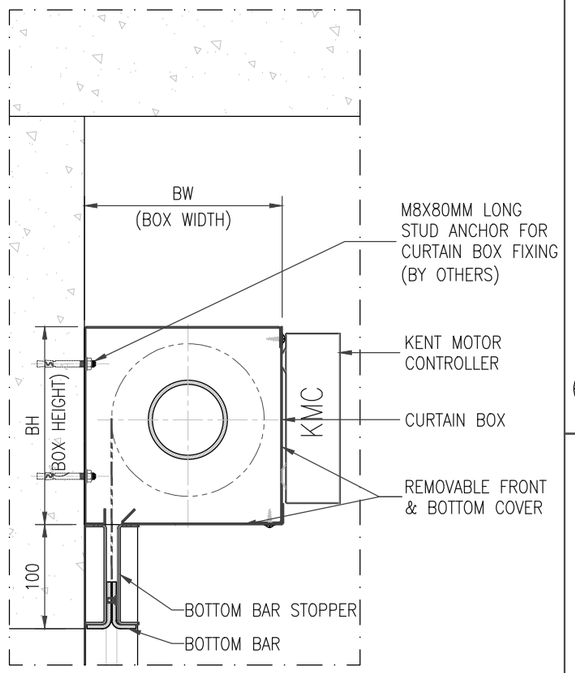

D1
-
ENLARGED DETAILS OF BOX CURTAIN
SCALE: NTS

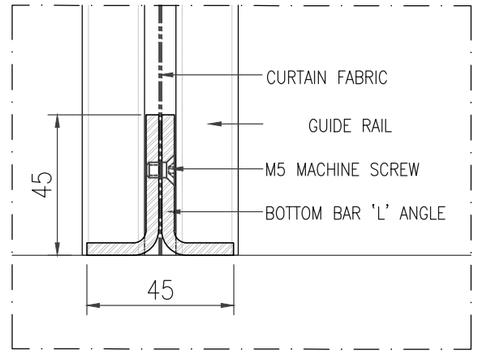

D2
ENLARGED DETAIL OF BOTTOM BAR
SCALE: NTS

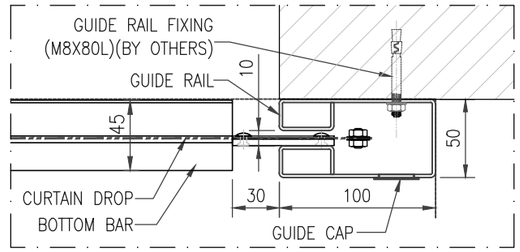

D3
-
ENLARGED DETAIL OF GUIDE RAIL
SCALE: NTS

FIRE CURTAIN SPECIFICATION:

CURTAIN	MANUFACTURED FROM WIRE REINFORCED, WOVEN GLASS FIBRE, FABRIC COATED ON EACH SIDE WITH POLYURETHANE (VWG-520) IN GREY COLOR FINISH
BOTTOM BAR	45x23x4.7mm THK STEEL BOTTOM BAR POWDER COATED FINISH (TBC)
BOX COVER	1.2mmTHK GALVANISED STEEL FINISH POWDER COATED FINISH (TBC)
END PLATE	3mmTHK GALVANISED STEEL END PLATES AND BRACKETS
GUIDE RAIL	2mmTHK GALVANISED STEEL POWDER COATED FINISH (TBC)
MOTOR	INTERNAL, ELECTRIC, TUBULER GEARED CONSTANT SPEED MOTOR
POWER SUPPLY	SINGLE PHASE, 230V,5A MIN,50Hz
FIRE ALARM SIGNAL	VOLTAGE FREE N.C SIGNAL

2HRS FIRE RATED FIRE CURTAIN - SCHEDULE

S.NO	SHUTTER REF.	LOCATION	QTY	WIDTH			HEIGHT			CURTAIN BOX SIZE		MOTOR LOCATION	FINISH	REMARKS
				W	W1	W2	H	H1	H2	BW	BH			
1	FC	–	3NOS	3000	3200	3000	5500	5600	5810	210	210	LEFT	TBC	

NOTE:
ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

Rev.	Date	By	Description	Checked	Approved
0	17.07.2025	PS	FOR APPROVAL		

NIHVA Technologies Pvt. Ltd.

Project Code NPTL-288-PM

Drawing Title : 2HRS FIRE CURTAIN PLAN, ELEVATION, SECTION & DETAILS

Designed J.P	Checked P.M	Approved	Drawing No. : NPTL-01-00-00	Rev. 00	Sheet 1 of 1
Scale N.T.S	Drawn	Date 17.07.2025	CAD File Name :		A3

PRINTEDDATE