
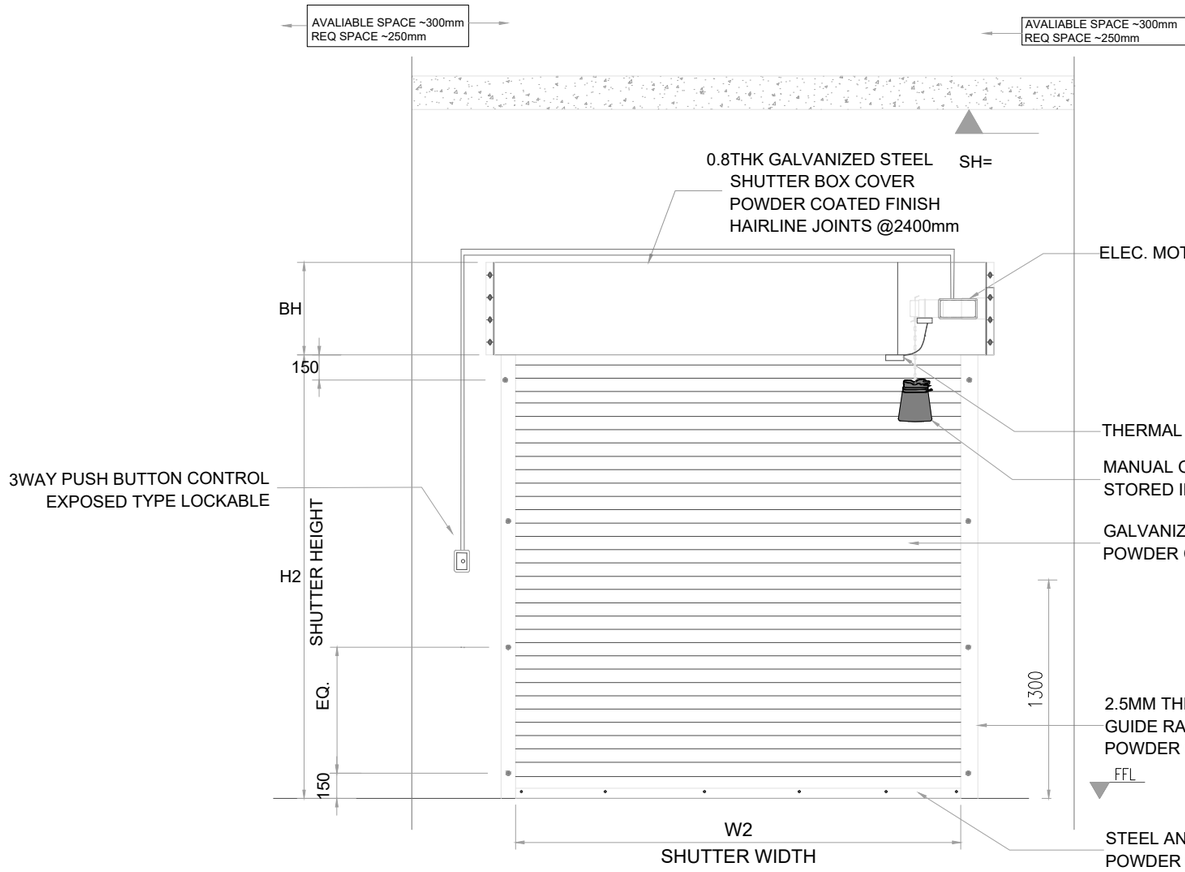




| (ATEX ZONE 1) | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|
| | | | | OPENING SIZE | | SHUTTER SIZE | | HEAD BOX SIZE | | MOTOR LOCATION | SHUTTER FINISH |
| | LOCATION | MOUNTING | QTY | W1 | H1 | W2 | H2 | BW | BH | | |
| 1 | PLANT 1 (RS04) | OUTSIDE | 01 | 2700 | 3500 | 2750 | 3550 | 500 | 600 | RHS | EXPLOSION PROOF ELECTRICAL SYSTEM AS PER ZONE 1 |


## TECHNICAL SPECIFICATION :

| SR. | SPECIFICATIONS | DETAILS |
|---|---|---|
| 1 | OPERATING MODE | MOTORISED |
| 2 | CERTIFICATION TYPE | BS EN1634-1 2014 + A1 : 2018 |
| 3 | FIRE RATING HRS | 2 HOUR FIRE RATED FERCO MOTORISED ROLLING SHUTTER |
| 4 | RAL COLOUR | RAL 3020 |

WE REQ MAINTENANCE SPACE

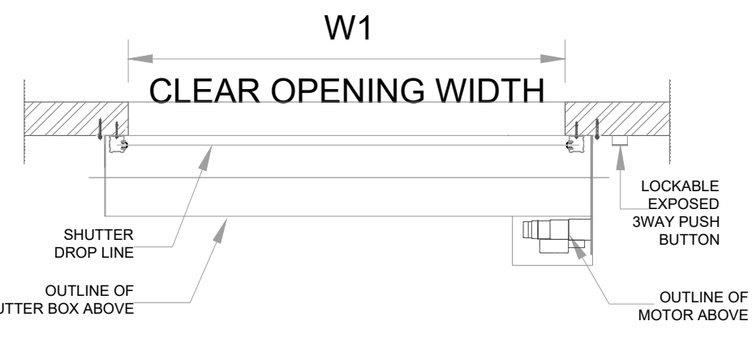


NOTE :-
1. All DIMENSIONS ARE IN MM.

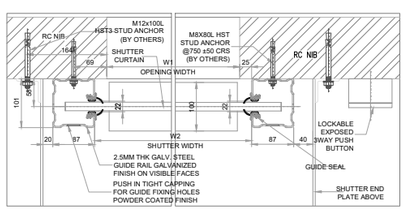This drawing & designing is the property of NIHVA TECHNOLOGIES. Not be sold or copy to any other concern.

| | | | |
|---|---|---|---|
| TITLE | DOOR AUTOMATION | | NIHVA TECHNOLOGY PVT. LTD. PUNE |
| | SIGN | DATE | Email:- Sales@nihva.com Website:- www.nihva.com |
| DRAWN | J.P | 26/03/26 | CLIENT - SIEGWERK INDIA PVT. LTD. |
| CHECK | B.S | 26/03/26 | PROJECT - 2 HRS. FIRE RATED ROLLING SHUTTERS |
| APPROVAL | V.T | 26/03/26 | |
| REV | 00 | | SITE - BHIWADI |
| If any queries contact : Design@nihva.com | | | SCALE: - WT: SHEET: 01 OF 01 |
| ALL DIMENSION ARE IN mm | | | DWG. NO. : NIHVA/25-26/178 |