

PROPOSED PLAN

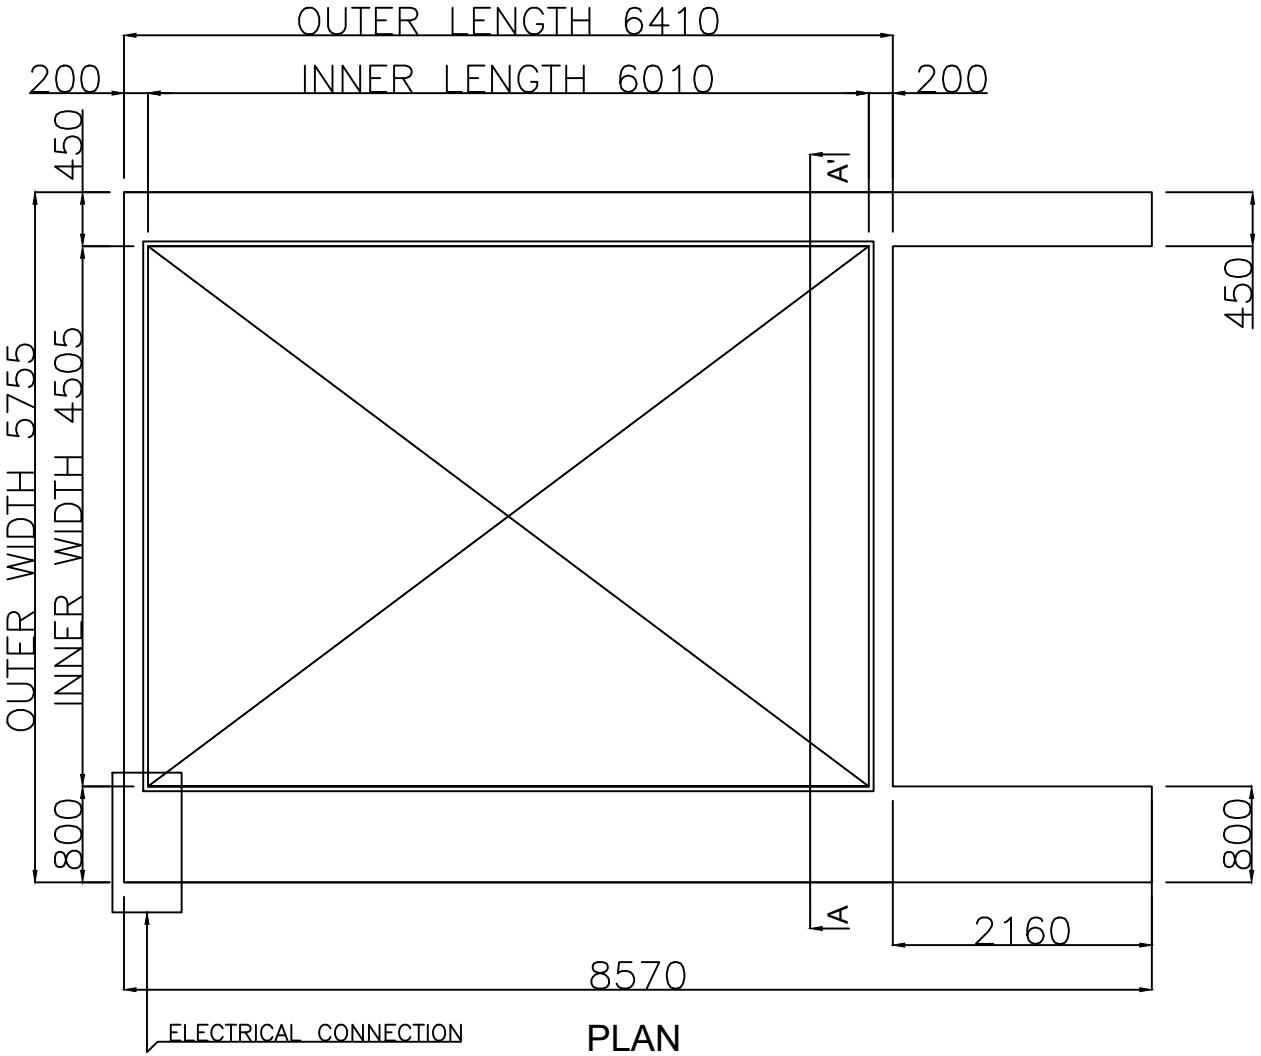

PLAN

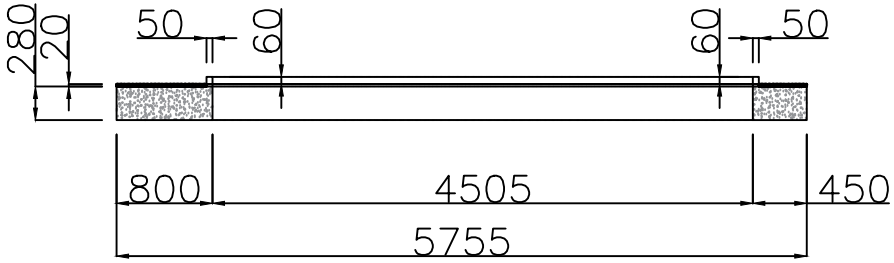

SECTION A-A'

1. THE STRUCTURE AROUND THE CUT OUT SHOULD BE OF CONCRETE FOR FOR PROPER FASTENING OF ROOF.
2. INNER PROJECTION OF 25X60MM REQUIRED AS A SINGLE STRUCTURE WITHOUT ANY JOINT TO AVOID WATER SEEPAGE INSIDE.
3. TOP SURFACE SHOULD BE OF GRANITE 20MM FOR SMOOTH FUNCTIONING OF ROOF.
4. ROOF EXTENSION IS SHOWN FOR ONLY REFERENCE. IT CAN BE MODIFIED AS PER THE WORK UNDERTAKEN.
5. GRADIENT OF 50MM NEED TO BE PROVIDED ALONG THE OUTER LENGTH TO AVOID WATER STAGNANCY IN GUIDE RAIL.
6. ELECTRICAL REQUIREMENT - 220V 5AMP SINGLE PHASE CONNECTION.
7. ALL DIMENSION IN MM.