


GALVANISED STEEL GUIDE RAIL
THICKNESS 3mm




SHUTTER SLAT






FIRE RATED BOTTOM BAR

SHUTTER TYPE	HIGH QUALITY 2HRS FIRE SHUTTERS
SHUTTER SLATS	1.0 mm ZINCALUME STEEL SOLID SLATS
FINISHING OF SLATS	POWER COAT STANDARD RAL COLOUR
GUIDE RAIL	GALVANIZED ,3mm THICK
FINISHING OF GUIDE	POWDER COAT STANDARD RAL COLOUR
BOTTOM BAR	T-120
FINISHING OF B/BAR	POWDER COAT STANDARD RAL COLOUR
BOX DESIGN	MILD STEEL SECTION FRAME DESIGN
FINISHING OF BOX	POWDER COAT STANDARD RAL COLOUR
BOX COVER PLATE	0.8mm ZINCALUME STEEL SHEET
FINISHING OF COVER	POWDER COAT STANDARD RAL COLOUR
OPERATION	MOTORIZE WITH MANUAL OVERRIDE CHAIN
MOTOR POWER SOURCE	230 VOLTS,1 PHASE,50HZ
FIRE MODE	THERMAL FUSIBLE LINK WILL AUTO CLOSE BY GRAVITY FORCE WHEN ROOM TEMP RISES UP TO 71°C
	FIRE SIGNAL FROM FIRE CONTROL ROOM AND SHUTTER SHALL CLOSE DOWN BY GRAVITY FORCE WITHOUT DELAY

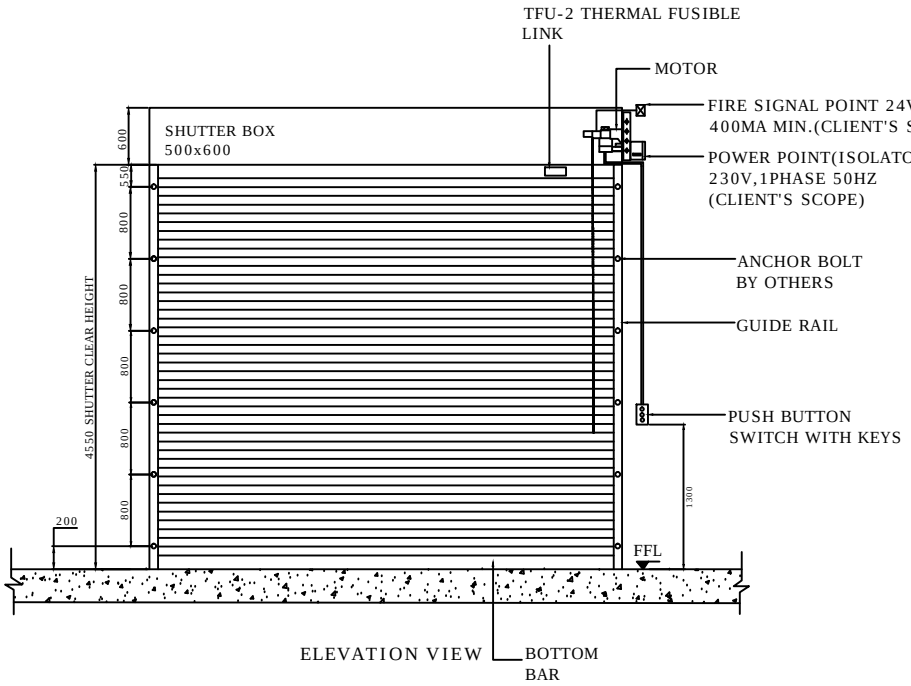


ELEVATION VIEW

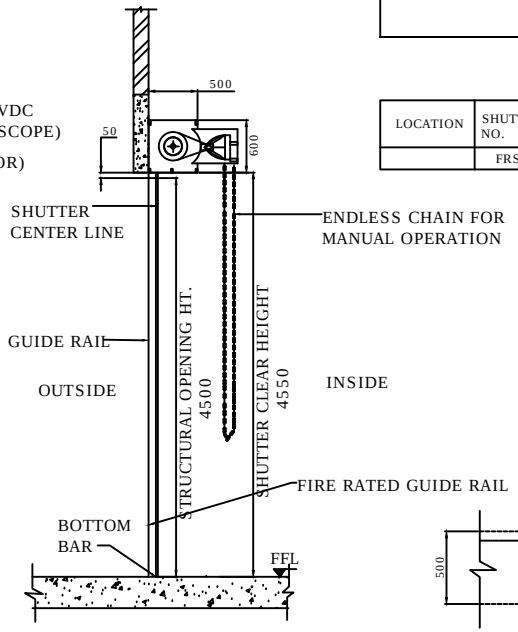


SIDE VIEW

LOCATION	SHUTTER NO.	CLEAR WIDTH (STRUCTURE)	CLEAR WIDTH (STRUCTURE)	QUANTITY	MOTOR POSITION
	FRS	4500 mm	4500 mm	3	RH

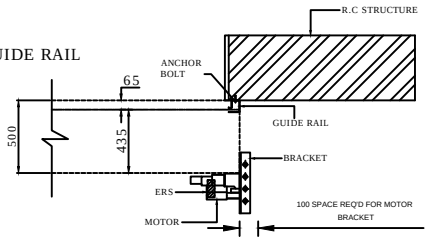

GUIDE & MOTOR ASSEMBLY DETAILS

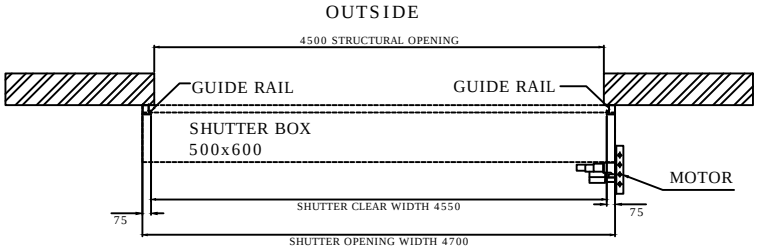

INSIDE
PLAN VIEW

NOTE:-

1. CLIENT SHOULD MENTION COLOR FOR SHUTTER.
2. THIRD PARTY FIRE RATED CERTIFICATE.
3. REQ. CIVIL WORK & M.S STRUCTURE WILL BE IN CLIENT SCOPE.

This drawing & designing is the property of NIHVA TECHNOLOGIES. Not to be sold or copied to any other concern.

TITLE
FIRE RATED ROLLING SHUTTER

NIHVA TECHNOLOGIES PVT. LTD. PUNE
Tel : 020 66304033
Email:- info@nihva.com
Website:- www.nihva.com

	NAME	SIGN	DATE
DRAWN	P.A		21.01.19
CHECK	V.T		21.01.19
APPROVAL			

CLIENT - ESR, PUNE
PROJECT - BMW
SITE - CHAKAN

If any queries contact : design@nihva.com
DWG. NO. : NIHVA/18-19/0248
REV. - 0
ALL DIMENSION ARE IN mm
SCALE: NTS
WT:
SHEET: 01 OF 01