
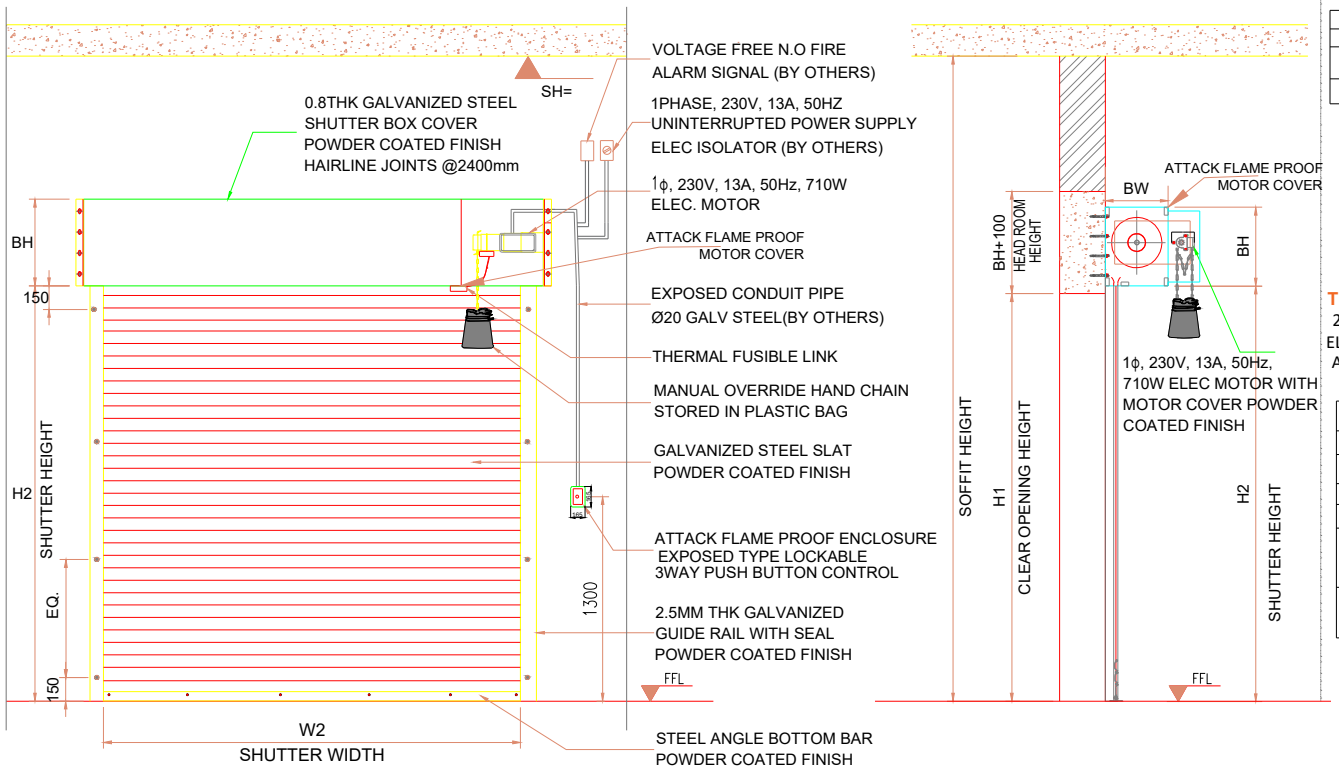



			OPENING SIZE		SHUTTER SIZE		HEAD BOX SIZE		MOTOR LOCATION	SHUTTER FINISH
	LOCATION	QTY	W1	H1	W2	H2	BW	BH		
1	IBC STORE (RS2)	01	3000	3600	2050	3550	500	500	LHS	EXPLOSION PROOF ELECTRICAL SYSTEM AS PER ZONE 1


TECHNICAL SPECIFICATION :

2 HRS FIRE RATED MOTORISED ROLLING SHUTTER WITH EXPLOSION-PROOF ELECTRICAL SYSTEM (ATEX ZONE 1) FOR QTY 23 NOS AND BALANCE 4NOS ARE 2 HRS FIRE RATED

SR.	SPECIFICATIONS	DETAILS
1	OPERATING MODE	MOTORISED
2	CERTIFICATION TYPE	BS EN1634-1 2014 + A1 : 2018
3	FIRE RATING HRS	2 HOUR FIRE RATED FERCO MOTORISED ROLLING SHUTTER
4	RAL COLOUR	RAL 3020
5	CONSIDER FOR MOUNTING AREA = 2HRS FIRERATED SHUTTER SIZES WITH EXPLOSION PROOF ELECTRICAL SYSTEM AS PER ZONE 1	1. PLANT 1 & 2 SIZE : 2.7M X 3.5M – 14 NOS 2. FOR W/H (RM+FG STORE; IBC STORE; DRUM STORAGE) = SIZE : 2.7M X 3.5M – 6 NOS + SIZE 2.7M X 4.0M – 3 NOS
6	CONSIDER FOR MOUNTING AREA = ONLY 2HRS FIRE RATED SHUTTER SIZES WITHOUT EXPLOSION PROOF ELECTRICAL SYSTEM	1. FOR W/ H (PACKING MATERIAL STORE AND WB RM STORE) = SIZE : 2.7M X 3.5M – 3 NOS + SIZE : 2.7M X 6.0M – 1 NO

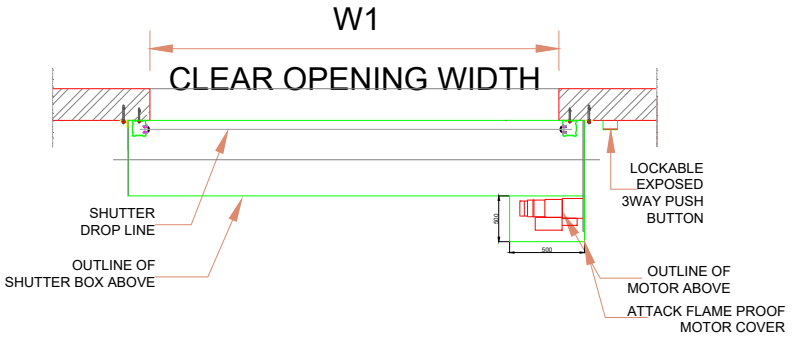



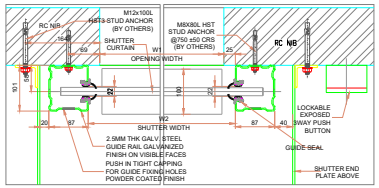

NOTE :-
1. All DIMENSIONS ARE IN MM.

This drawing & designing is the property of NIHVA TECHNOLOGIES. Not be sold or copy to any other concern.

TITLE	DOOR AUTOMATION		NIHVA TECHNOLOGY PVT. LTD. PUNE Website:- www.nihva.com
	SIGN	DATE	
DRAWN	J.P	26/08/26	CLIENT -
CHECK	B.S	26/08/26	PROJECT - 2 HRS. FIRE RATED ROLLING SHUTTERS
APPROVAL	V.T	26/08/26	
REV	00		SITE -
If any queries contact :sales@nihva.com			SCALE: - WT: SHEET: 01 OF 01
ALL DIMENSION ARE IN mm			DWG. NO. : NIHVA/25-26/178