

# PROPOSED PLAN LAYOUT

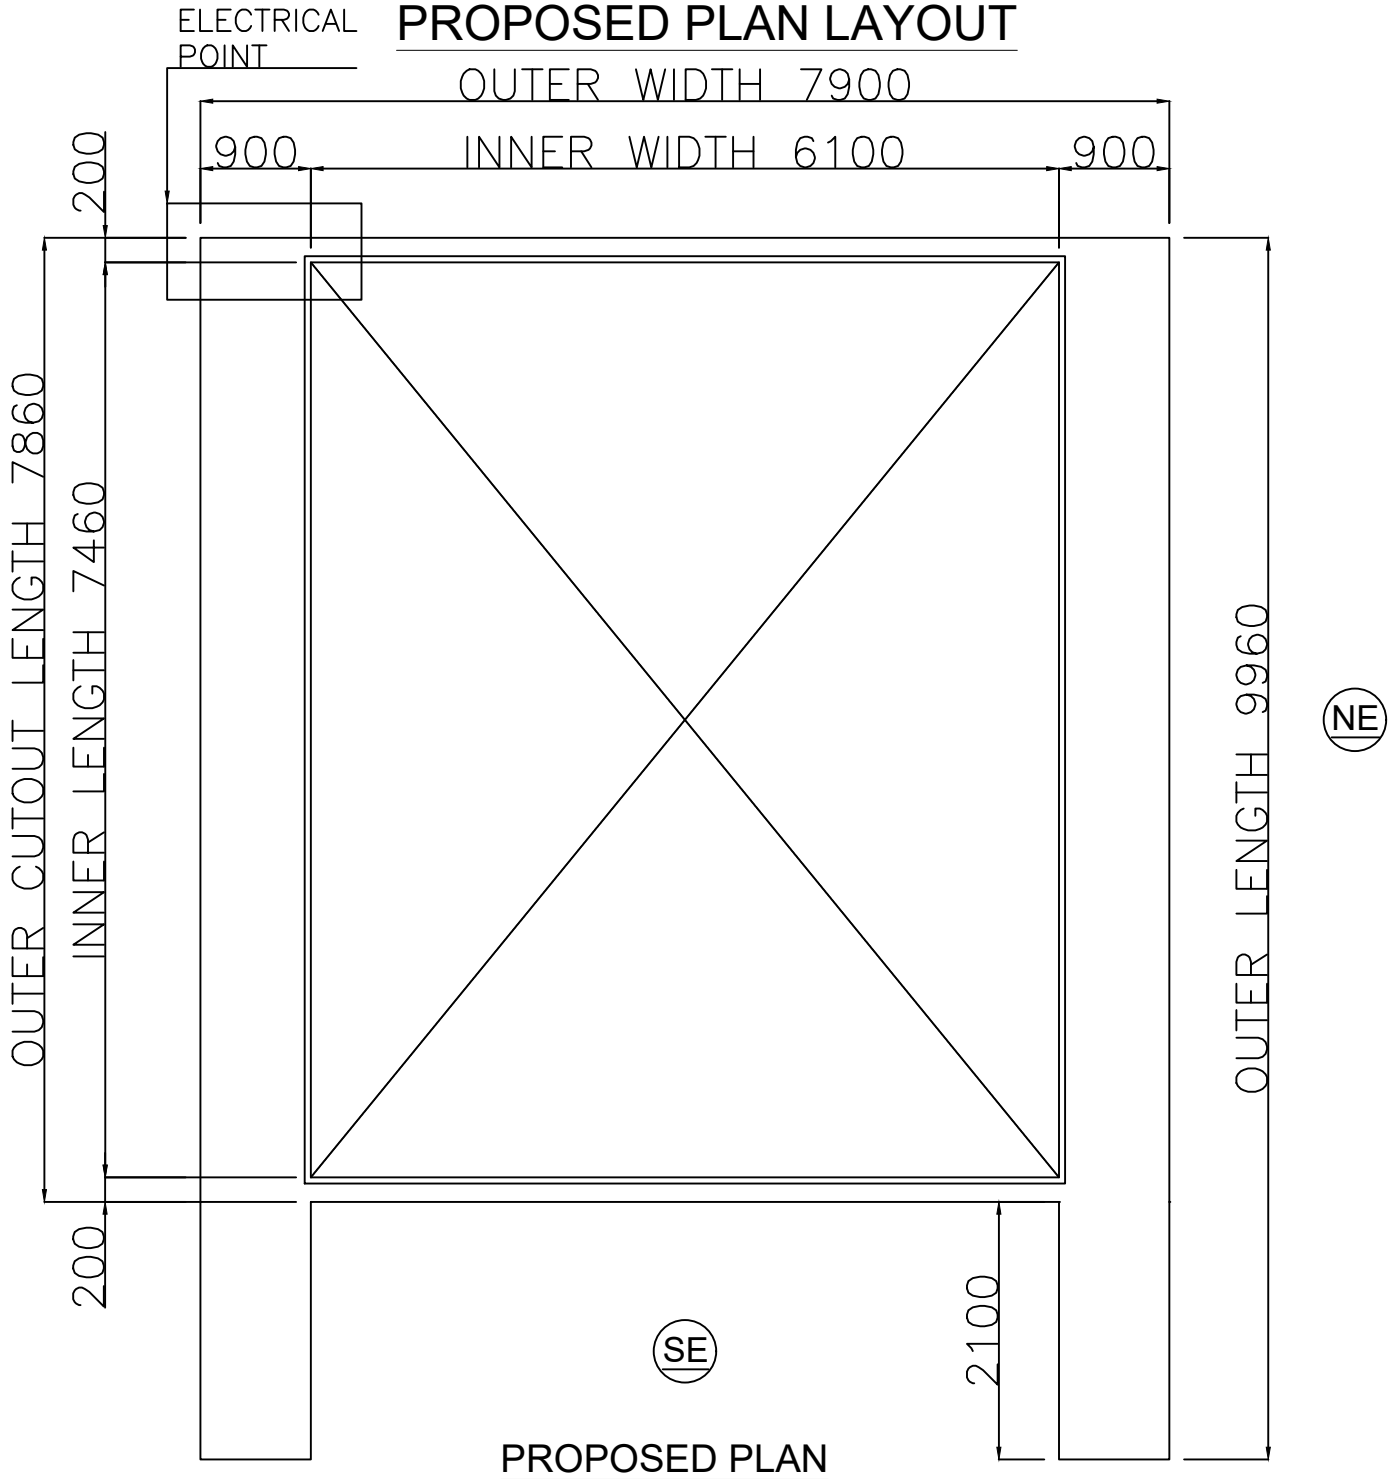


## PROPOSED PLAN

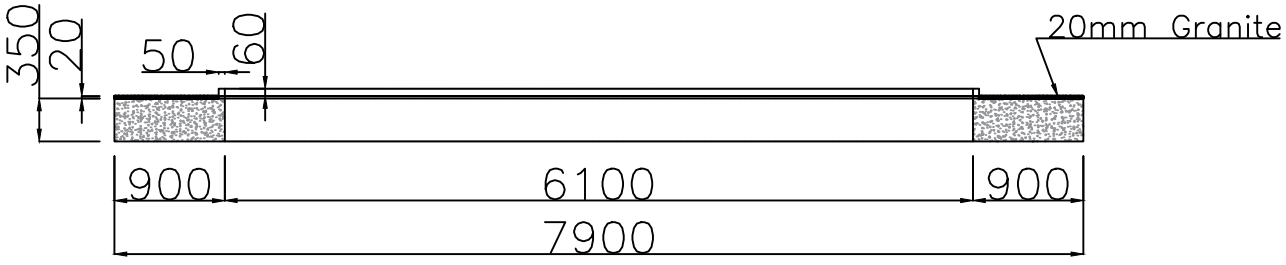


## SECTION VIEW

1. THE STRUCTURE AROUND THE CUT OUT SHOULD BE OF CONCRETE FOR FOR PROPER FASTENING OF ROOF.
2. TOP SURFACE SHOULD BE OF GRANITE 20MM FOR SMOOTH FUNCTIONING OF ROOF.
3. ROOF EXTENSION IS SHOWN FOR ONLY REFERENCE. IT CAN BE MODIFIED AS PER THE WORK UNDERTAKEN.
4. GRADIENT OF 50MM NEED TO BE PROVIDED ALONG THE OUTER LENGTH TO AVOID WATER STAGNANCY IN GUIDE RAIL.
5. AL PROFILE - POWDER COATED
6. GASKET - EPDM
7. MOTOR - ITALIAN/GERMAN MAKE
8. ELECTRICAL REQUIREMENT - 220V 5AMP SINGLE PHASE CONNECTION.
9. ALL DIMENSION IN MM.

This drawing & design is the property of NIHVA TECHNOLOGIES. Not to be sold or copied to any other concern.

TITLE: PROPOSED PLAN LAYOUT

NIHVA TECHNOLOGIES PVT. LTD.

| | NAME | SIGN | DATE |
|---|---|---|---|
| DRAWN | S.S. | | 29.06.22 |
| CHECK | A.K. | | 29.06.22 |
| APPRD. | V.T. | | 29.06.22 |

If any queries contact : projectsautomation@nihva.com

ALL DIMENSION ARE IN mm

CLIENT - CAPT. ABHIMANYU

LOCATION - CHANDIGARH_IN

PRODUCT - RETRACTABLE ROOF

NIHVA\22-23\02XX | REV- 0

SCALE: NTS | SHEET: 01 OF 01