Changes Required:-
1) Add cross section for both (Open and closed) conditions
2) We are going to mount guides on wall directly, so change the drawing accordingly.

DISTRIBUTED LOAD
Door closed: 11.6kN
Door open: 5.2 kN

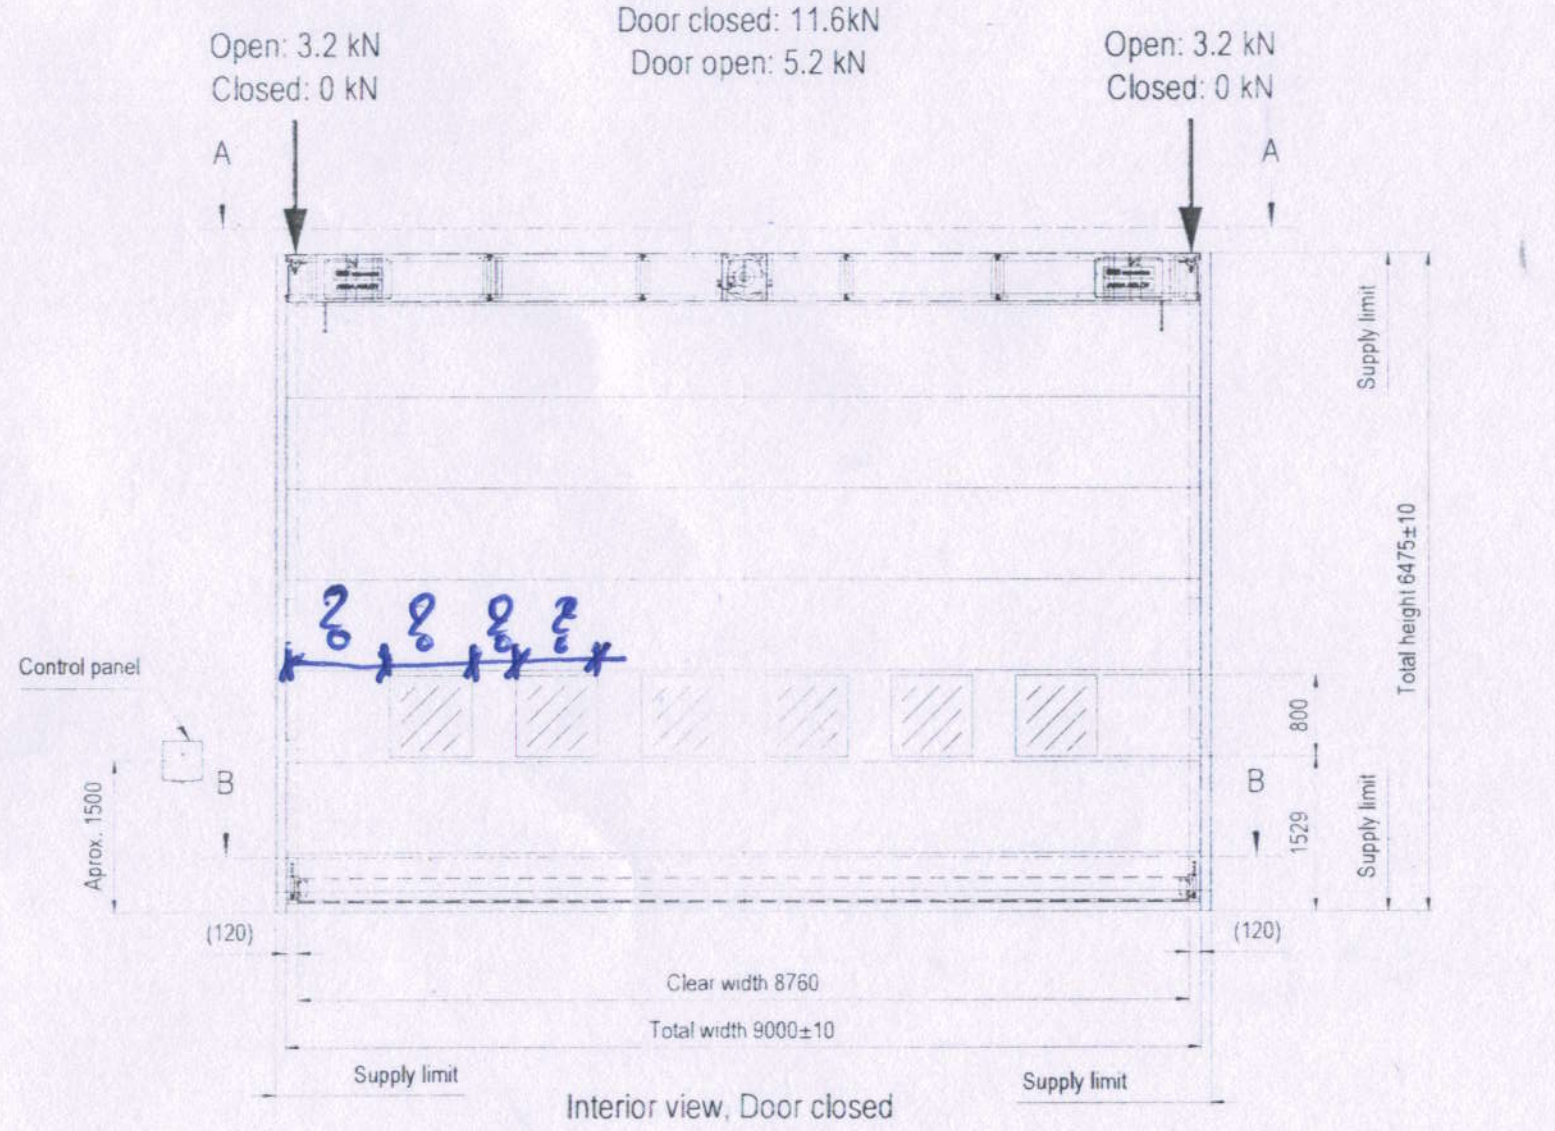

Interior view, Door closed

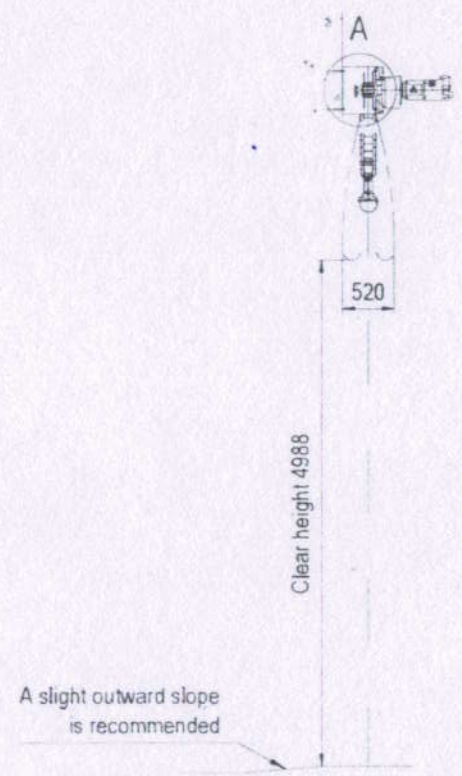

Add title of detail and Scale

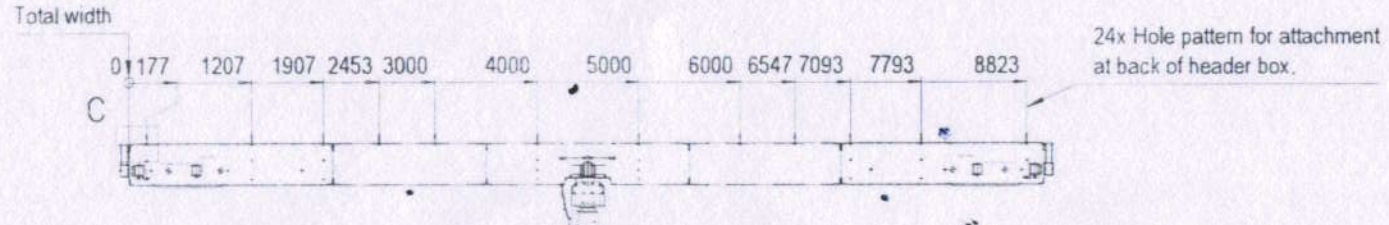

SECTION A-A

Scale?

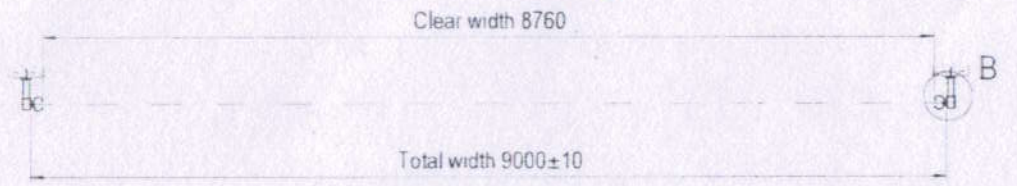

SECTION B-B

Door leaf is not shown for clarification

Scale?



DETAIL C, SCALE (1:10)

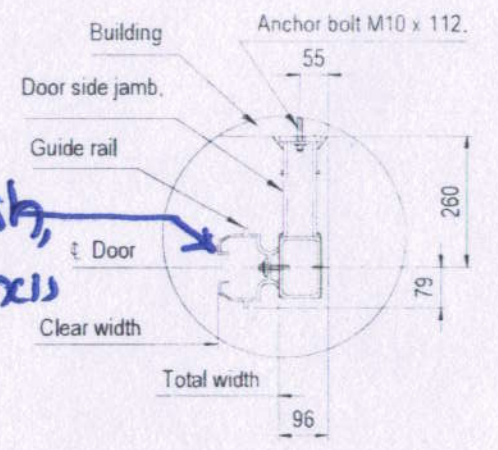

Mention finish, material & thickness of guide

DETAIL B, SCALE (1:10)

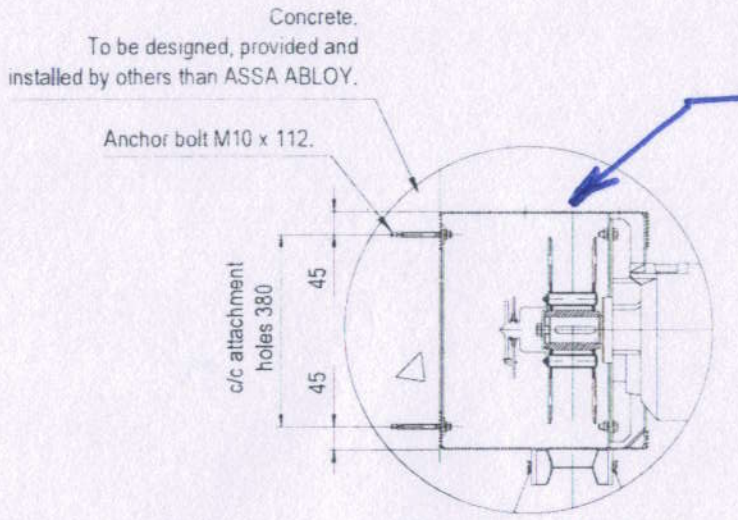

Concrete.
To be designed, provided and installed by others than ASSA ABLOY.
Anchor bolt M10 x 112.
c/c attachment holes 380
45
45

Mention finish, thickness and material of Header box.

DETAIL A, SCALE (1:10)

NOT INCLUDED IN DOOR SUPPLY:
1. Design and supply of all door supporting structural components.
2. Design and supply of all closure between door and adjacent steel.
3. Door jambs adjustable for overall door width and true to plumb.
4. Paint job after completed door installation.
5. Any frameworks being provided by ASSA ABLOY will be clearly indicated as "by ASSA ABLOY".

REQUIREMENTS ON BUILDING:
6. Door head support must be straight within 1/600 of span in the in/out direction and free from protrusions of any kind.
7. For a single door leaf, door head support should be horizontal and straight within 1/600 of span at distributed full door load.
8. Door side jambs must be smooth, straight and parallel, out of plumb must not exceed 2mm/m (total deviation at full length 5 mm) in any direction.
9. Any footings at bottom of jamb columns must not interfere with installation of guide rails at floor level.
10. At time of installation, finished floor, free from obstructions, out to a distance of 2 m on each side of door centreline must be available.
11. Header box must be accessible from both sides during installation.

DOOR PROPERTIES:
12. The door is designed to withstand a differential pressure of 1.15kPa.
13. Color of door fabric: Please specify
14. Side profiles
15. Metal trim: motor side

ELECTRICAL:
16. One main control panel provided of PLC type.
17. Audible and visual alarm
18. Back-up power switch
19. Safety edge
20. Approx. size of main control panel: WxHxD (500mm x 600mmx250 mm),
21. Power: 2.7kW
22. Nom. current: 6.4A
23. (max. allowed voltage drop at start: 5%)

BELT HOIST UNITS:
SK 873.1-100L/4 Z dual brake

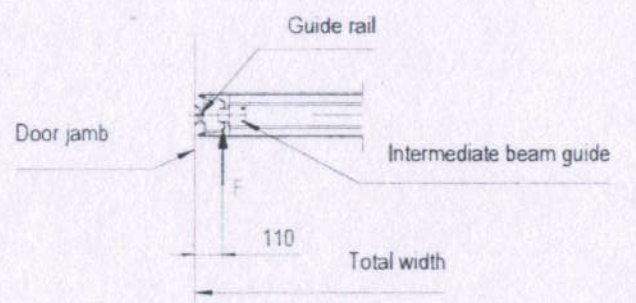

Force by differential pressure transferred to guide rail at each intermediate position.
F=4.7 kN

Provide detailing of Header

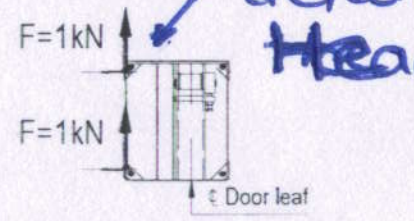

Load on header box attachment (each screw), due to wind load and door weight

Building: ARFF5

DESIGNED	SIZE	SCALE	
KMÖ	A1	1:50	Delhi Fire Station India Megadoor 8760 x 4988 Sales interface
CODE 22240-22241	If not otherwise stated Tolerances ISO 2768-m EN ISO 13920-B Cutting class ISO 9013-442 Weld class ISO 5817-C Surface finish Smooth raw surface		PLOT DATE
ITEM NO			
DATE 2021-07-22			DRAWING NO 74414
ASSA ABLOY			REVISION --

* Please refer general comments on dwg 74414

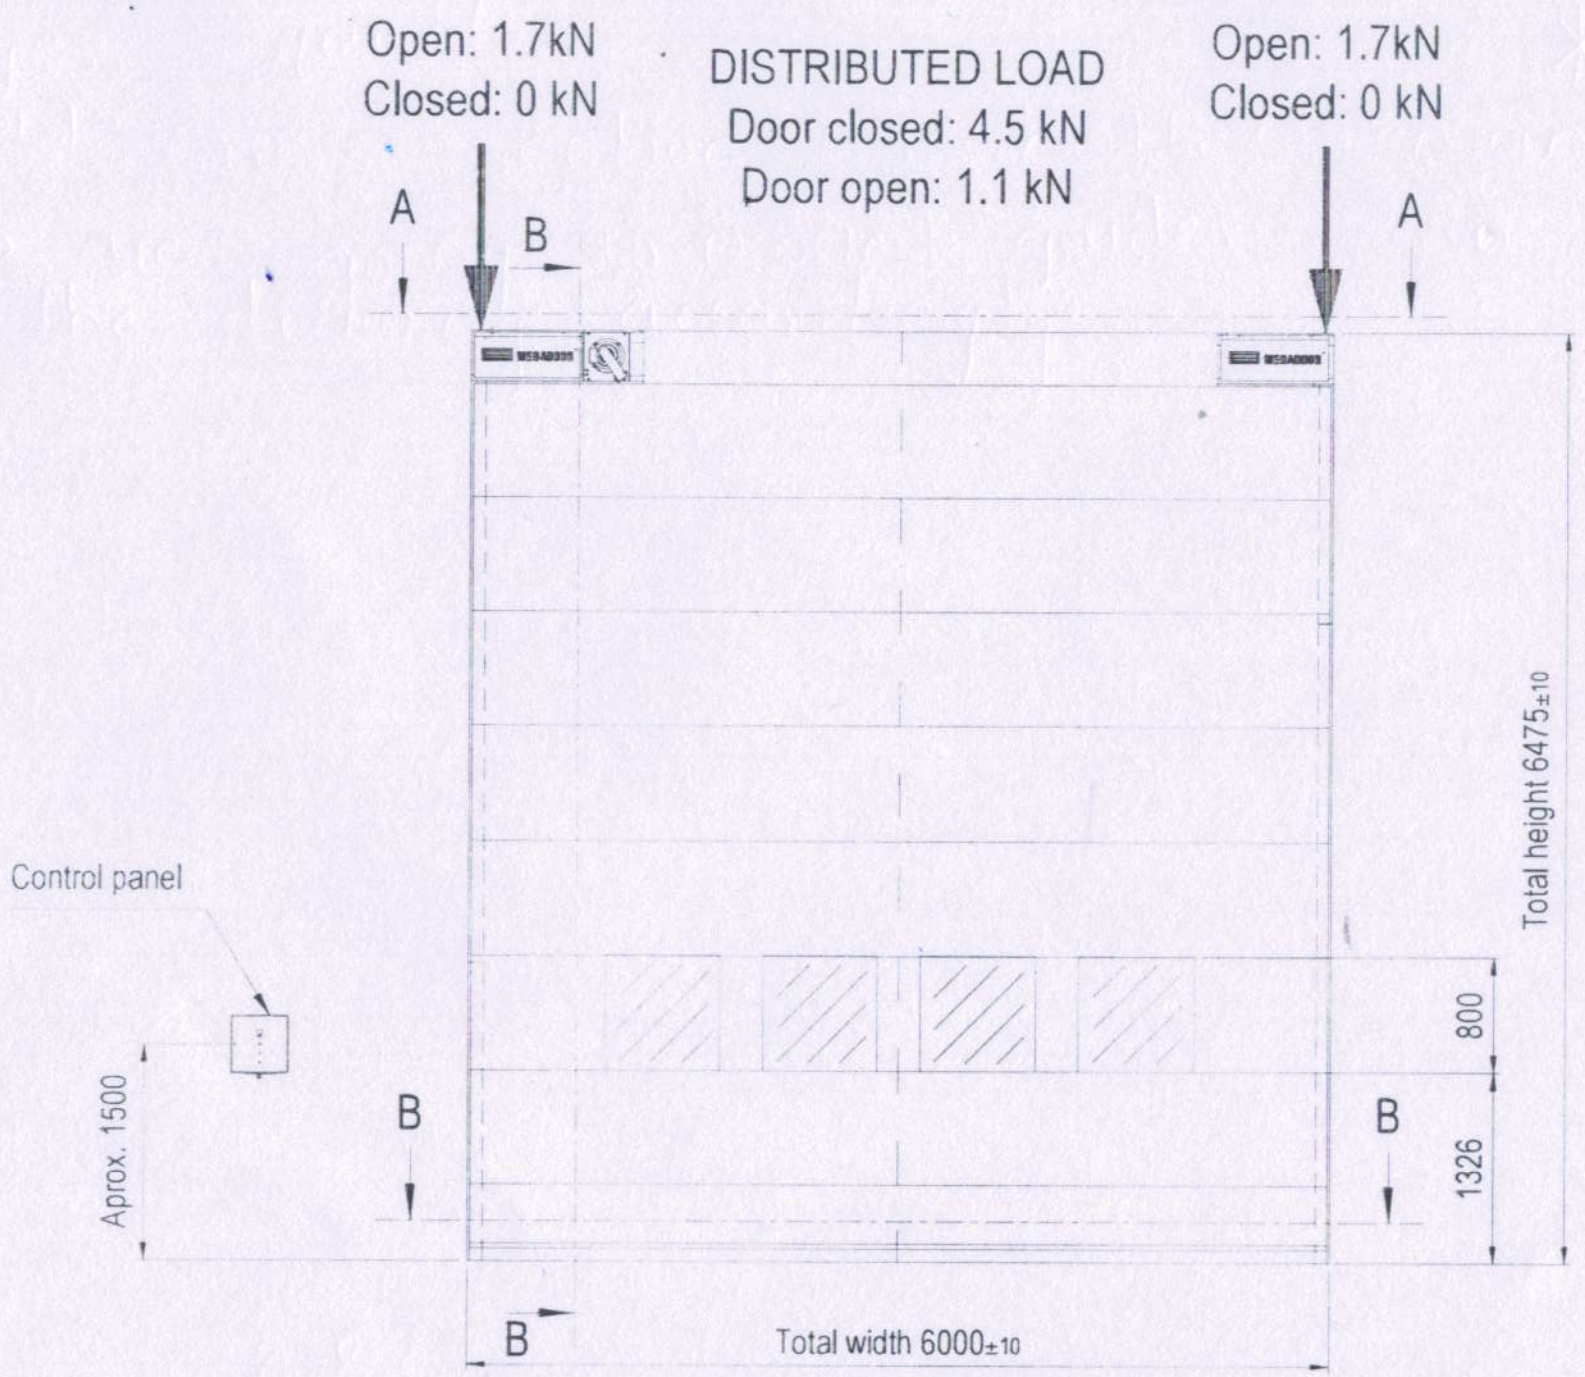

Interior view, Door closed

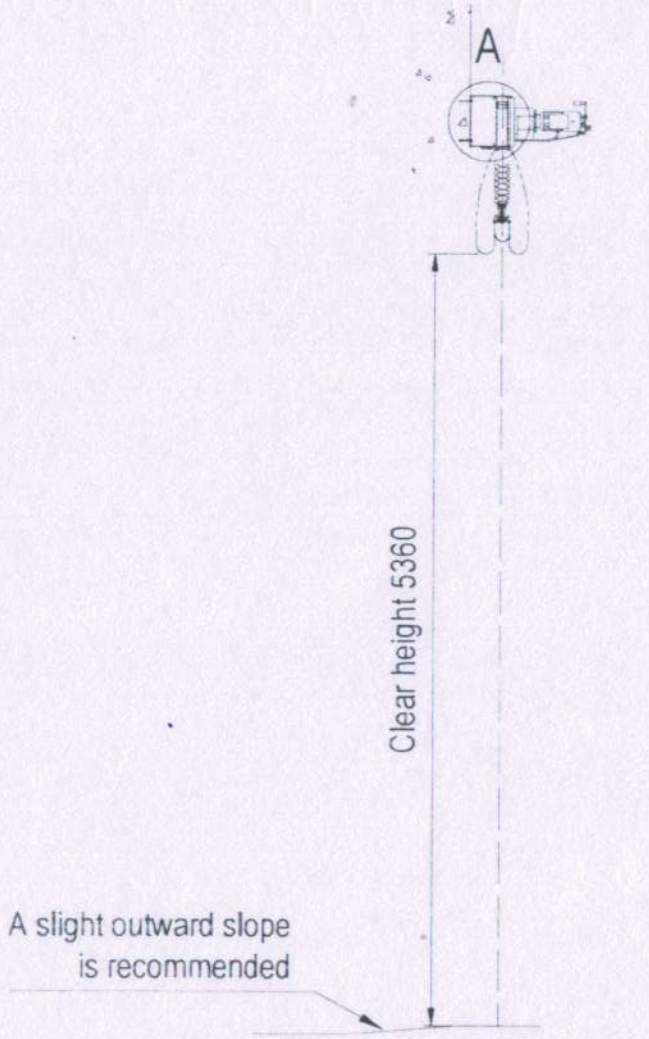

SECTION B-B

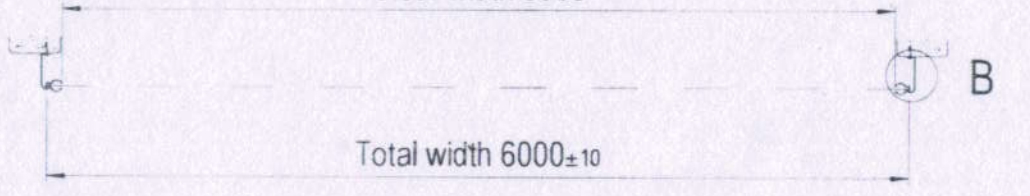

SECTION B-B

Door leaf is not shown for clarification

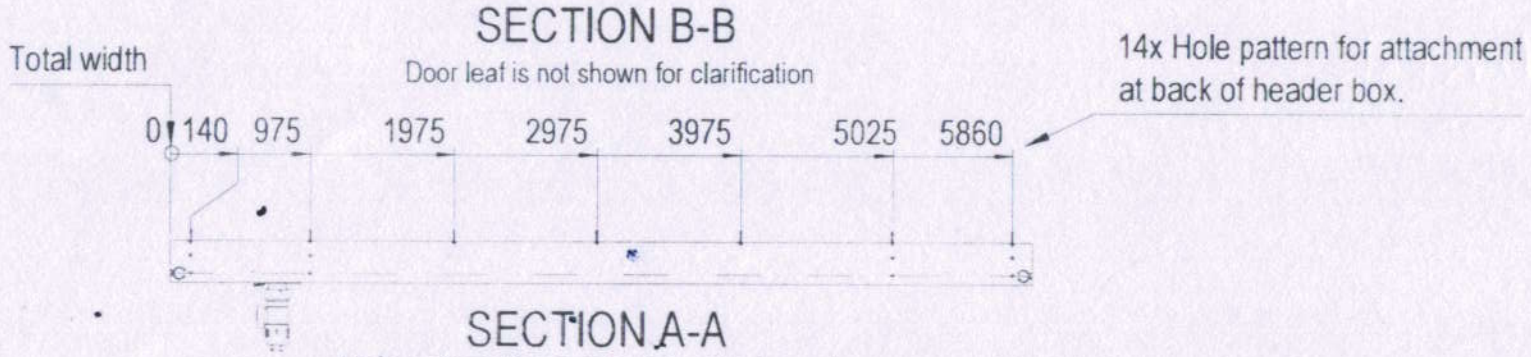

SECTION A-A

Hole pattern for header box attachment

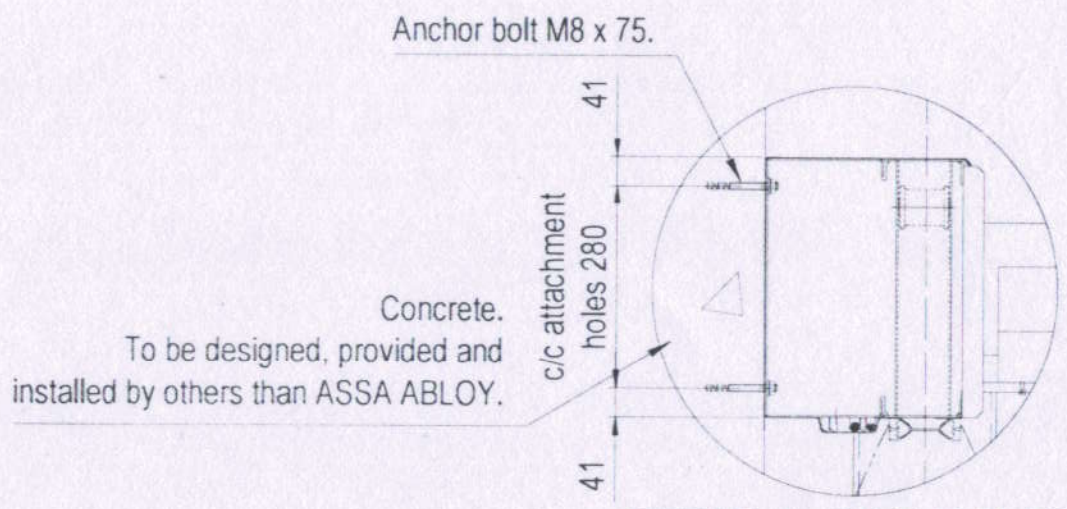
Anchor bolt M8 x 75.
41
c/c attachment holes 280
41
Concrete.
To be designed, provided and installed by others than ASSA ABLOY.

DETAIL A, SCALE (1:10)

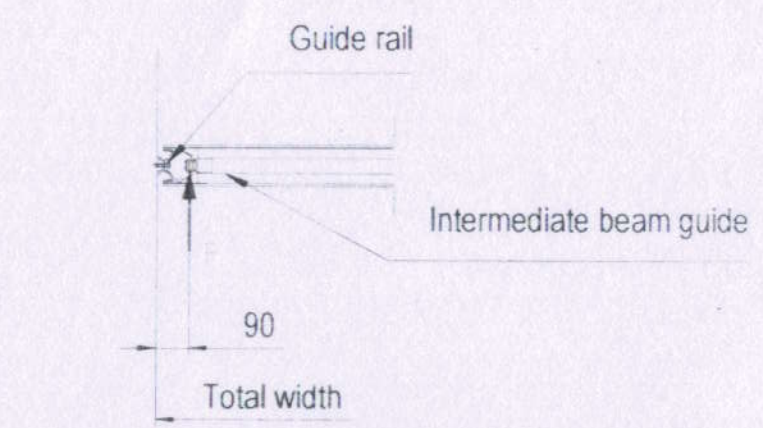

Force by differential pressure transferred to guide rail at each intermediate position.
F= 2.7 kN

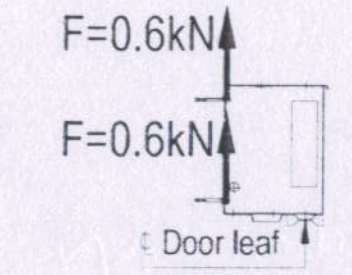

Load on header box attachment (each screw), due to wind load and door weight

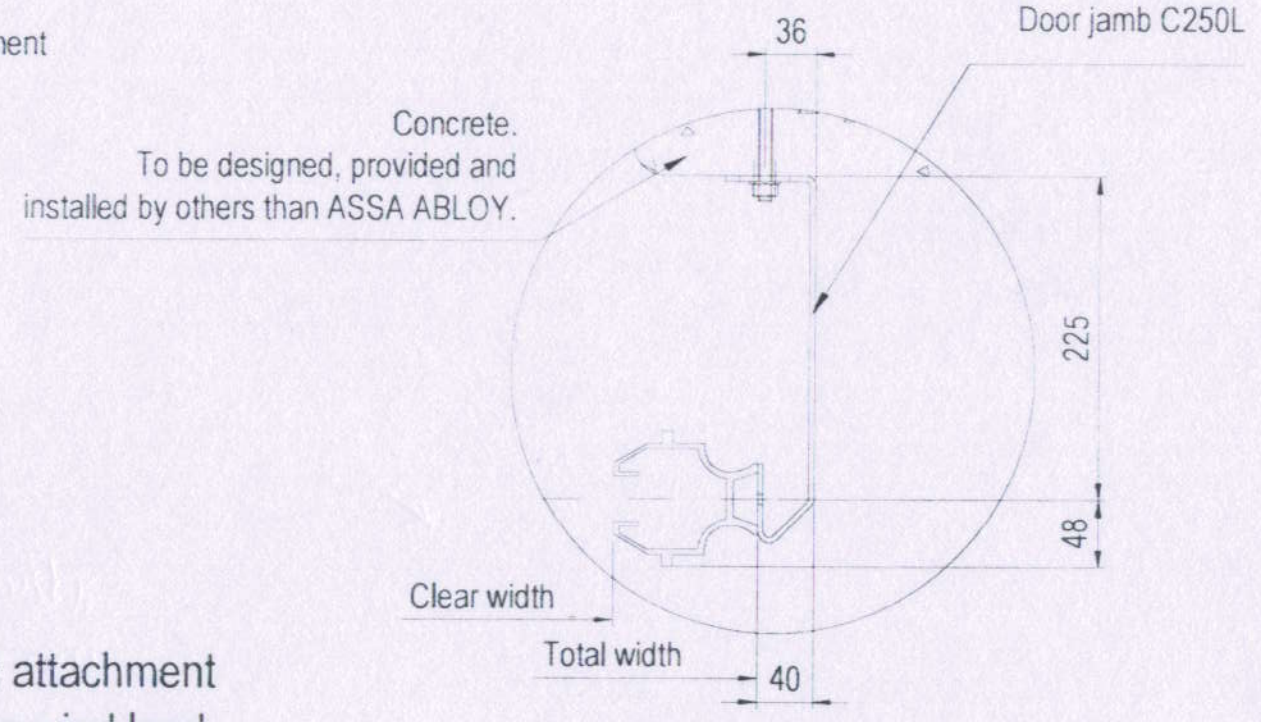
36
Door jamb C250L
Concrete.
To be designed, provided and installed by others than ASSA ABLOY.
225
48
Clear width
Total width
40

DETAIL B, SCALE (1:5)

NOT INCLUDED IN DOOR SUPPLY:
1. Design and supply of all door supporting structural components.
2. Design and supply of all closure between door and adjacent steel.
3. Door jambs adjustable for overall door width and true to plumb.
4. Paint job after completed door installation.
5. Any frameworks being provided by ASSA ABLOY will be clearly indicated as "by ASSA ABLOY".

REQUIREMENTS ON BUILDING:
6. Door head support must be straight within 1/600 of span in the in/out direction and free from protrusions of any kind.
7. For a single door leaf, door head support should be horizontal and straight within 1/600 of span at distributed full door load.
8. Door side jambs must be smooth, straight and parallel, out of plumb must not exceed 2mm/m (total deviation at full length 5 mm) in any direction.
9. Any footings at bottom of jamb columns must not interfere with installation of guide rails at floor level.
10. At time of installation, finished floor, free from obstructions, out to a distance of 2 m on each side of door centreline must be available.
11. Header box must be accessible from both sides during installation.

DOOR PROPERTIES:
12. The door is designed to withstand a differential pressure of 1.15kPa.
13. Metal trim: motor side
14. Side profiles
15. Fabric colour: Please specify

ELECTRICAL:
14. One main control panel provided of PLC type.
15. Audible and visual alarm
16. Safety edge
17. Back-up power switch
18. Approx. size of main control panel: WxHxD (500mm x 600mm x 250 mm),
19. Power: 1.4kW
20. Nom. current: 3.3A
21. (max. allowed voltage drop at start: 5%)

BELT HOIST UNITS:
Sk 773.1-90S/4 Z dual brake

Building: ARFF5

DESIGNED KMÖ	SIZE A2	SCALE 1:50	Delhi Fire Station India Megadoor 5800 x 5360 Sales Interface
CODE 22242-22245	If not otherwise stated Tolerances ISO 2768-m EN ISO 13920-B		
ITEM NO			
DATE 2021-09-27	Cutting class ISO 9013-442 Weld class ISO 5817-C		DRAWING NO 74413
ASSA ABLOY	Surface finish Smooth raw surface		REVISION --

PLOT DATE

* Please refer general comments on dwg 74414

Revision		Date	By
A	CW was 9000, CH was 5400	2022-09-27	KMO

NOT INCLUDED IN DOOR SUPPLY:
1. Design and supply of all door supporting structural components.
2. Design and supply of all closure between door and adjacent steel.
3. Door jambs adjustable for overall door width and true to plumb.
4. Paint job after completed door installation.
5. Any frameworks being provided by ASSA ABLOY will be clearly indicated as "by ASSA ABLOY".

REQUIREMENTS ON BUILDING:
6. Door head support must be straight within 1/600 of span in the in/out direction and free from protrusions of any kind.
7. For a single door leaf, door head support should be horizontal and straight within 1/600 of span at distributed full door load.
8. Door side jambs must be smooth, straight and parallel, out of plumb must not exceed 2mm/m (total deviation at full length 5 mm) in any direction.
9. Any footings at bottom of jamb columns must not interfere with installation of guide rails at floor level.
10. At time of installation, finished floor, free from obstructions, out to a distance of 2 m on each side of door centreline must be available.
11. Header box must be accessible from both sides during installation.

DOOR PROPERTIES:
12. The door is designed to withstand a differential pressure of 1.15kPa.
13. Color of door fabric: Please specify
14. Side profiles
15. Metal trim: motor side

ELECTRICAL:
16. One main control panel provided of PLC type.
17. Audible and visual alarm
18. Back-up power switch
19. Safety edge
20. Approx. size of main control panel: WxHxD (500mm x 600mmx250 mm).
21. Power: 2.7kW
22. Nom. current: 6.4A
23. (max. allowed voltage drop at start: 5%)

BELT HOIST UNITS:
SK 873.1-100L/4 Z dual brake

DISTRIBUTED LOAD
Door closed: 11.6kN
Door open: 5.2 kN

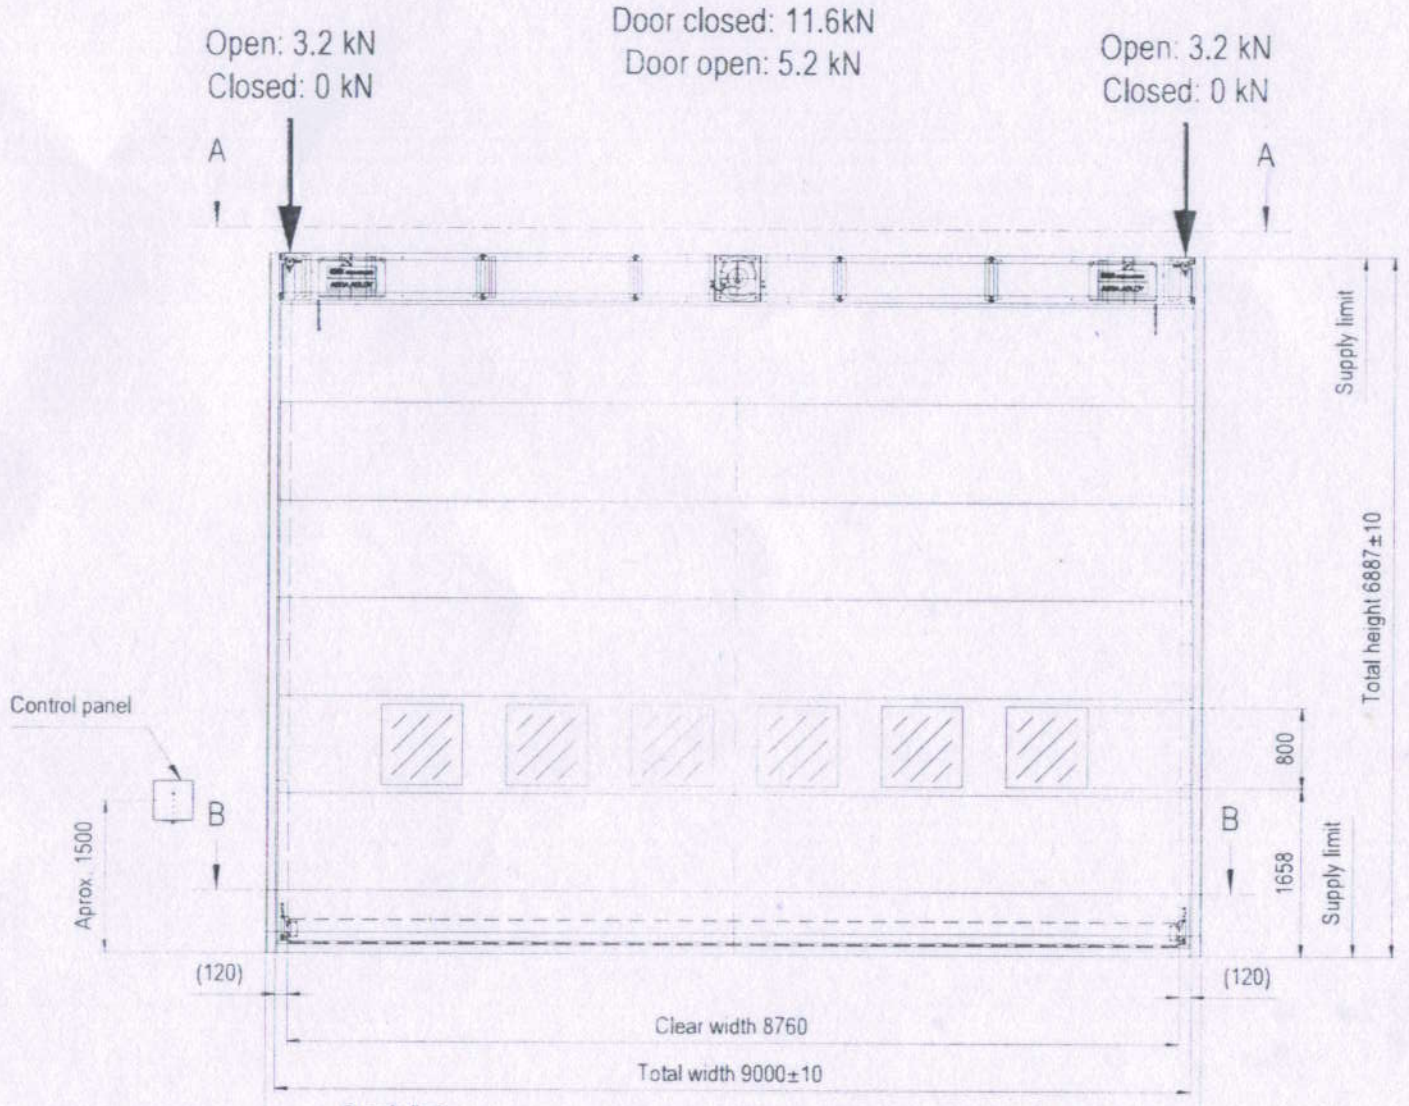

Interior view, Door closed

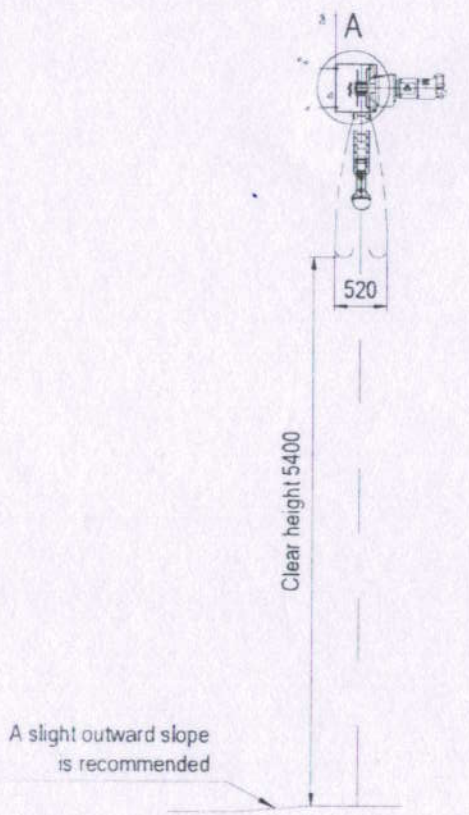

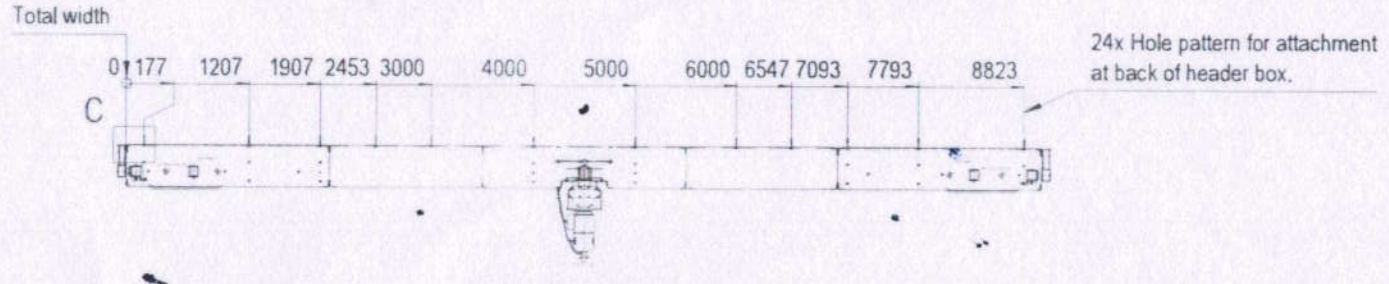

SECTION A-A

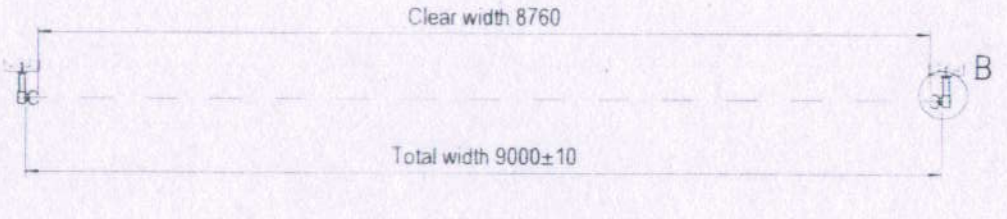

SECTION B-B

Door leaf is not shown for clarification



DETAIL C, SCALE (1:10)

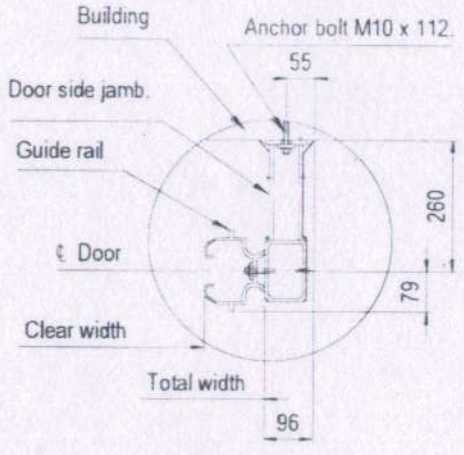

DETAIL B, SCALE (1:10)

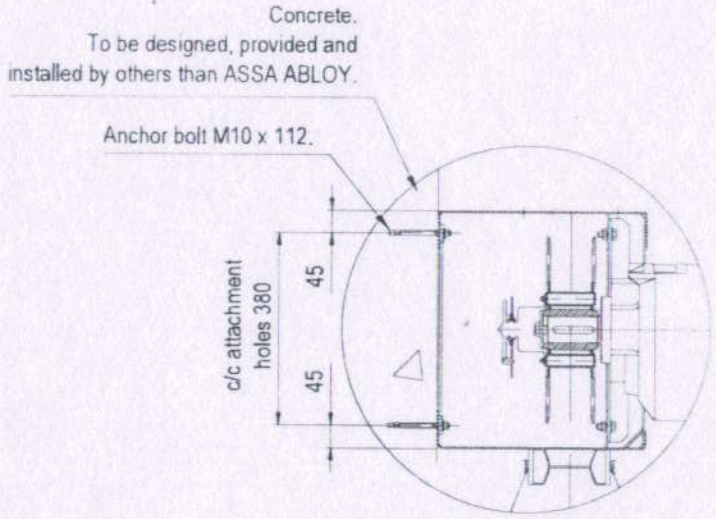
Concrete.
To be designed, provided and installed by others than ASSA ABLOY.
Anchor bolt M10 x 112.
c/c attachment holes 380
45
45

DETAIL A, SCALE (1:10)

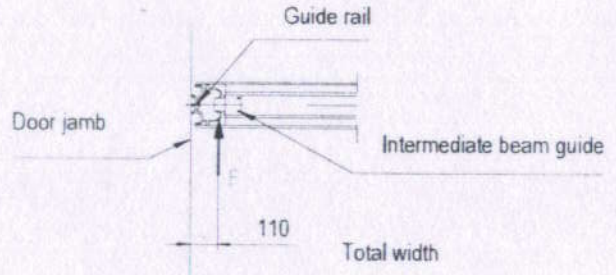

Force by differential pressure transferred to guide rail at each intermediate position.
F=4.7 kN

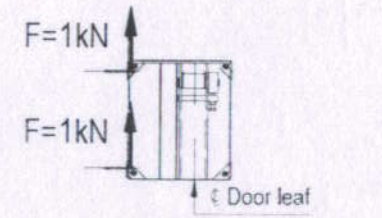

Load on header box attachment (each screw), due to wind load and door weight

Building: ARFF4

DESIGNED KMÖ	SIZE A1	SCALE 1:50	Delhi Fire Station India Megadoor 8760 x 5400 Sales interface	PLOT DATE
CODE 22238-22239	If not otherwise stated Tolerances ISO 2768-m EN ISO 13920-B Cutting class ISO 9013-442 Weld class ISO 5817-C Surface finish Smooth raw surface			
ITEM NO				
DATE 2021-07-22			DRAWING NO 74147	REVISION A
ASSA ABLOY				

Revision		Date	By
A	CW was 6000, CH was 5400	2022-09-27	KMÖ

* Please refer general comments on dwg 74414

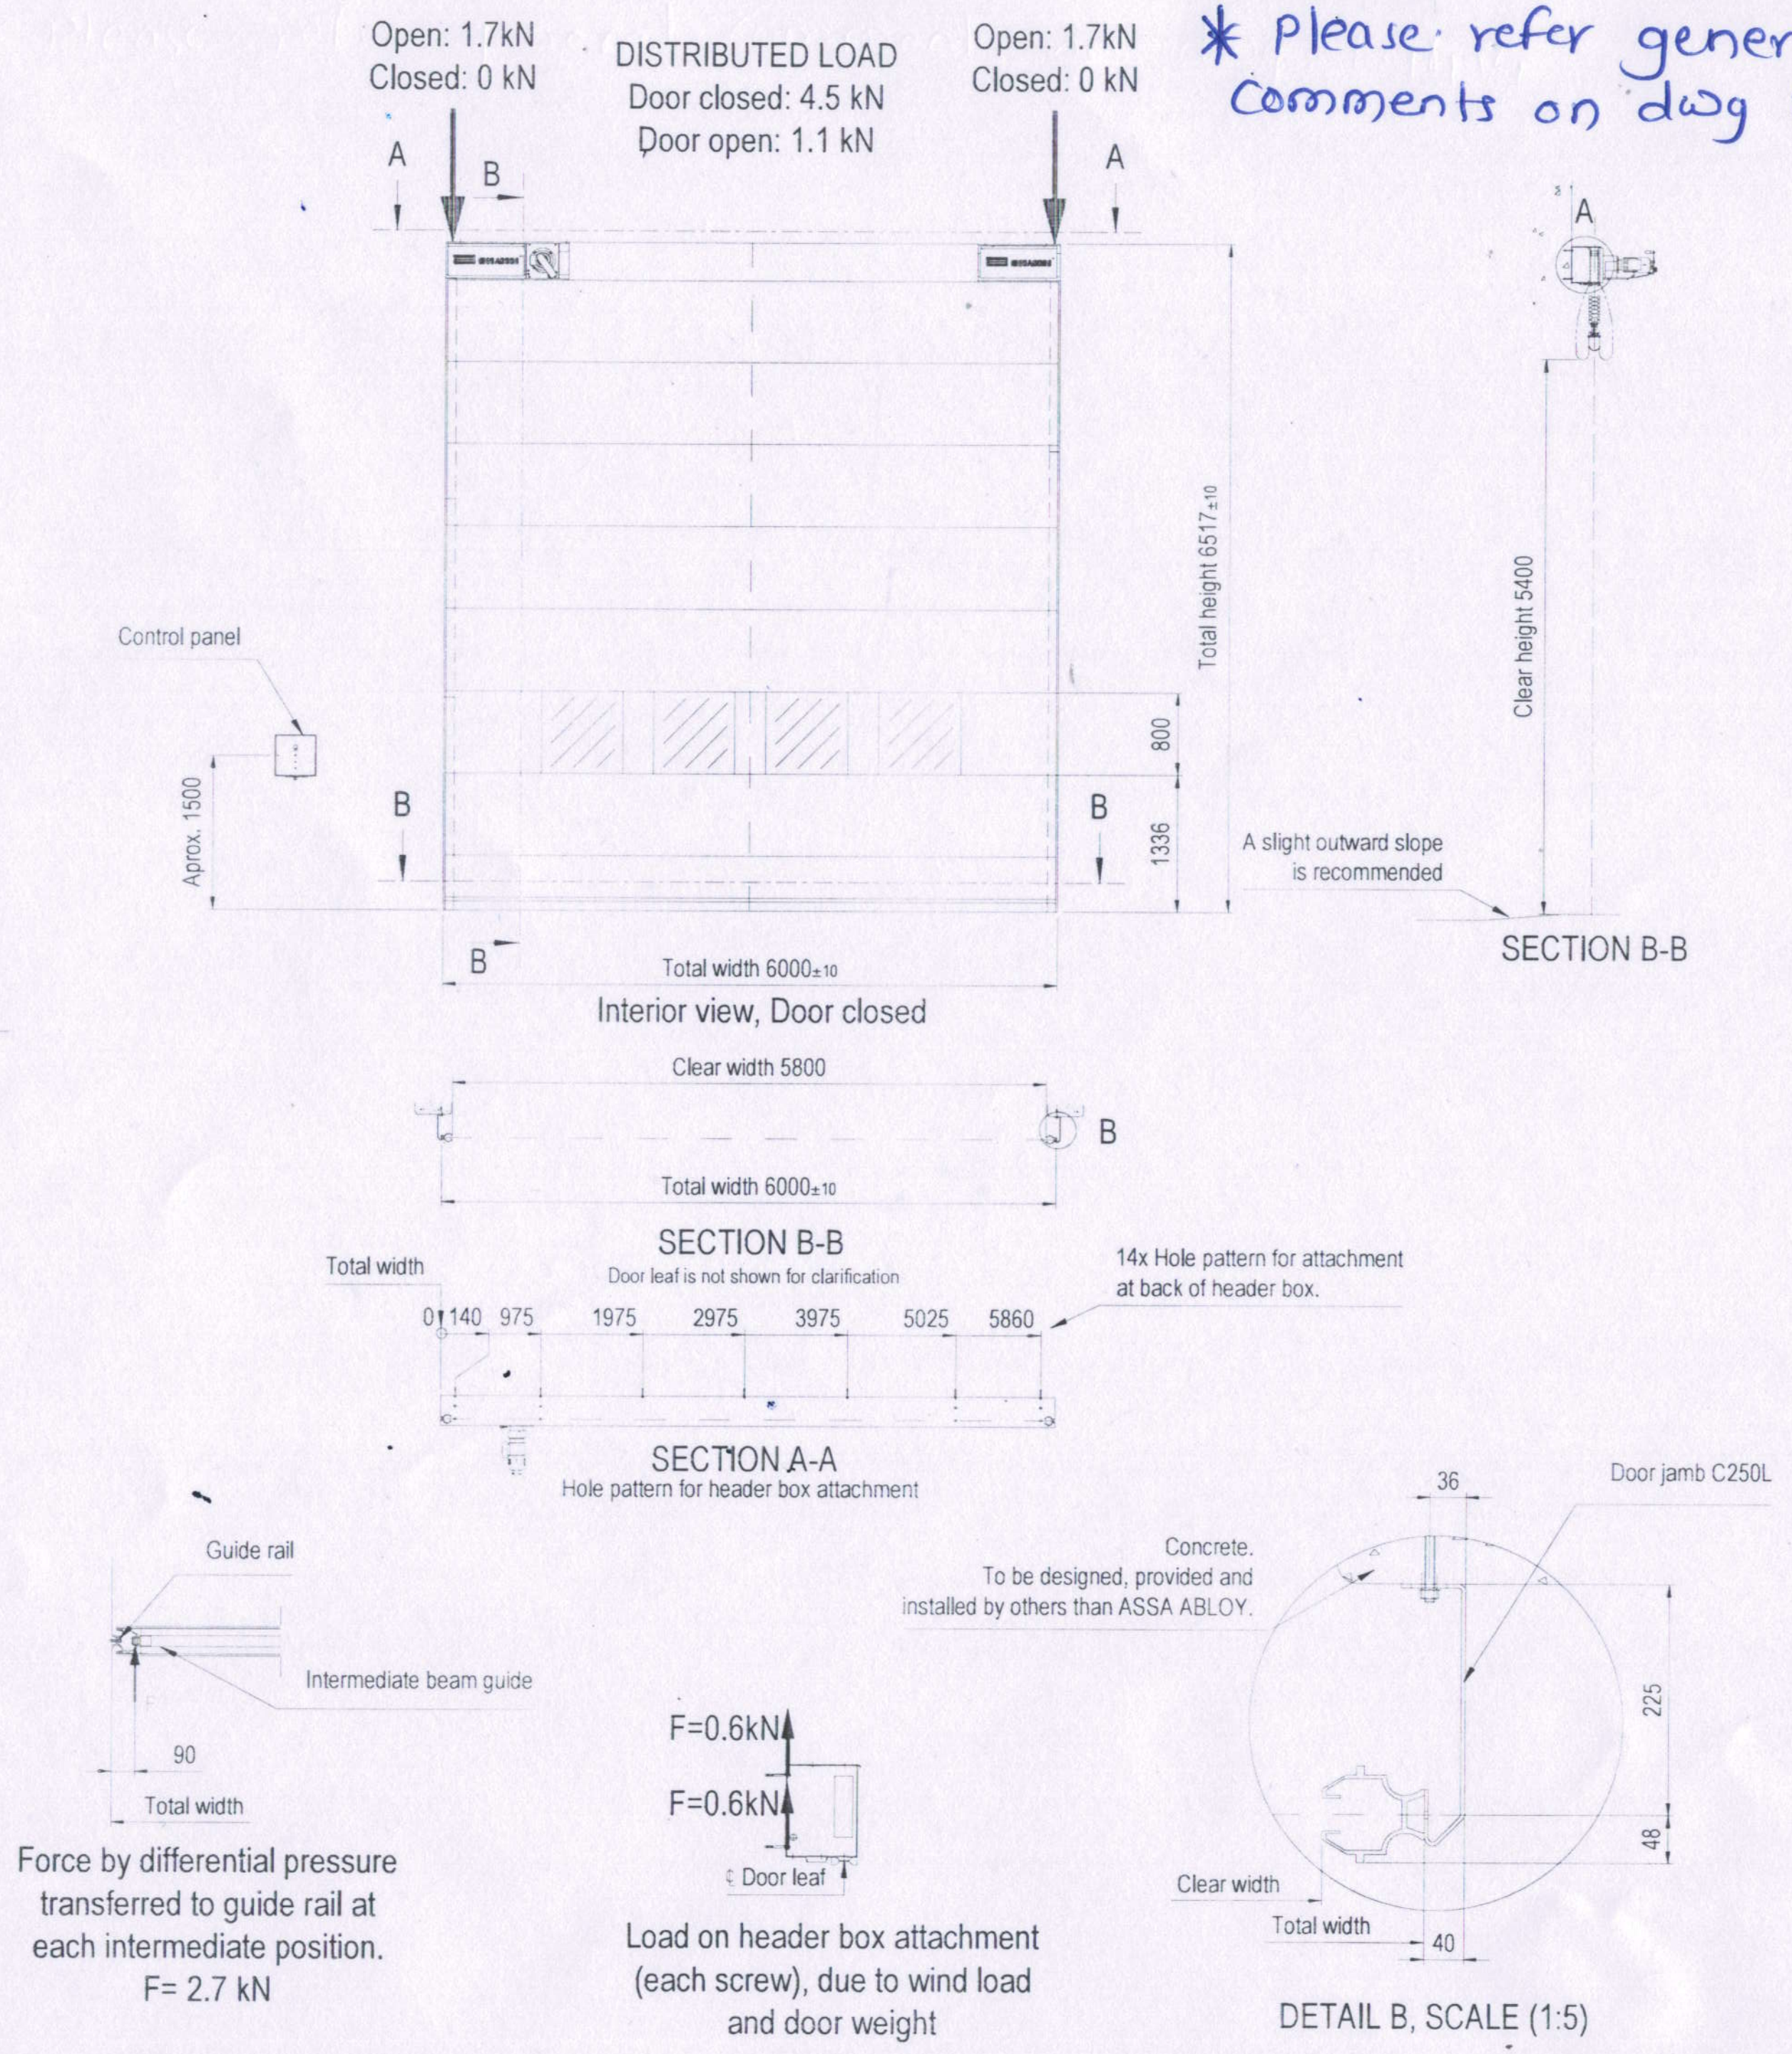

NOT INCLUDED IN DOOR SUPPLY:
1. Design and supply of all door supporting structural components.
2. Design and supply of all closure between door and adjacent steel.
3. Door jambs adjustable for overall door width and true to plumb.
4. Paint job after completed door installation.
5. Any frameworks being provided by ASSA ABLOY will be clearly indicated as "by ASSA ABLOY".

REQUIREMENTS ON BUILDING:
6. Door head support must be straight within 1/600 of span in the in/out direction and free from protrusions of any kind.
7. For a single door leaf, door head support should be horizontal and straight within 1/600 of span at distributed full door load.
8. Door side jambs must be smooth, straight and parallel, out of plumb must not exceed 2mm/m (total deviation at full length 5 mm) in any direction.
9. Any footings at bottom of jamb columns must not interfere with installation of guide rails at floor level.
10. At time of installation, finished floor, free from obstructions, out to a distance of 2 m on each side of door centreline must be available.
11. Header box must be accessible from both sides during installation.

DOOR PROPERTIES:
12. The door is designed to withstand a differential pressure of 1.15kPa.
13. Metal trim: motor side
14. Side profiles
15. Fabric colour: Please specify

ELECTRICAL:
14. One main control panel provided of PLC type.
15. Audible and visual alarm
16. Safety edge
17. Back-up power switch
18. Approx. size of main control panel: WxHxD (500mm x 600mmx250 mm).
19. Power: 1.4kW
20. Nom. current: 3.3A
21. (max. allowed voltage drop at start: 5%)

BELT HOIST UNITS:
Sk 773.1-90S/4 Z dual brake

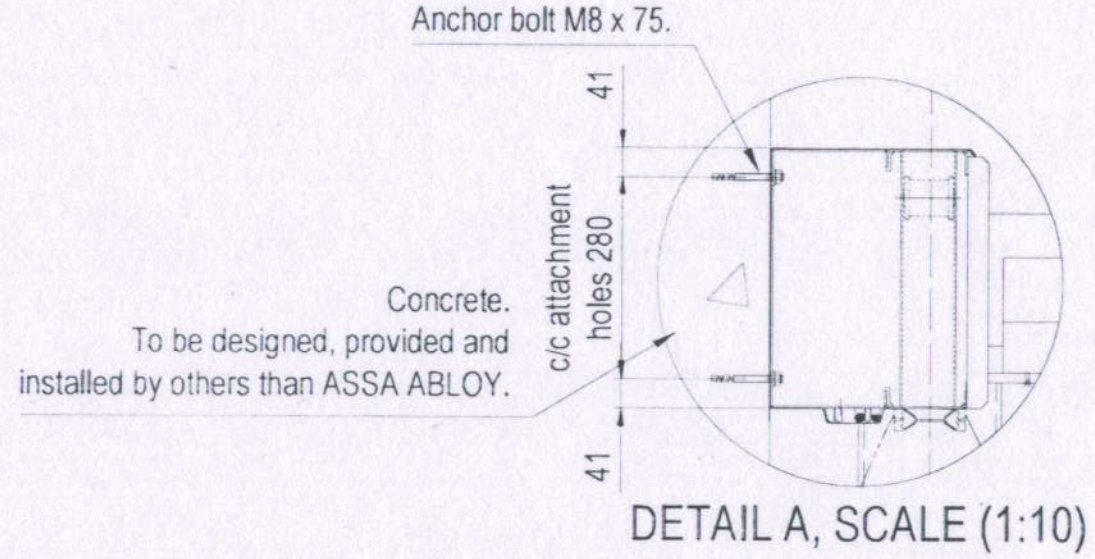
Anchor bolt M8 x 75.
41
c/c attachment
holes 280
41
Concrete.
To be designed, provided and
installed by others than ASSA ABLOY.

DETAIL A, SCALE (1:10)

Building: ARFF4

DESIGNED KMÖ	SIZE A2	SCALE 1:50	Delhi Fire Station India Megadoor 5800 x 5400 Sales Interface
CODE 22246-22249	If not otherwise stated Tolerances ISO 2768-m EN ISO 13920-B		
ITEM NO			
DATE 2021-07-22	Cutting class ISO 9013-442 Weld class ISO 5817-C		DRAWING NO 74148
ASSA ABLOY	Surface finish Smooth raw surface		REVISION A

PLOT DATE