

NOTES:

1. PIT FOR GOODS LIFT SHOULD BE DIAGONALLY WITHIN 3-5 MM.
2. BASE OF THE PIT SHOULD BE IN WATER LEVEL& RIGHT ANGLE TO SIDE VERTICAL WALLS.
3. PROPER ARRANGEMENT FOR ROUTING HOSES & CABLE SHOULD BE MADE DEPENDING ON SITE CONDITIONS& POWERPACK POSITION.
4. COVERING REQUIRED FOR HOSES,CABLES& PANEL AND RELATED CIVIL WORK IS IN CLIENT SCOPE.
5. PROPER DRAINAGE SYSTEM SHOULD BE PROVIDED FOR THE PIT.

ELECTRICAL REQUIREMENT
1. SUPPLY REQUIRED
3Ø, 4 WIRE + EARTHING,415V [R,Y,B,N,E]
SUITABLE FOR 3HP MOTOR

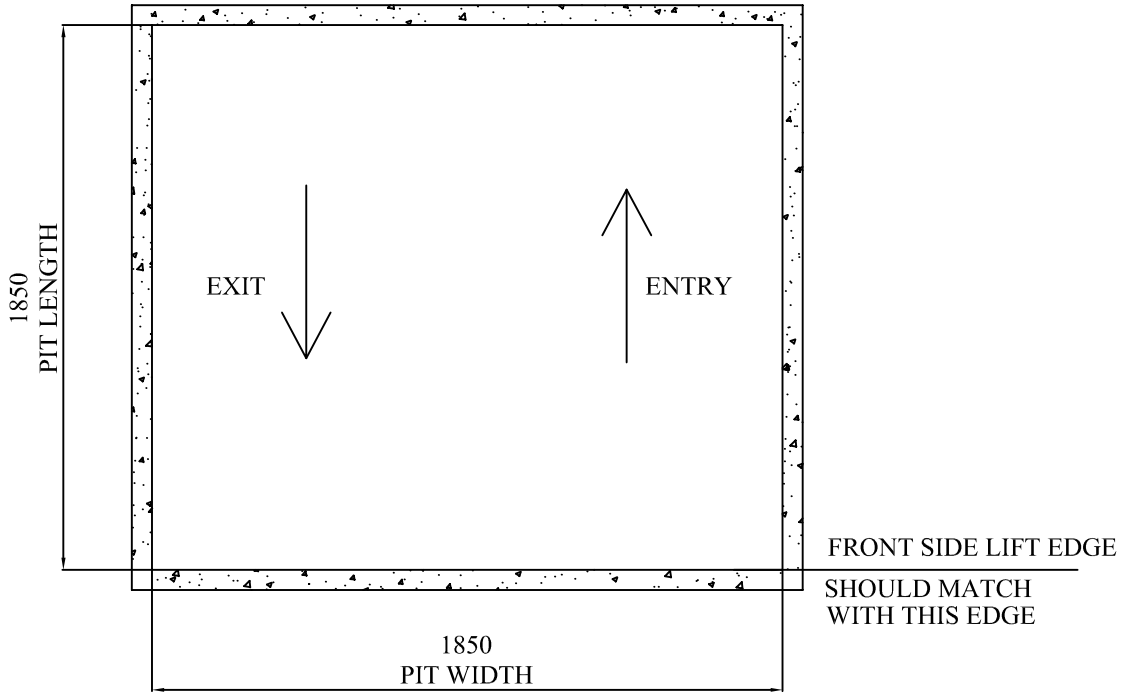

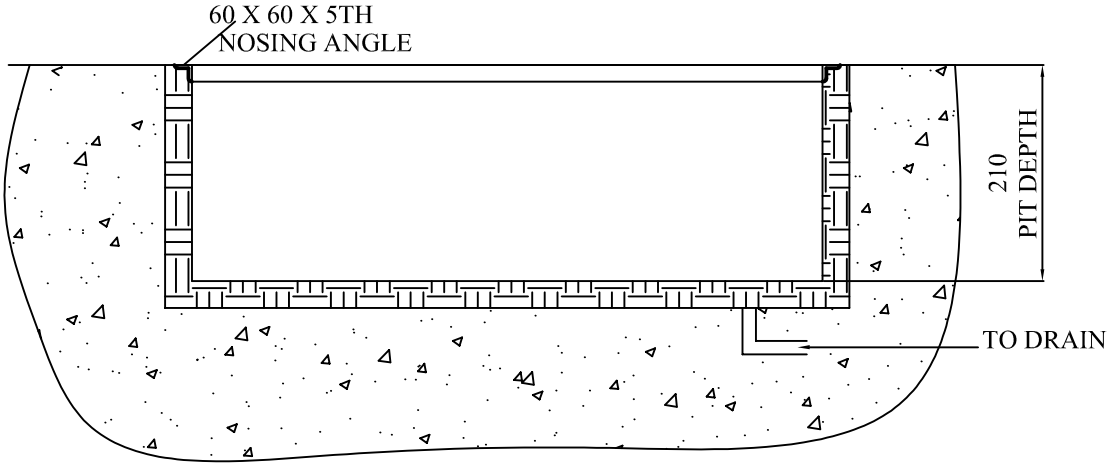

ALL DIMENSIONS ARE IN MM

CLIENT:- PURATOS FOOD INGREDIENTS INDIA PVT LTD.				
PRODUCT:- ELECTRO HYDRAULIC GOODS LIFT				
CAPACITY :- 1500KGS				
DWG NO.:- NVA/GOODSLIFT/PURATOS/0914.				
PROJECATION:-	SCALE:- NTS	DATE	SIGN	
	DRAWN	27.09.2014	A.KUMAR	
	CHECKED	27.09.2014		REV
	APPROVED	27.09.2014	R.KULKARNI	0

NIHVA TECHNOLOGIES PVT LTD.
PUNE - 411019
TEL:- 020-66304033/8551095333.
Email:- projects@nihva.com

THIS PRINT IS THE PROPERTY OF NIHVA TECHNOLOGIES PVT LTD.
RETURNED UPON REQUSETTHIS PART MUST NOT BE SOLD TO ANY OTHER CONCERN.

SIZE
A4
SHEET