

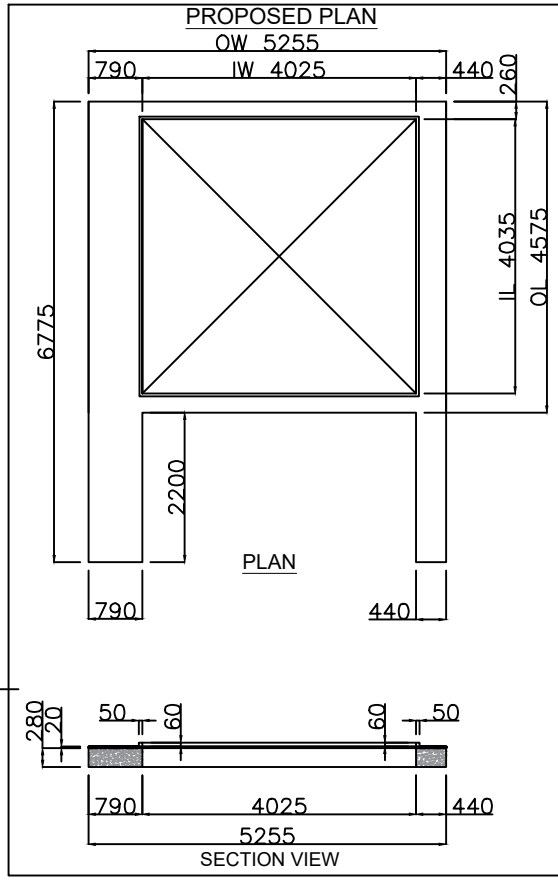


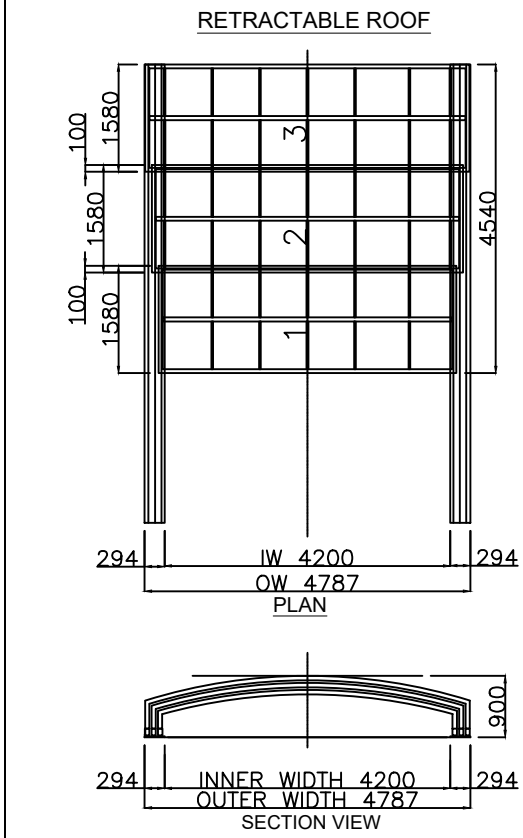

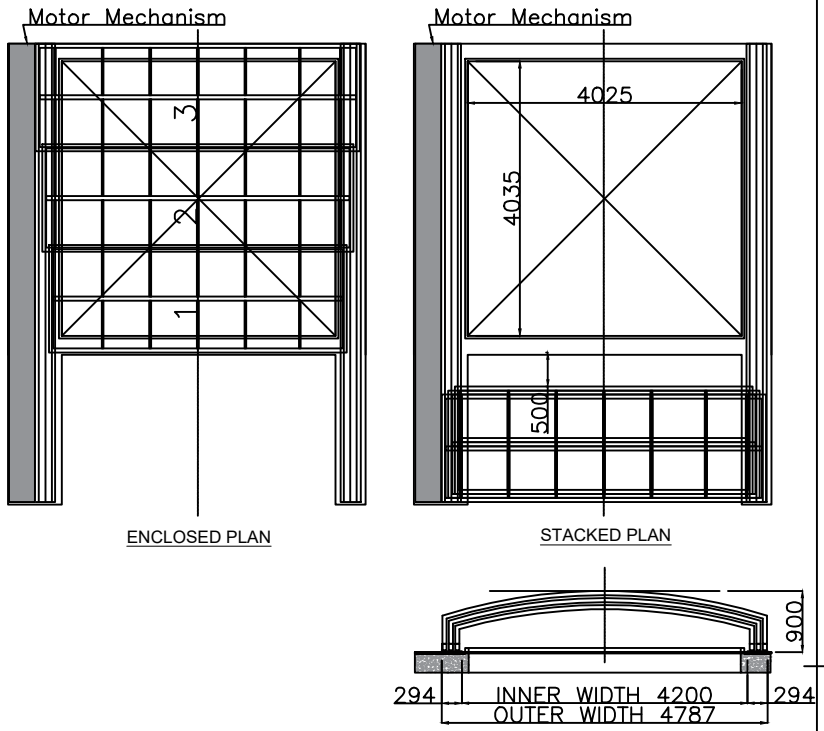

1. THE STRUCTURE AROUND THE CUT OUT SHOULD BE OF CONCRETE FOR FOR PROPER FASTENING OF ROOF.
2. INNER PROJECTION OF 50X60MM REQUIRED AS A SINGLE STRUCTURE WITHOUT ANY JOINT TO AVOID WATER SEEPAGE INSIDE.
3. TOP SURFACE SHOULD BE OF GRANITE 20MM FOR SMOOTH FUNCTIONING OF ROOF.
4. ROOF EXTENSION IS SHOWN FOR ONLY REFERENCE. IT CAN BE MODIFIED AS PER THE WORK UNDERTAKEN.
5. GRADIENT OF 50MM NEED TO BE PROVIDED ALONG THE OUTER LENGTH TO AVOID WATER STAGNANCY IN GUIDE RAIL.

This drawing & design is the property of NIHVA TECHNOLOGIES. Not to be sold or copied to any other concern.

TITLE
GA DRAWING-RR

NIHVA
NIHVA TECHNOLOGIES PVT. LTD.

NIHVA TECHNOLOGIES PVT. LTD. PUNE
Tel : 020 66304033
Email:- info@nihva.com
Website:- www.nihva.com

	NAME	SIGN	DATE
DRAWN	G.J.		23.02.21
CHECK	A.K.		23.02.21
APPRD.	V.T.		23.02.21

If any queries contact : projectsautomation@nihva.com	NIHVA\20-21\0163	REV- 0
ALL DIMENSION ARE IN mm	SCALE: NTS	SHEET: 01 OF 01

CLIENT - MR. PHARANDE
LOCATION - NANDED, MH
PRODUCT - RETRACTABLE ROOF