NIHVA

NIHVA Technologies Pvt. Ltd.

# Wind load Analysis For Rolling Shutter

as per Indian Standards IS 875 Part III 1987

Project: LM WIND POWER
Client: LM WIND POWER
Date: 22/05/2018
Height: 7000 mm
Width: 7000 mm
Slat Size: 95 mm
Slat Width: 19 mm

# Wind Load Analysis as per IS

Design Wind Speed Vz= Vb * k1 * k2 * k3

where Vb = Basic Wind Speed in m / s.

k1 = Risk Coefficient (clause 5.) = 1

k2 = THS Factor (clause 5.3 = 1

k3 = Topography Factor (clause 5.) = 1

Vb = Maximum = 45 m/s

Wind Speed Vz = 45 m/s

Terrain Category: 2

(Open terrain with well-scattered obstructions having heights between 1.5m to 10m)

Class of Building: A( Structures having max. dimensions is less then 20m)

k1, k2 & k3 constants are derived from IS-875, based on location height of structure & geographical factor. These factors are required for tall structures, Where we need to consider varying pressure condition.



NIHVA
NIHVA TECHNOLOGIES PVT. LTD.

# Wind Load Analysis as per IS 875 - III

Design wind pressure = $0.6 \times V_z^2$

Where,

Pz = Design wind pressure

Vz = Design wind velocity

Wind Pressure, Pz = 0.6 x (45)2

Wind Pressure, Pz = 1215 N/m^2

Pz = 0.001215 N/mm^2




NIHVA
NIHVA TECHNOLOGIES PVT. LTD.

Wind Load Analysis as per IS 875 - III

Case I - Simply supported beam with uniform pressu

1215 N/m^2

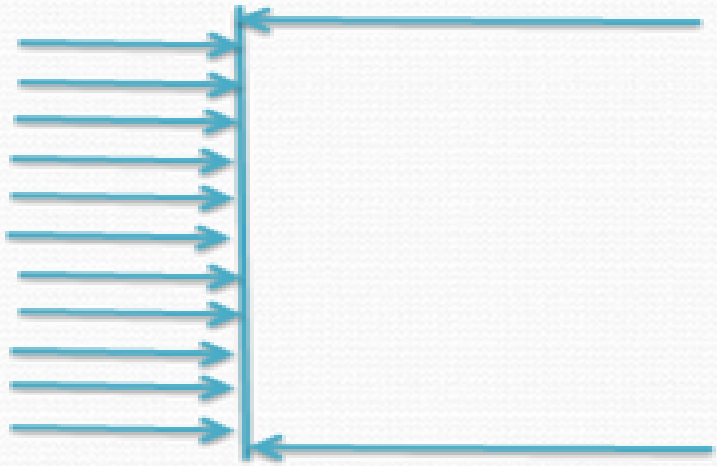



NIHVA
NIHVA TECHNOLOGIES PVT. LTD.


Contents:


A)Bending Moment

B)Deflection

C)Maximum Stress

D)Side guides for curtain

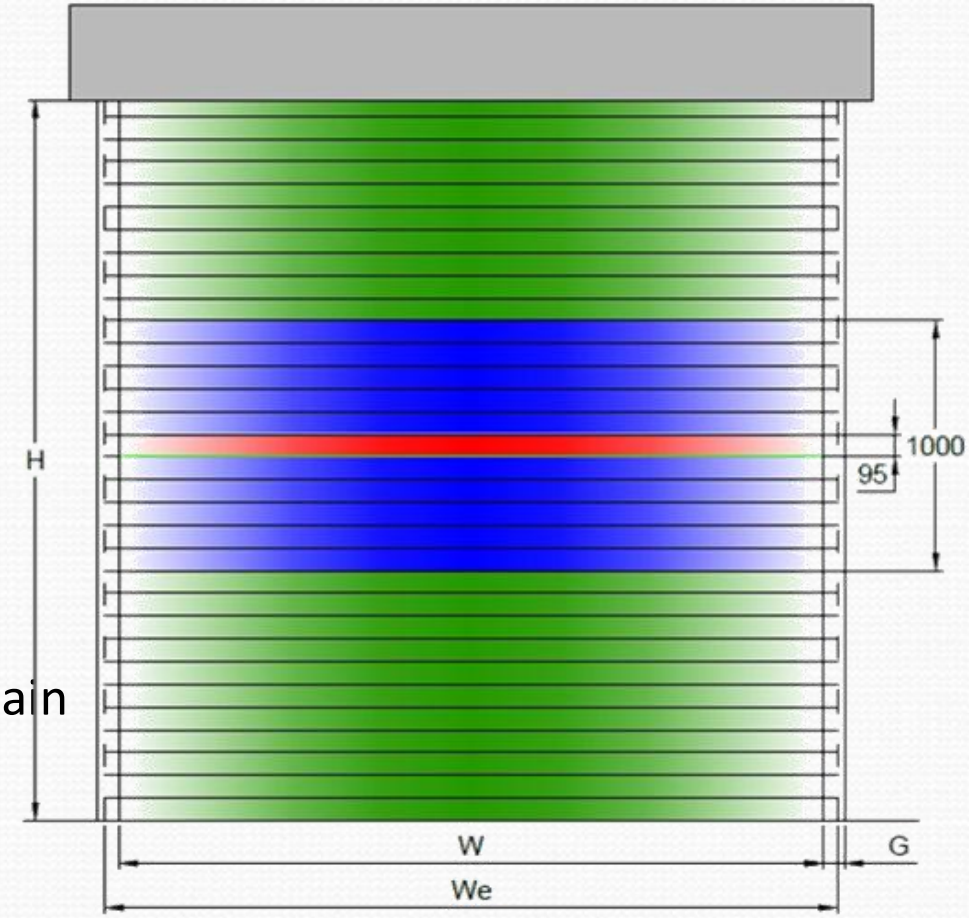

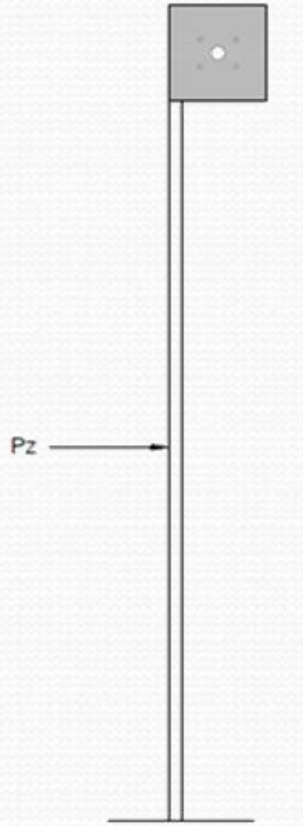
Pz- Design pressure
W- Width of shutter
We- Effective width of shutter
H- Height of shutter
G- Width of guide



NIHVA
NIHVA TECHNOLOGIES PVT. LTD.

## A)Bending Moment


Door is simply supported on two opposite sides

Max B.M. = Design Pressure x $We^2/8$

## B)Deflection

Max. deflection will be at the centre

D max = ( 5x M x We^2 ) / (48 x E x I)

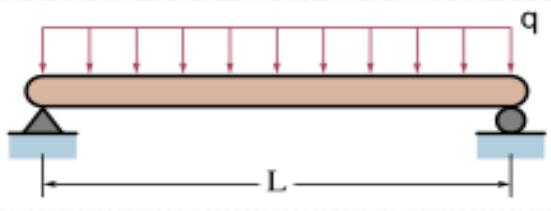


Where ,

M = Bending Moment of 75mm Curved type

E = Modules of Elasticity for CRS = 210GPa

I = Moment of Inertia of slat (b x d3 /12)

We= Effective Width of Shutter

w = Clear Width of shutter



NIHVA
NIHVA TECHNOLOGIES PVT. LTD.

## C)Max Stress

Max. Stress= $W_e$^2xpressure on stripx1000xC/12x I

Where,

C= centre of gravity ,I= moment of inertia ,We= effective width

Permissible Stress =248/FOS

=248/1.5

= 165 N/sq.mm

## D)Side Guides for Curtain panel

Side Guides required = w/60

Where,

w= width of shutter



NIHVA
NIHVA TECHNOLOGIES PVT. LTD.

Design calculations for shutter of
Size: 7000mm(w) x 7000mm(H)



NIHVA
NIHVA TECHNOLOGIES PVT. LTD.

# 1. Wind Analysis for rolling shutter of size 7000mm(w) x 7000mm(h)

ØDesign Wind Speed Vz= Vb * k1 * k2 * k3

where,

Vb = Basic Wind Speed in m / s.


k1 = Risk Coefficient (clause 5.4.1) = 1

k2 = THS Factor (clause 5.3.2) = 1

k3 = Topography Factor (clause 5.3.3) = 1

Vb = Maximum = 45

wind Speed Vz = 45 m/s

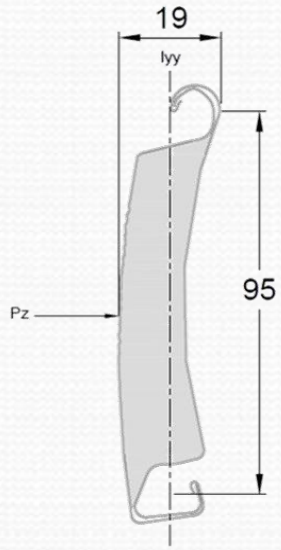


(of 1 meter slat)

Design wind pressure = 0.6x 45x45= 1215 N/m2

Bending Moment $M_1$ = ((Design pressure x Width$^2$)/8

= 0.001215 x 7000 x 7000 / 8

= 7441.88 N-mm

Bending Moment M = $M_1$x0.095m (Moment of 95mm slat)

= 7441.875 x 95

= 706.98 N-mm



NIHVA TECHNOLOGIES PVT. LTD.

Ø Assuming thickness of slat 0.5 mm & minimum width as 19mm & depth as 95mm.

(From CAD DATA) I= 8450 mm^4

E= modulus of elasticity for CRS= 210 GPA

= 210000 N/mm^2

Max. deflection = 5 x 7441.88 x 7000 x 7000 / ( 48 x 210000 x 8450 )

= 21.41 mm

Permissible deflection = 7000/250

= 28 mm

Deflection is within limit.

Max. stress = = 706.98 x (19 / 2)/ 8450

= 0.79 N/mm^2

Permissible stress = (248 N/mm2) /1.5

= 165 N/mm^2

Hence, design is Safe on conditions.

Guide side required = 7000/60 = 116.67

Hence we are using 150mm guide.



NIHVA
NIHVA TECHNOLOGIES PVT. LTD.

Thank You



NIHVA
NIHVA TECHNOLOGIES PVT. LTD.