
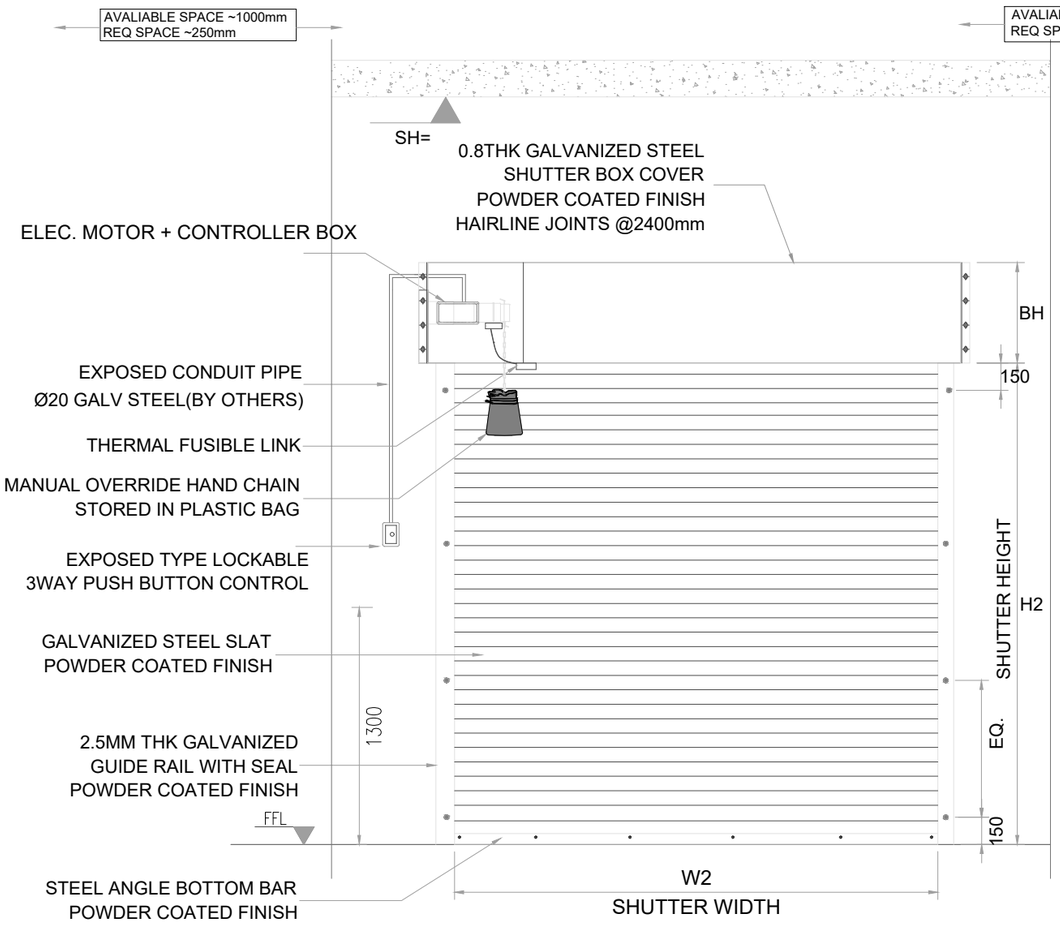


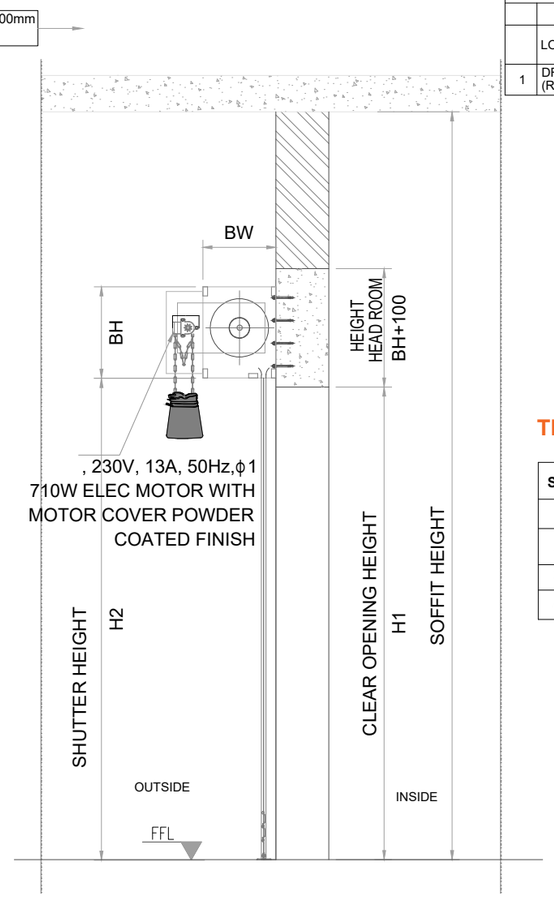


(ATEX ZONE 1)											
				OPENING SIZE		SHUTTER SIZE		HEAD BOX SIZE		MOTOR LOCATION	SHUTTER FINISH
	LOCATION	MOUNTING	QTY	W1	H1	W2	H2	BW	BH		
1	DRUM STORE (RS2)	OUTSIDE	01	2700	3500	2750	3550	500	600	LHS	EXPLOSION PROOF ELECTRICAL SYSTEM AS PER ZONE 1


TECHNICAL SPECIFICATION :


SR.	SPECIFICATIONS	DETAILS
1	OPERATING MODE	MOTORISED
2	CERTIFICATION TYPE	BS EN1634-1 2014 + A1 : 2018
3	FIRE RATING HRS	2 HOUR FIRE RATED FERCO MOTORISED ROLLING SHUTTER
4	RAL COLOUR	RAL 3020

MAINTAIN TOP DISTANCE OF > 600mm

WE REQ MAINTENANCE SPACE



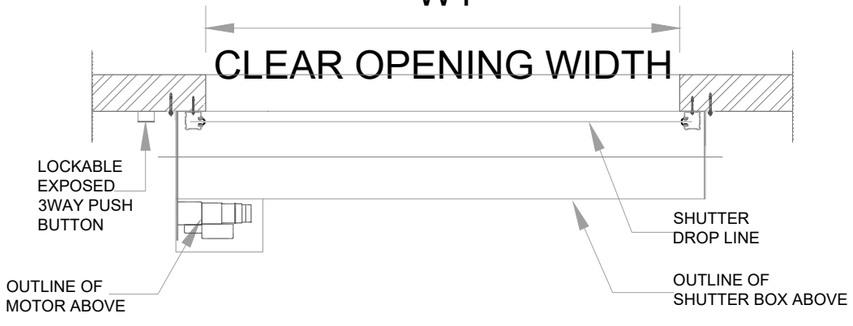

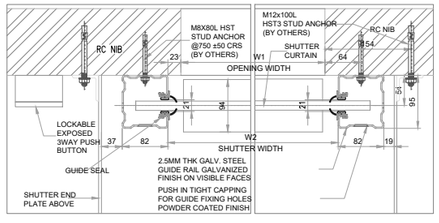

NOTE :-

1. All DIMENSIONS ARE IN MM.

This drawing & designing is the property of NIHVA TECHNOLOGIES. Not be sold or copy to any other concern.

TITLE	DOOR AUTOMATION		NIHVA TECHNOLOGY PVT. LTD. PUNE
	SIGN	DATE	
DRAWN	J.P	26/03/26	CLIENT - SIEGWERK INDIA PVT. LTD.
CHECK	B.S	26/03/26	PROJECT - 2 HRS. FIRE RATED ROLLING SHUTTERS
APPROVAL	V.T	26/03/26	
REV	00		SITE - BHIWADI

NIHVA TECHNOLOGIES PVT. LTD.
Email:- Sales@nihva.com
Website:- www.nihva.com

If any queries contact : Design@nihva.com	SCALE: -	WT:	SHEET: 01 OF 01
ALL DIMENSION ARE IN mm	DWG. NO. : NIHVA/25-26/178		