


SITE PROPOSED LAYOUT

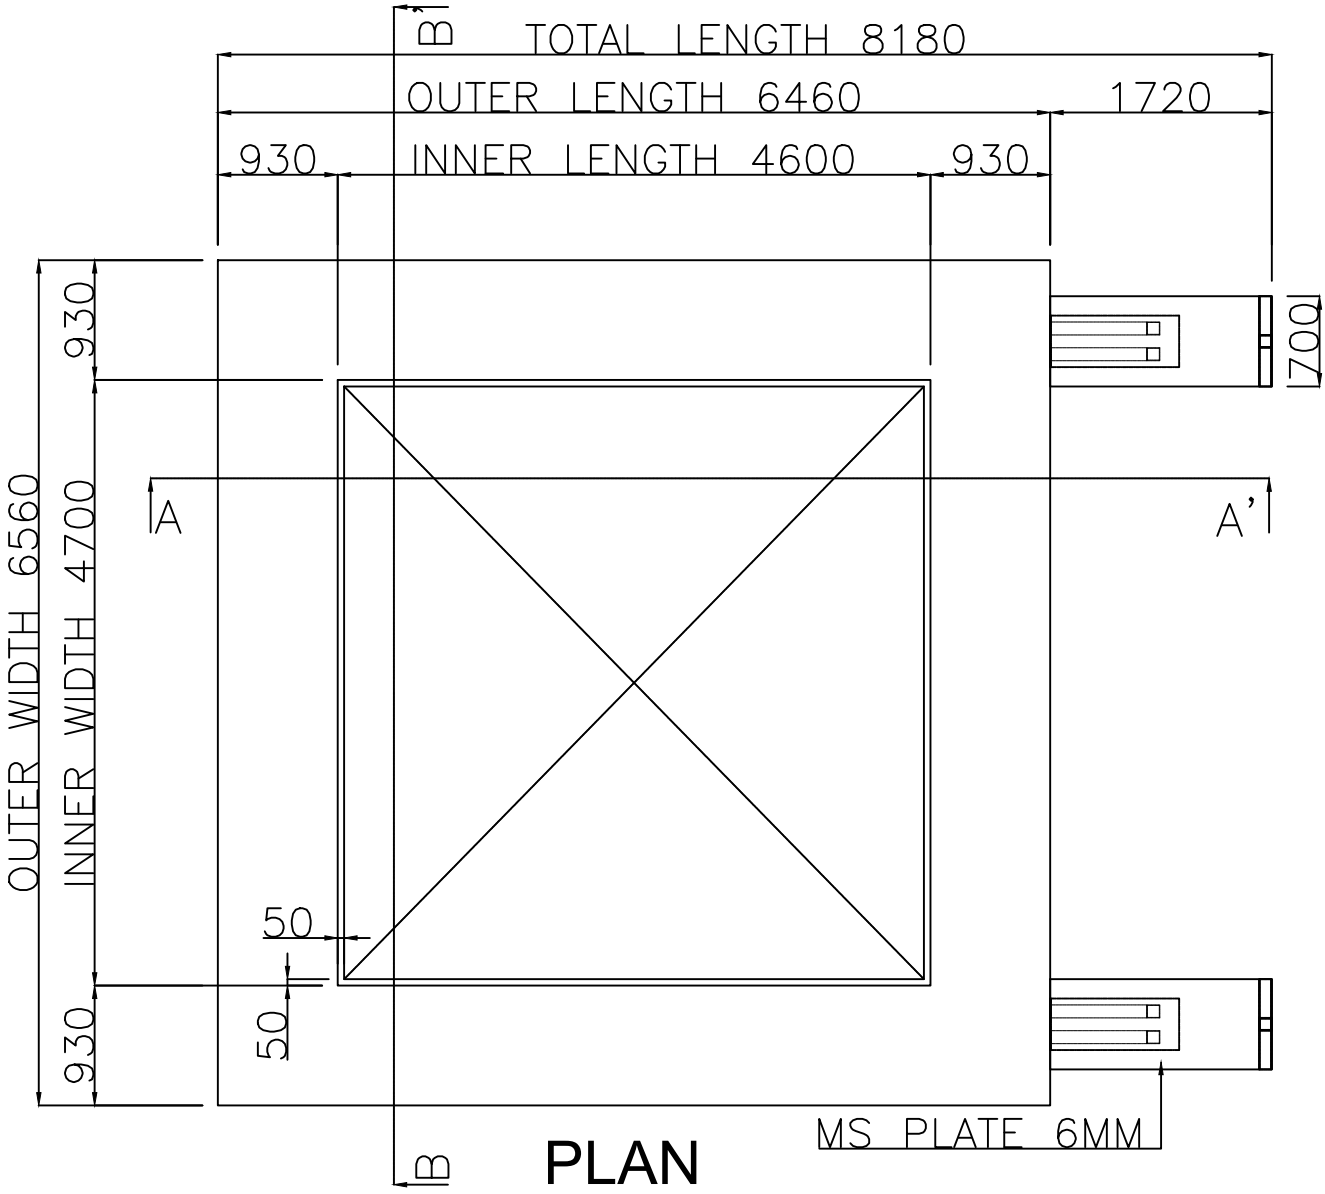

PLAN

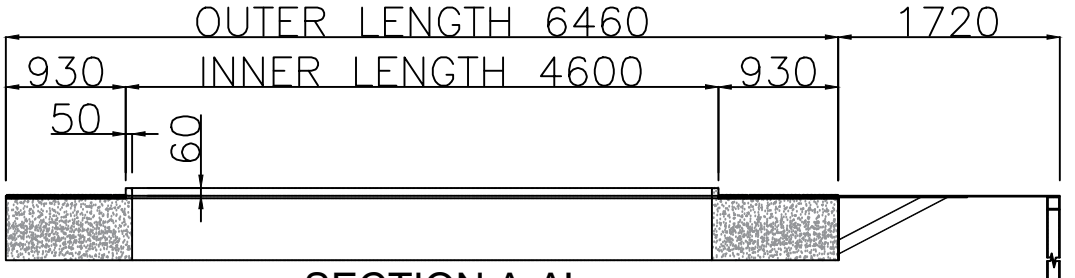

SECTION A-A'

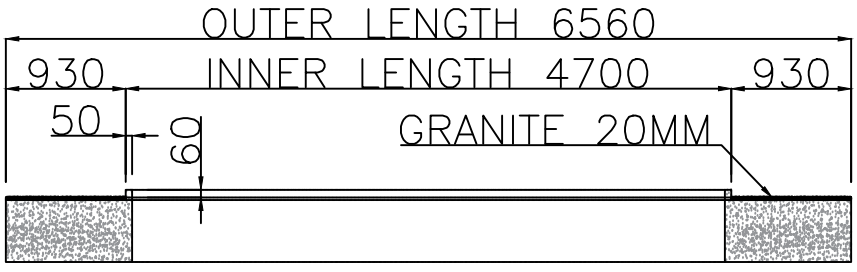

SECTION A-A'

1. THE STRUCTURE AROUND THE CUT OUT SHOULD BE OF CONCRETE FOR FOR PROPER FASTENING OF ROOF.
2. INNER PROJECTION OF 50X60MM REQUIRED AS A SINGLE STRUCTURE WITHOUT ANY JOINT TO AVOID WATER SEEPAGE INSIDE.
3. TOP SURFACE SHOULD BE OF GRANITE FOR SMOOTH FUNCTIONING OF ROOF.
4. ROOF EXTENSION IS SHOWN FOR ONLY REFERENCE. IT CAN BE MODIFIED AS PER THE WORK UNDERTAKEN.
5. 6MM MS PLATE 1720MM x 700MM TO BE PROVIDED WITH REQUIRED SUPPORT RAISED FROM ROOF LEVEL AND VERTICAL SIDE OF PARAPET FOR THE EXTENSION
6. GRADIENT OF 50MM NEED TO BE PROVIDED ALONG THE OUTER LENGTH TO AVOID WATER STAGNANCY IN GUIDE RAIL.