签署 Signature

专业 Discipline
电照 LI
工艺 PR

签署 Signature

专业 Discipline
供电 EL
自控 IC
通信 CO

签署 Signature

专业 Discipline
给水排水 PL
空调通风 HV
工业管道 PP

签署 Signature

专业 Discipline
总图 MP
建筑 AR
结构 ST

编号 No.	FM1621(4h) 1600X2100	名称 Name	无纺布防火卷帘门(4h)
		数量 Quantity	2

立面(洞口尺寸) Elevation(opening size)

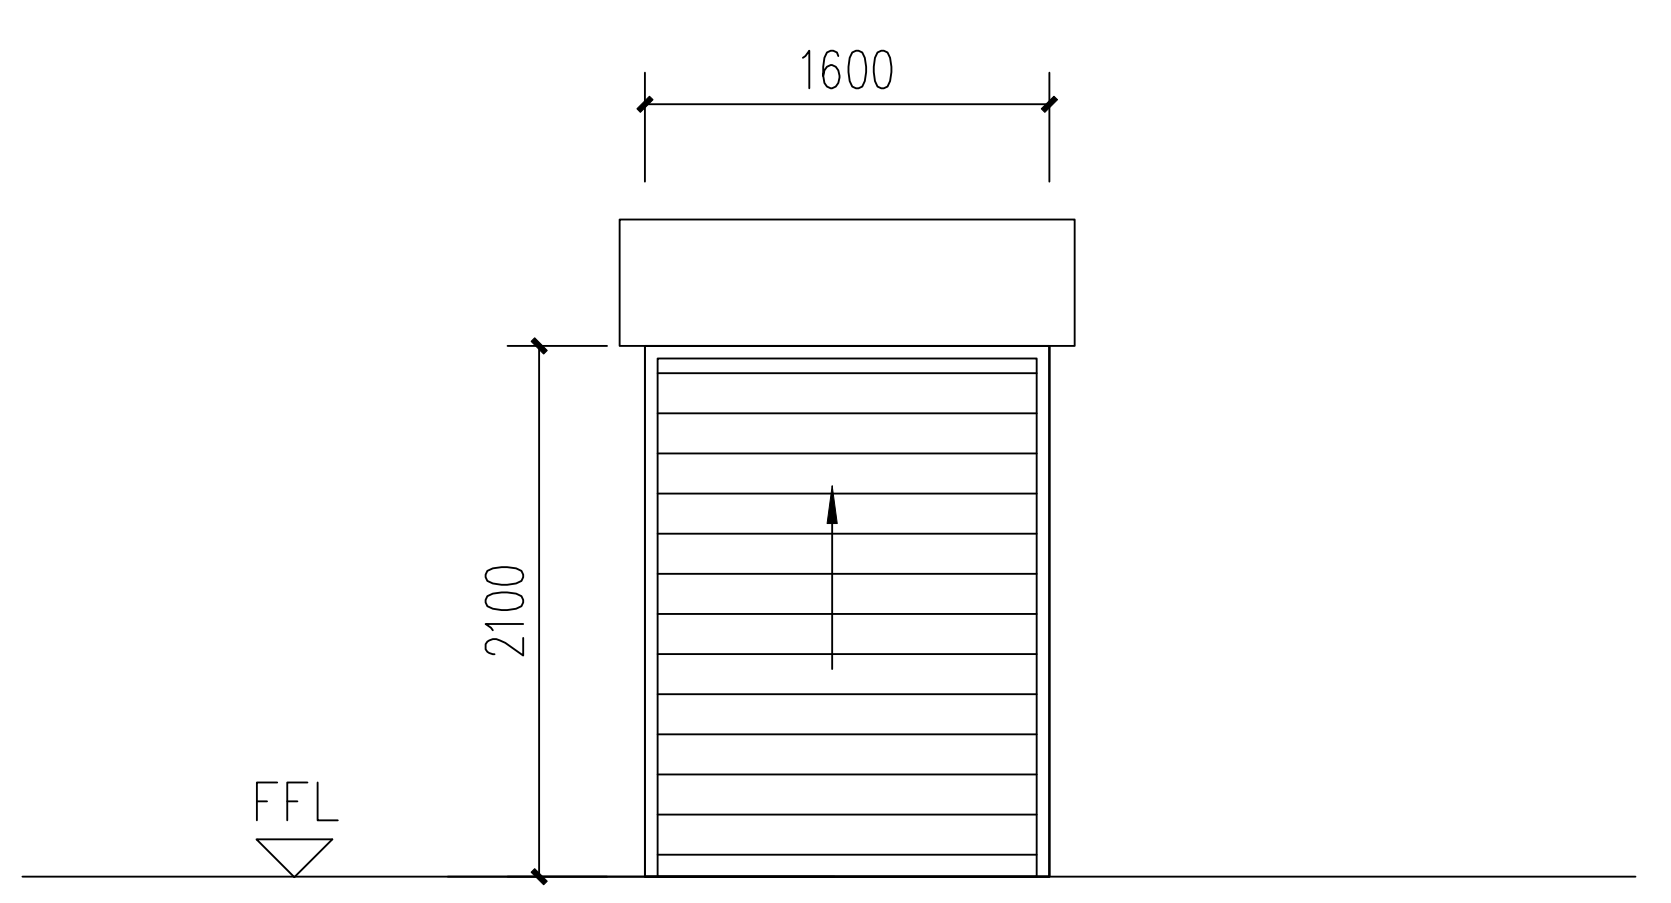

框 Frame	厂家配套 Manufacturer support				
扇 Leaf	厂家配套 Manufacturer support	铰链 Hinge	— -	纱窗 Screen	— —
玻璃 Glass	— —	制动 Closure	电动带手动 Electric plus manual	锁具 Lock	配套 Support
百叶 Louver	— —	门槛 Sill	— —	执手 Handle	— —
备注 Note	耐火时间满足4.0h要求；门及五金须与门窗厂家确认，由专业厂家设计制造及安装 The fire resistance time meets the requirements of 4.0h; the door and hardware must be confirmed by the door and window manufacturers, designed, manufactured and installed by professional manufacturers.				

编号 No.	FM1821(4h) 1800X2100	名称 Name	无纺布防火卷帘门(4h)
		数量 Quantity	1

立面(洞口尺寸) Elevation(opening size)

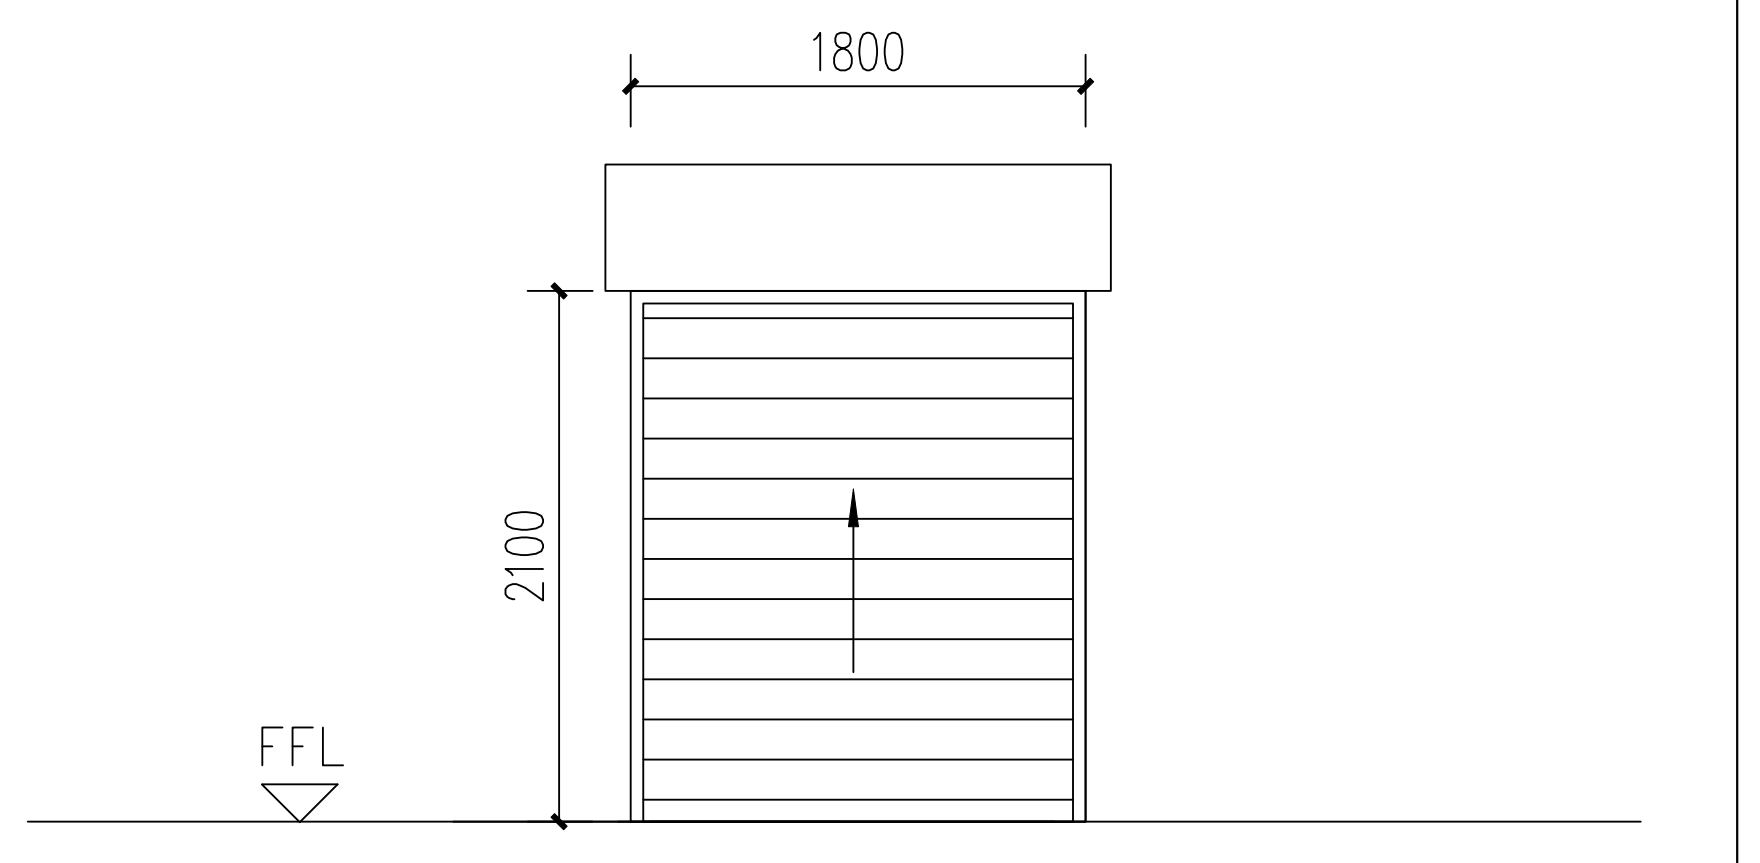

框 Frame	厂家配套 Manufacturer support				
扇 Leaf	厂家配套 Manufacturer support	铰链 Hinge	— -	纱窗 Screen	— —
玻璃 Glass	— —	制动 Closure	电动带手动 Electric plus manual	锁具 Lock	配套 Support
百叶 Louver	— —	门槛 Sill	— —	执手 Handle	— —
备注 Note	耐火时间满足4.0h要求；门及五金须与门窗厂家确认，由专业厂家设计制造及安装 The fire resistance time meets the requirements of 4.0h; the door and hardware must be confirmed by the door and window manufacturers, designed, manufactured and installed by professional manufacturers.				

编号 No.	FM3023(4h) 3000X2300	名称 Name	无纺布防火卷帘门(4h)
		数量 Quantity	1

立面(洞口尺寸) Elevation(opening size)

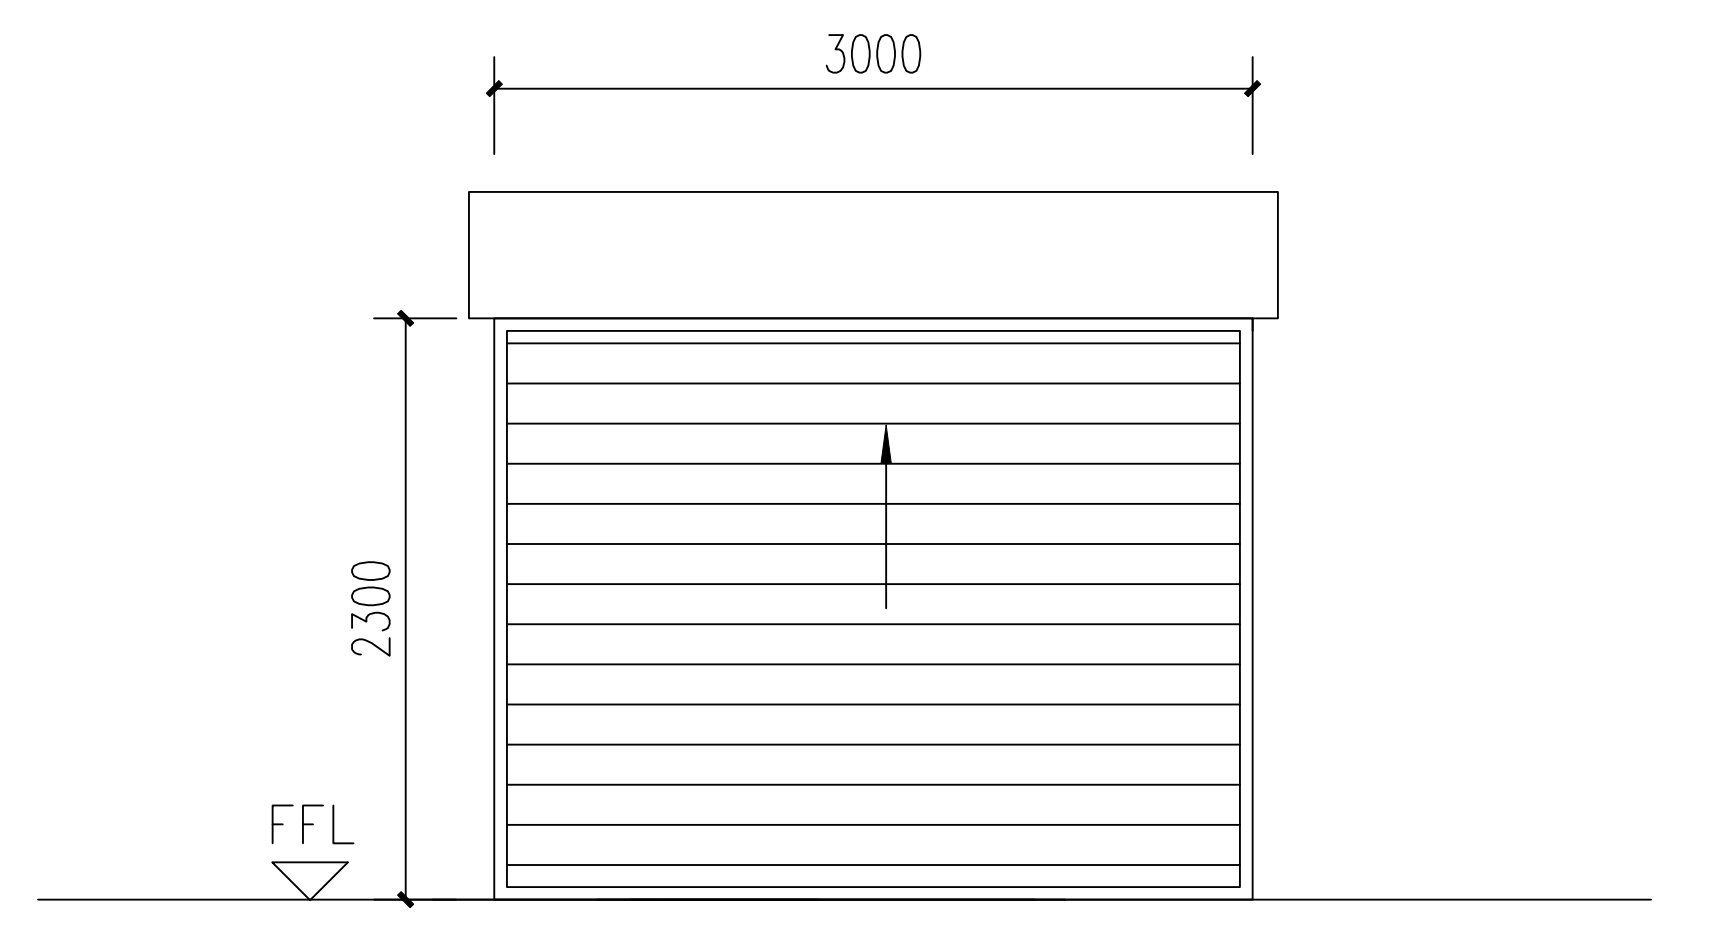

框 Frame	厂家配套 Manufacturer support				
扇 Leaf	厂家配套 Manufacturer support	铰链 Hinge	— -	纱窗 Screen	— —
玻璃 Glass	— —	制动 Closure	电动带手动 Electric plus manual	锁具 Lock	配套 Support
百叶 Louver	— —	门槛 Sill	— —	执手 Handle	— —
备注 Note	耐火时间满足4.0h要求；门及五金须与门窗厂家确认，由专业厂家设计制造及安装 The fire resistance time meets the requirements of 4.0h; the door and hardware must be confirmed by the door and window manufacturers, designed, manufactured and installed by professional manufacturers.				

编号 No.	FM3030(4h) 3000X3000	名称 Name	无纺布防火卷帘门(4h)
		数量 Quantity	1

立面(洞口尺寸) Elevation(opening size)

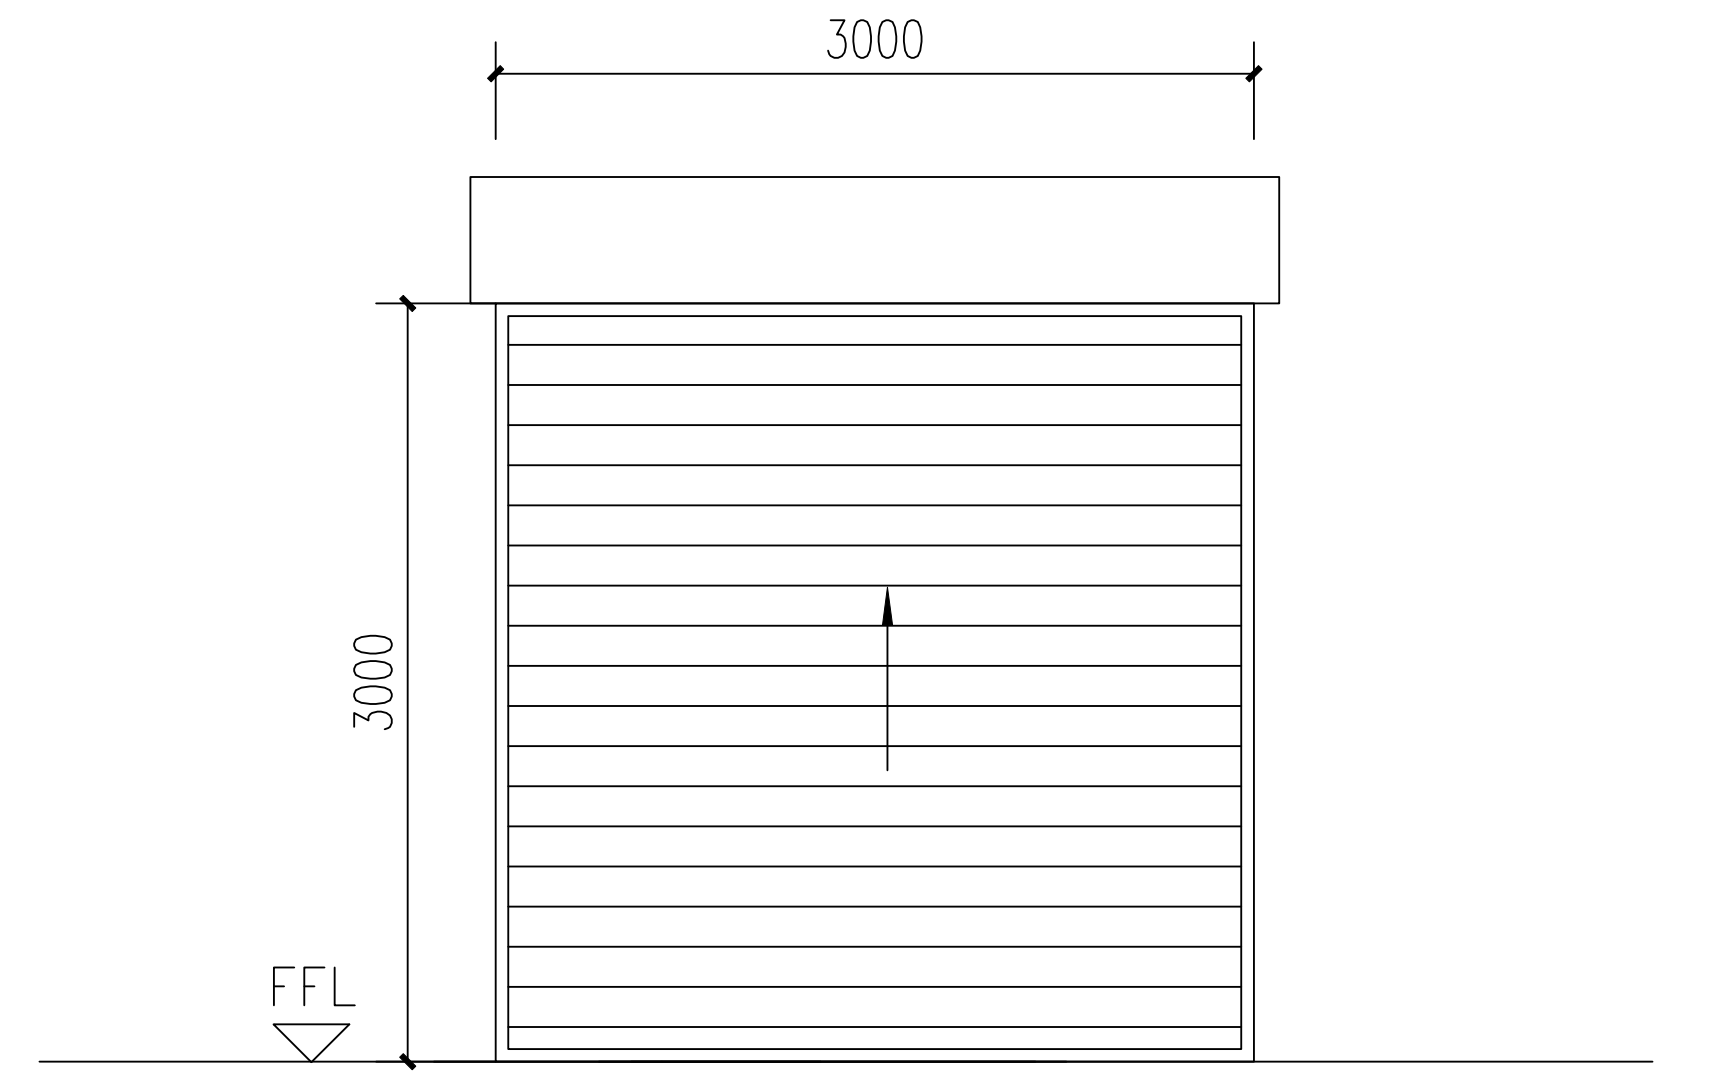

框 Frame	厂家配套 Manufacturer support				
扇 Leaf	厂家配套 Manufacturer support	铰链 Hinge	— -	纱窗 Screen	— —
玻璃 Glass	— —	制动 Closure	电动带手动 Electric plus manual	锁具 Lock	配套 Support
百叶 Louver	— —	门槛 Sill	— —	执手 Handle	— —
备注 Note	耐火时间满足4.0h要求；门及五金须与门窗厂家确认，由专业厂家设计制造及安装 The fire resistance time meets the requirements of 4.0h; the door and hardware must be confirmed by the door and window manufacturers, designed, manufactured and installed by professional manufacturers.				

编号 No.	FM1521(3h) 1500X2100	名称 Name	无纺布防火卷帘门(3h)
		数量 Quantity	1

立面(洞口尺寸) Elevation(opening size)

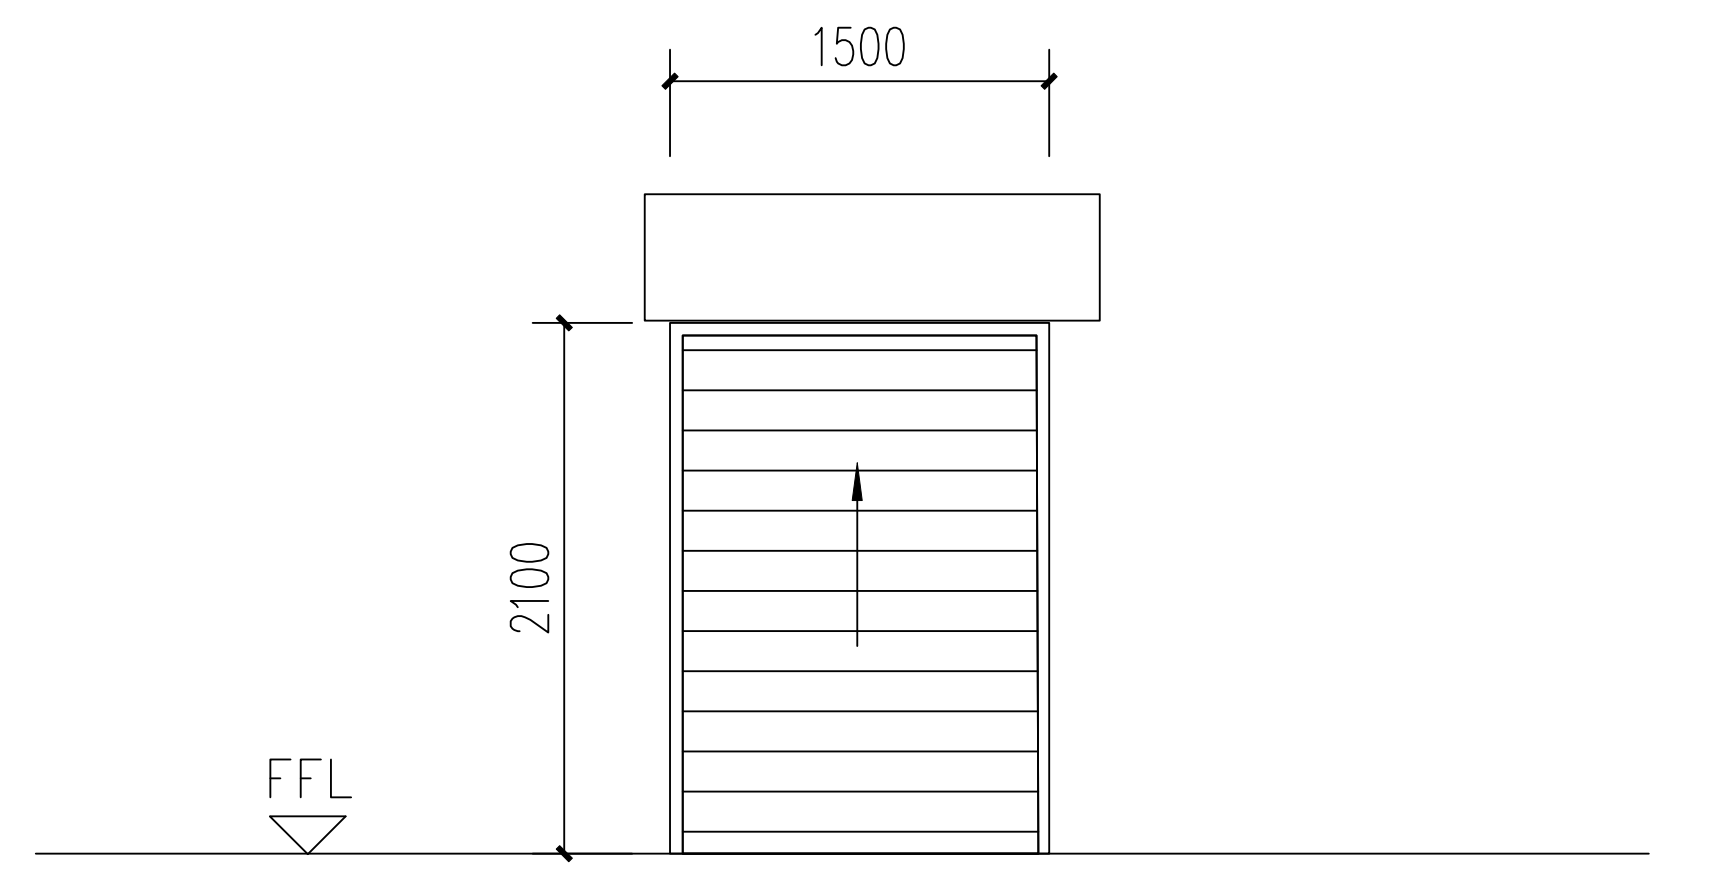

框 Frame	厂家配套 Manufacturer support				
扇 Leaf	厂家配套 Manufacturer support	铰链 Hinge	— -	纱窗 Screen	— —
玻璃 Glass	— —	制动 Closure	电动带手动 Electric plus manual	锁具 Lock	配套 Support
百叶 Louver	— —	门槛 Sill	— —	执手 Handle	— —
备注 Note	耐火时间满足3.0h要求；门及五金须与门窗厂家确认，由专业厂家设计制造及安装 The fire resistance time meets the requirements of 3.0h; the door and hardware must be confirmed by the door and window manufacturers, designed, manufactured and installed by professional manufacturers.				

编号 No.	FM1621(2h) 1600X2100	名称 Name	无纺布防火卷帘门(2h)
		数量 Quantity	1

立面(洞口尺寸) Elevation(opening size)

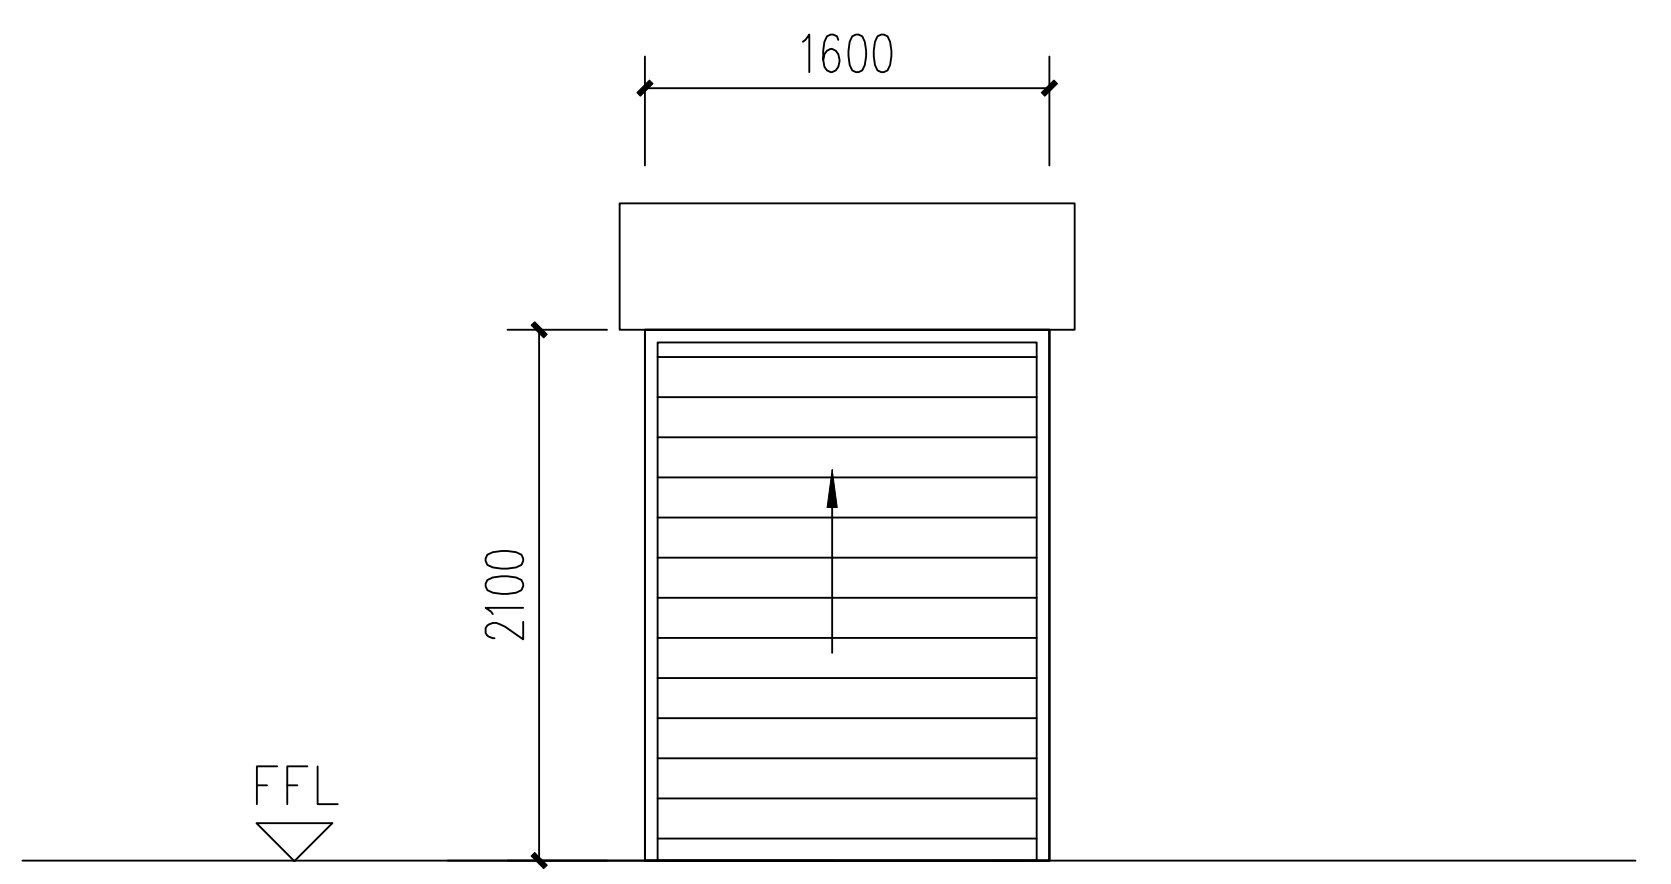

框 Frame	厂家配套 Manufacturer support				
扇 Leaf	厂家配套 Manufacturer support	铰链 Hinge	— -	纱窗 Screen	— —
玻璃 Glass	— —	制动 Closure	电动带手动 Electric plus manual	锁具 Lock	配套 Support
百叶 Louver	— —	门槛 Sill	— —	执手 Handle	— —
备注 Note	耐火时间满足2.0h要求；门及五金须与门窗厂家确认，由专业厂家设计制造及安装 The fire resistance time meets the requirements of 2.0h; the door and hardware must be confirmed by the door and window manufacturers, designed, manufactured and installed by professional manufacturers.				

编号 No.	FM1821(2h) 1800X2100	名称 Name	无纺布防火卷帘门(2h)
		数量 Quantity	1

立面(洞口尺寸) Elevation(opening size)

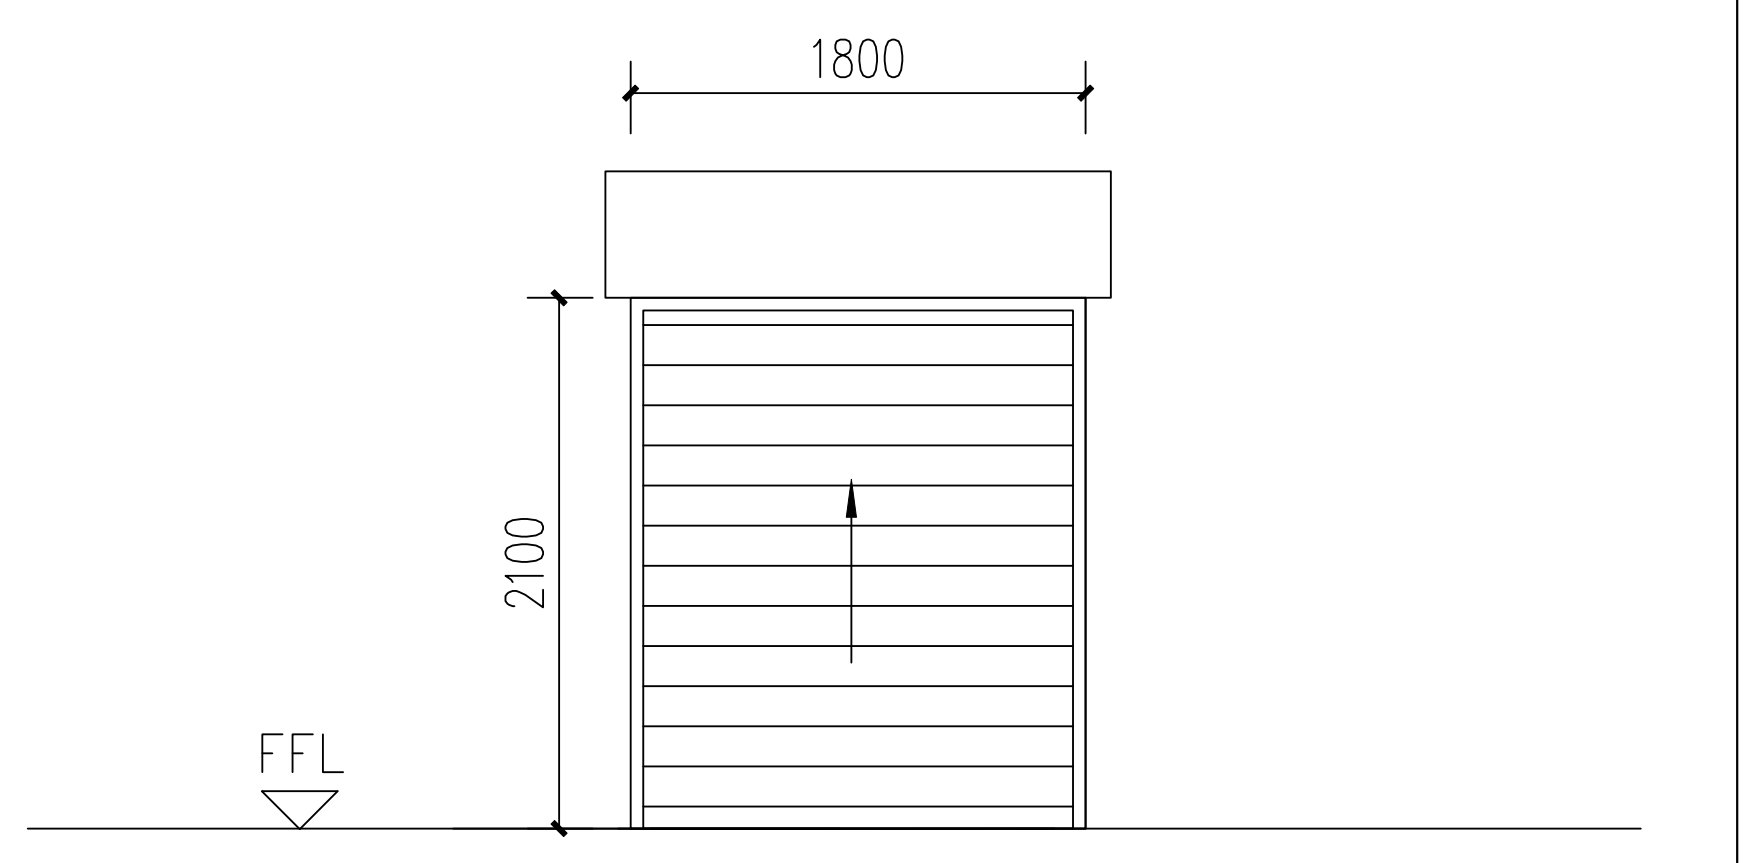

框 Frame	厂家配套 Manufacturer support				
扇 Leaf	厂家配套 Manufacturer support	铰链 Hinge	— -	纱窗 Screen	— —
玻璃 Glass	— —	制动 Closure	电动带手动 Electric plus manual	锁具 Lock	配套 Support
百叶 Louver	— —	门槛 Sill	— —	执手 Handle	— —
备注 Note	耐火时间满足2.0h要求；门及五金须与门窗厂家确认，由专业厂家设计制造及安装 The fire resistance time meets the requirements of 2.0h; the door and hardware must be confirmed by the door and window manufacturers, designed, manufactured and installed by professional manufacturers.				

编号 No.	FM3023(2h) 3000X2300	名称 Name	无纺布防火卷帘门(2h)
		数量 Quantity	1

立面(洞口尺寸) Elevation(opening size)

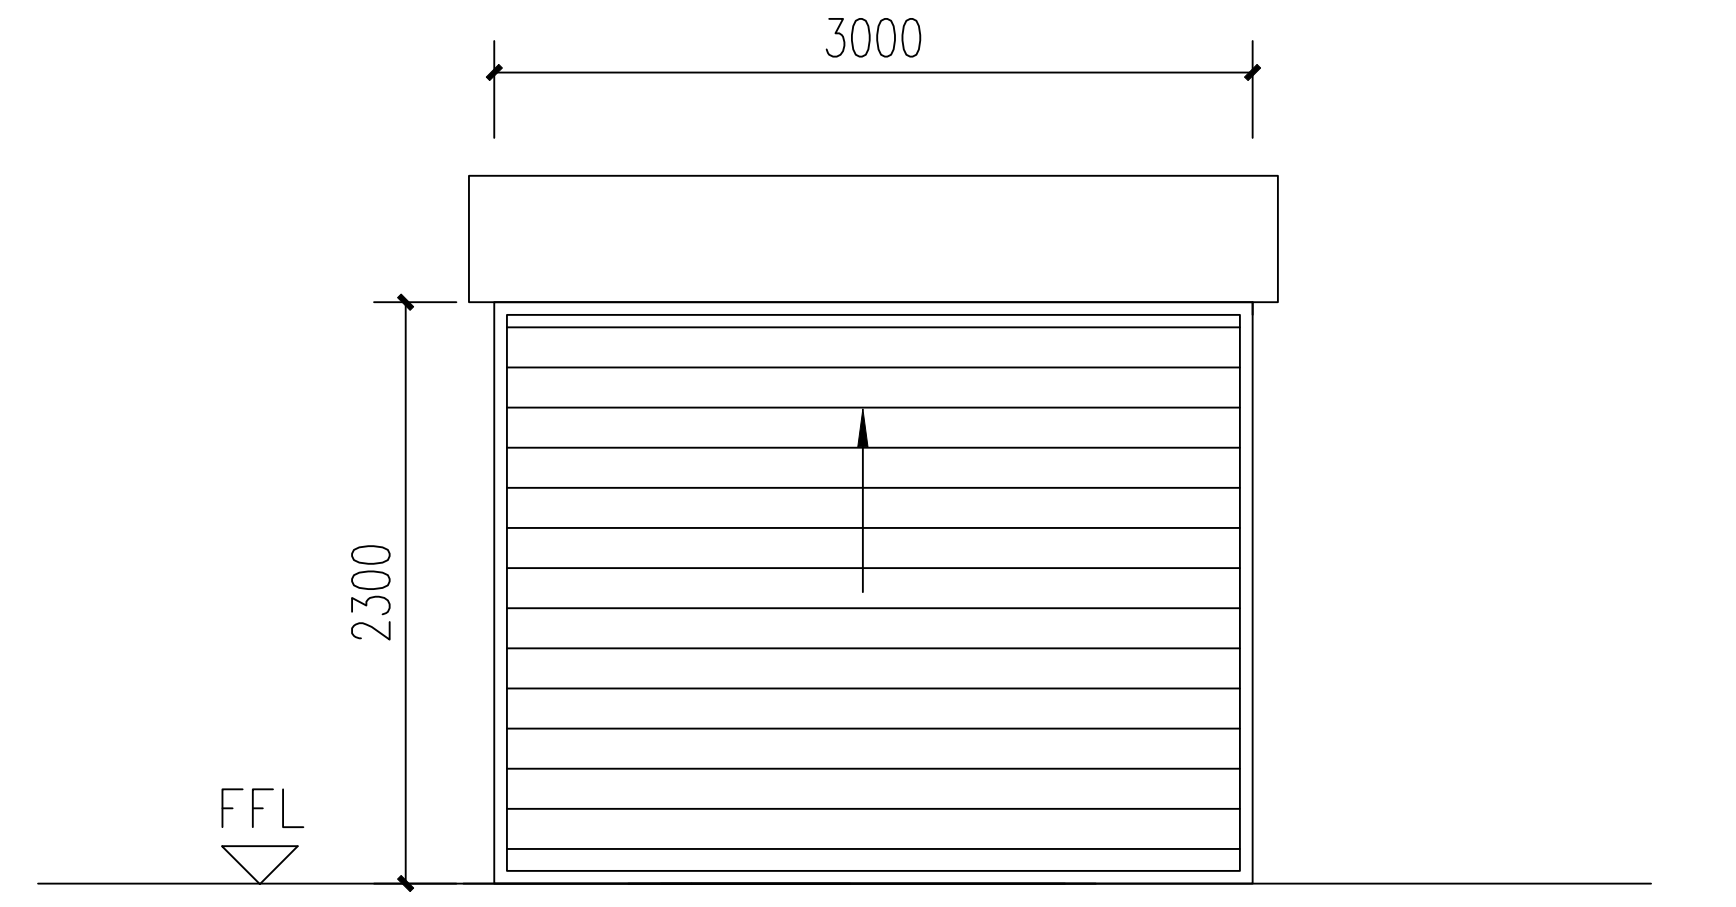

框 Frame	厂家配套 Manufacturer support				
扇 Leaf	厂家配套 Manufacturer support	铰链 Hinge	— -	纱窗 Screen	— —
玻璃 Glass	— —	制动 Closure	电动带手动 Electric plus manual	锁具 Lock	配套 Support
百叶 Louver	— —	门槛 Sill	— —	执手 Handle	— —
备注 Note	耐火时间满足2.0h要求；门及五金须与门窗厂家确认，由专业厂家设计制造及安装 The fire resistance time meets the requirements of 2.0h; the door and hardware must be confirmed by the door and window manufacturers, designed, manufactured and installed by professional manufacturers.				

说明：

1、钥匙的数量由业主与供应商确认。
2、门窗订货前应与业主确认。
3、本门窗表中个别数量与实际用量不符时，以实际用量为准。
4、玻璃隔断的分割仅为示意，由专业厂家根据现场实际情况以及保证美观的情况下确定分割。
5、所有门窗均由有质量保证的厂家制作、安装。
6、墙上的高窗（包括电动窗）均设置手动铰链开启。
7、铝合金金防雨百叶均带防虫网。
8、推拉窗窗扇应有防止从室外拆卸的装置，以及用于外墙时，应设置防止窗扇向室外脱落的装置。
9、透明玻璃门上应贴有标示，防止人员撞伤。
11、门洞的高度均应从建筑完成面算。所有门窗在加工前对实际洞口尺寸必须进行校核。
12、除注明外，其余见“建筑施工图设计通用说明”。
13、╱╲ 表示门窗开启方向。
14、如有门窗表中门窗无对应门窗详图，需与设计确认后方可采购、定制及施工。
15、有节能要求的外门窗整体传热系数应满足《建筑节能计算分析报告书》中相应外门窗的要求。外窗构造：金属隔热型材（隔热条高度 26.0mm）
(5Low-e+15A+5（中透光，离线单银）)，传热系数2.2W/m2.K，玻璃遮阳系数0.65，窗框系数0.75 可见光透射比0.60。外窗的可开启面
积不小于窗面积的30%。外门构造：1.0mm钢板+硅酸铝纤维棉（干密度160 Kg/m3）+1.0mm钢板），传热系数 2.2W/m2.K外门窗气密性、水
密、抗风压等级应符合《建筑外门窗气密、水密、抗风压性能分级及检测方法》GB/T7106-2008中的相关规定，气密性不低于 6级，即1.5≥
q1>1.0m3/m•h；水密性不低于4级，即350Pa≤ΔP≤500Pa；抗风压性不低于5级即3000Pa≤P3 ≤3500pa。隔声性能分级不低于《建
筑门窗空气声隔声性能分级及检测方法》GB/T8485-2008中的4级，即40dB>R+C≥35dB.
16、除注明者外，普通钢门框壁厚不小于1.5mm，钢门扇面板壁厚不小于0.8mm。铝合金门受力杆件最小壁厚 2.0mm，铝合金窗受力杆件最小壁厚
1.6mm。
17、门窗玻璃的选用:金属隔热型材（隔热条高度26.0mm）(5Low-e+15A+5（中透光，离线单银）)，传热系数 2.2W/m2.K，玻璃遮阳系数
0.65，窗框系数0.75，可见光透射比0.60;玻璃不论面积大小，凡符合下列情况者必须使用钢化玻璃:各种吊顶顶棚、室内隔断、倾斜装配窗、楼梯、阳台、
平台、走廊、中厅内栏板、公共建筑出入口、门厅等可能伤人的部位； 有防火要求的用防火玻璃;应遵照《建筑玻璃应用技术规程》 JGJ113-2015中7.1、
7.2条选取和《建筑安全玻璃管理规定》发改委【2003】2116号及地方主管部门的相关规定。门窗上所有玻璃、单块玻璃、 5mm厚的玻璃大于等于
0.5m2、6mm厚的玻璃大于等于0.9m2应采用钢化玻璃。挡烟垂壁的玻璃采用12厚夹胶防火玻璃，中空玻璃中空层内不得有灰尘和水汽。单面镀膜玻璃的
镀膜层及磨砂玻璃的磨砂面应朝向室内；中空玻璃的单面镀膜玻璃应在最外层，镀膜层应朝向室内。门窗玻璃切割尺寸应与框料槽口匹配，门窗玻璃不得直接接
触金属型材；玻璃与定位块、嵌缝条、密封膏应接触紧密、平稳。安装后的玻璃应牢固、密封性能好。
18、防火卷帘门的防烟性能在压差为20Pa时漏烟量应小于0.2m3/m2.min.防火卷帘的耐火极限应符合现行国家标准《防火卷帘耐火测试方法》
GB7633有关背火面温升的判定条件.防火卷帘门应带有火灾探测器、报警系统.
19、所有平开门带闭门器，双扇防火门带顺序器。

Description:

1、The number of keys is confirmed by the owner and the supplier.
2、Doors and windows should be confirmed with the owner before ordering.
3、If the individual quantity in this door and window table does not match the actual dosage, the actual dosage shall prevail.
4、The division of the glass partition is only an indication, and the division is determined by the professional manufacturer according to the actual situation on the spot and the aesthetics.
5、All doors and windows are manufactured and installed by quality assurance manufacturers.
6、The high window on the wall (including the power window) is equipped with a manual hinge opening.
7、Aluminum alloy gold rainproof louvers are equipped with insect nets.
8、The sliding window sash should have means to prevent detachment from the outside, and when used for the external wall, a device for preventing the sash from falling out of the room should be provided.
9、A transparent glass door should be marked to prevent personal injury.
11、The height of the door opening should be calculated from the completion of the building. All doors and windows must be checked for actual hole size before machining.
12、Except as noted, see the “General Description of Building Construction Drawing Design”.
13、< Indicates the opening direction of the door and window.
14、If there are no corresponding windows and doors in the doors and windows of the door and window table, it must be confirmed with the design before purchase, customization and construction.
15、The overall heat transfer coefficient of the external doors and windows with energy-saving requirements shall meet the requirements of the corresponding external doors and windows in the “Building Energy Efficiency Calculation Analysis Report”. Exterior window structure: metal heat insulation profile (insulation strip height 26.0mm (5Low-e+15A+5 (medium light transmission, offline single silver), heat transfer coefficient 2.2W/m2.K, glass shading coefficient 0.65, window frame The coefficient is 0.75, the visible light transmittance is 0.60. The openable area of the outer window is not less than 30% of the window area. The outer door structure: 1.0mm steel plate + aluminum silicate fiber cotton (dry density 160Kg/m3) + 1.0mm steel plate), heat transfer coefficient The airtightness, watertightness and wind pressure rating of 2.2W/m2.K outer door and window shall comply with the relevant provisions of GB/T7106-2008, "Airtight, Watertight, Wind Pressure Performance Classification and Detection Methods for Building Exterior Doors and Windows", Airtight The property is not less than grade 6, that is, 1.5q1>1.0m3/m•h; the watertightness is not lower than grade 4, that is, 350Pa≤ΔP≤500Pa; the wind resistance is not lower than grade 5, that is, 3000Pa≤P3≤3500pa. The sound insulation performance classification is not lower than the level 4 of GB/T8485-2008 in the classification and detection method of air sound insulation performance of building doors and windows, that is, 40dB>R+C≥35dB.
16、Except as noted, the wall thickness of ordinary steel door frame is not less than 1.5mm, and the wall thickness of steel door panel is not less than 0.8mm. The minimum wall thickness of the aluminum alloy door is 2.0mm, and the minimum wall thickness of the aluminum alloy window is 1.6mm.
17、Metal and heat insulation profiles for door and window glass (insulation strip height 26.0mm) (5Low-e+15A+5 (medium light transmission, offline single silver), heat transfer coefficient 2.2W/m2.K, glass shading coefficient 0.65, window The frame factor is 0.75, and the visible light transmittance is 0.60. Regardless of the size of the glass, it is necessary to use tempered glass for various ceilings, indoor partitions, inclined assembly windows, stairs, balconies, platforms, corridors, halls, and public panels. Building entrances, entrance halls and other parts that may injure people; fireproof glass with fire protection requirements shall comply with the "Technical Regulations for the Application of Building Glass" JGJ113-2015 7.2 and the "Building Safety Glass Management Regulations" Development and Reform Commission [2003] 2116 and local supervisors Relevant regulations of the department. All glass, single glass, 5mm thick glass on the door and window is greater than or equal to 0.5m2, and the glass with thickness of 6mm is greater than or equal to 0.9m2. Tempered glass should be used. The glass for blocking the vertical wall of the smoke is made of 12 thick laminated fireproof glass. There shall be no dust or water vapor in the hollow layer of the hollow glass. The coating layer of the single-coated glass and the frosted surface of the frosted glass shall face indoors; the single-coated glass of the insulating glass shall be the most The outer layer and the coating layer should face indoors. The size of the door and window glass should be matched with the frame slot, and the door and window glass should not directly contact the metal profile; the glass should be in close contact with the positioning block, the caulking strip and the sealing paste. It should be firm and sealed.
18、The smoke prevention performance of the fire shutter door should be less than 0.2m3/m2.min when the pressure difference is 20Pa. The fire endurance of the fire shutter should comply with the current national standard "Fireproofing Test Method for Fireproof Roller" GB7633 Judging conditions. Fire shutter doors should be equipped with fire detectors and alarm systems.
19、All swing doors have door closers and double fire doors with sequencers.

缩引图 Keyplan

版本 REV.	版本说明 Description	日期 Date
1	IFC	20190329

注册执业印章 Registered Stamp

注册执业师 Professional Engineer

出图印章 Print Stamp

咨询公司 Consultant

JLL®

设计单位 Designer

信息产业电子第十一设计研究院科技工程股份有限公司
The IT Electronics Eleventh Design & Research Institute
Scientific and Technological Engineering Corporation Ltd.
中国 成都 新华大道双林路251号
NO. 251 Shuanglin Rd. Xinhua Avenue. Chengdu, China
邮编：610021 P.C.:610021

十一科技
设计证号:
A151000523

建设单位 Owner

Hengtong Optic-Electric
India Private Ltd

项目名称 Project Name

Indian Optical Fiber
and Cable Project

图纸名称 Drawing Title

建筑—Architecture
光纤光缆厂房—Optical Fiber Plant
门窗大样图二
DOOR AND WINDOW PICTURE 2

设计 Designed By	梁智浩		项目号 Project No.	2017-08设-043
制图 Drawn By	梁智浩		设计阶段 Des. Stage	施工图
校对 Checked By	张凤磊		专业 Discipline	建筑
审核 Reviewed By	赵军		比例 Scale	1:100
审定 Approved			版本 Version	1
专业负责人 Discipline Leader	赵军		日期 Date	20190329
项目负责人 Design Manager	汤敏		页数 Sheet No.	
图号 Drawing No.	HTIN-AR-01-DWS-00-002			