
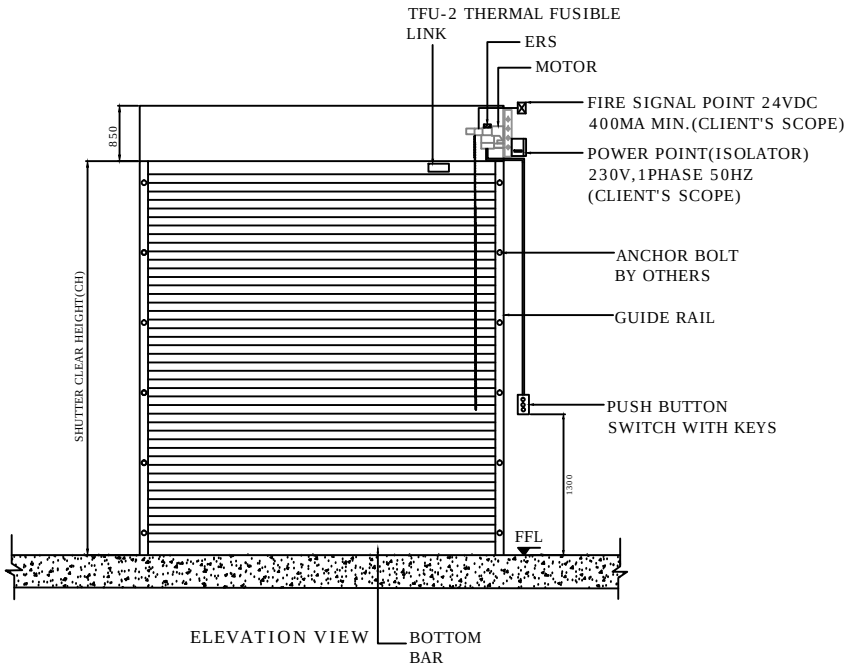



ELEVATION VIEW

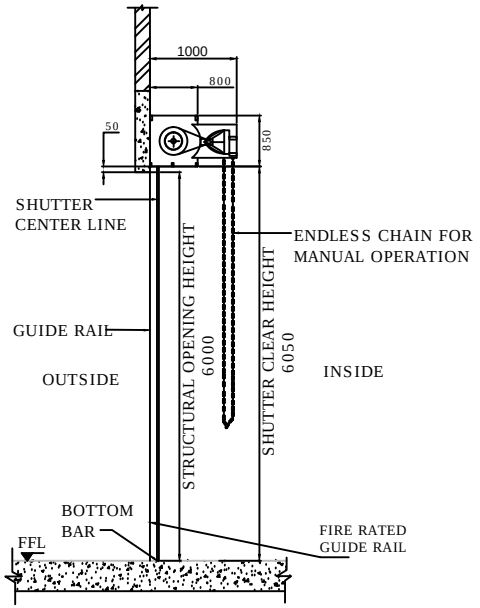


SIDE VIEW

SHUTTER TYPE	HIGH QUALITY 2HRS FIRE SHUTTERS
SHUTTER SLATS	1.0 mm GALVALUME STEEL SOLID SLATES
FINISHING OF SLATS	POWER COAT STANDARD RAL COLOUR
GUIDE RAIL	GALVANIZED ,3mm THICK
FINISHING OF GUIDE	POWDER COAT STANDARD RAL COLOUR
BOTTOM BAR	T-120
FINISHING OF B/BAR	POWDER COAT STANDARD RAL COLOUR
BOX DESIGN	MILD STEEL SECTION FRAME DESIGN
FINISHING OF BOX	POWDER COAT STANDARD RAL COLOUR
BOX COVER PLATE	0.8mm ZINCALUME STEEL SHEET
FINISHING OF COVER	POWDER COAT STANDARD RAL COLOUR
OPERATION	MOTORIZE WITH MANUAL OVERRIDE CHAIN
MOTOR POWER SOURCE	230 VOLTS,1 PHASE,50HZ
FIRE MODE	THERMAL FUSIBLE LINK WILL AUTO CLOSE BY GRAVITY FORCE
	WHWN ROOM TEMP RISES UP TO 68°C
	FIRE SIGNAL FROM FIRE CONTROL ROOM AND SHUTTER
	SHALL CLOSE DOWN BY GRAVITY FORCE WITHOUT DELAY


LOCATION	SHUTTER NO.	CLEAR WIDTH (STRUCTURE)	CLEAR HEIGHT (STRUCTURE)	QUANTITY	MOTOR POSITION
	FRS	4000 mm	6000mm	1	RH

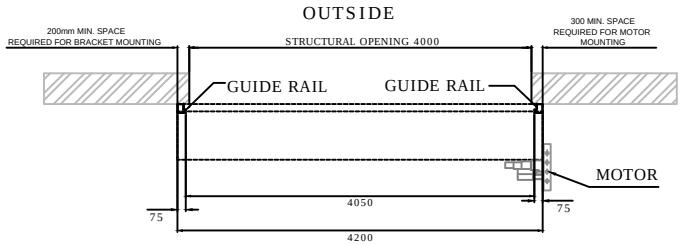


INSIDE
PLAN VIEW

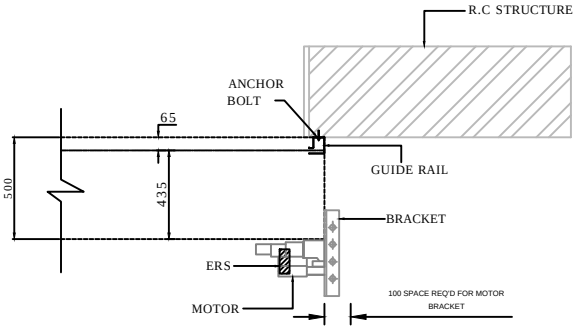


GUIDE & MOTOR ASSEMBLY DETAILS

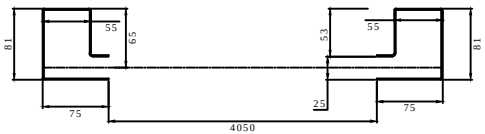

GALVANISED STEEL GUIDE RAIL
THICKNESS 3mm



SHUTTER SLAT



FIRE RATED BOTTOM BAR

LOCATION- TESTING BUILDING PAINT LAB.

This drawing & designing is the property of NIHVA TECHNOLOGIES. Not to be sold or copied to any other concern.

TITLE
FIRE RATED ROLLING SHUTTER

	SIGN	DATE
DRAWN	SURAJ	19/09/17
CHECK	SAGAR P.	19/09/17
REV.		
APPROVAL	SHEKHAR	19/09/17

If any queries contact : projects@nihva.com

ALL DIMENSION ARE IN mm

NIHVA
NIHVA TECHNOLOGIES PVT. LTD.
NIHVA TECHNOLOGIES PVT. LTD. PUNE
Tel : 020 66304033
Email:- info@nihva.com
Website:- www.nihva.com

CLIENT - TATA PROJECTS LIMITED
PROJECT -ALSTOM
SITE - MADHEPURA, BIHAR
DWG. NO. : NIHVA/17-18/0208
SCALE: NTS | WT: | SHEET: 01 OF 01