

PROPOSED PLAN LAYOUT

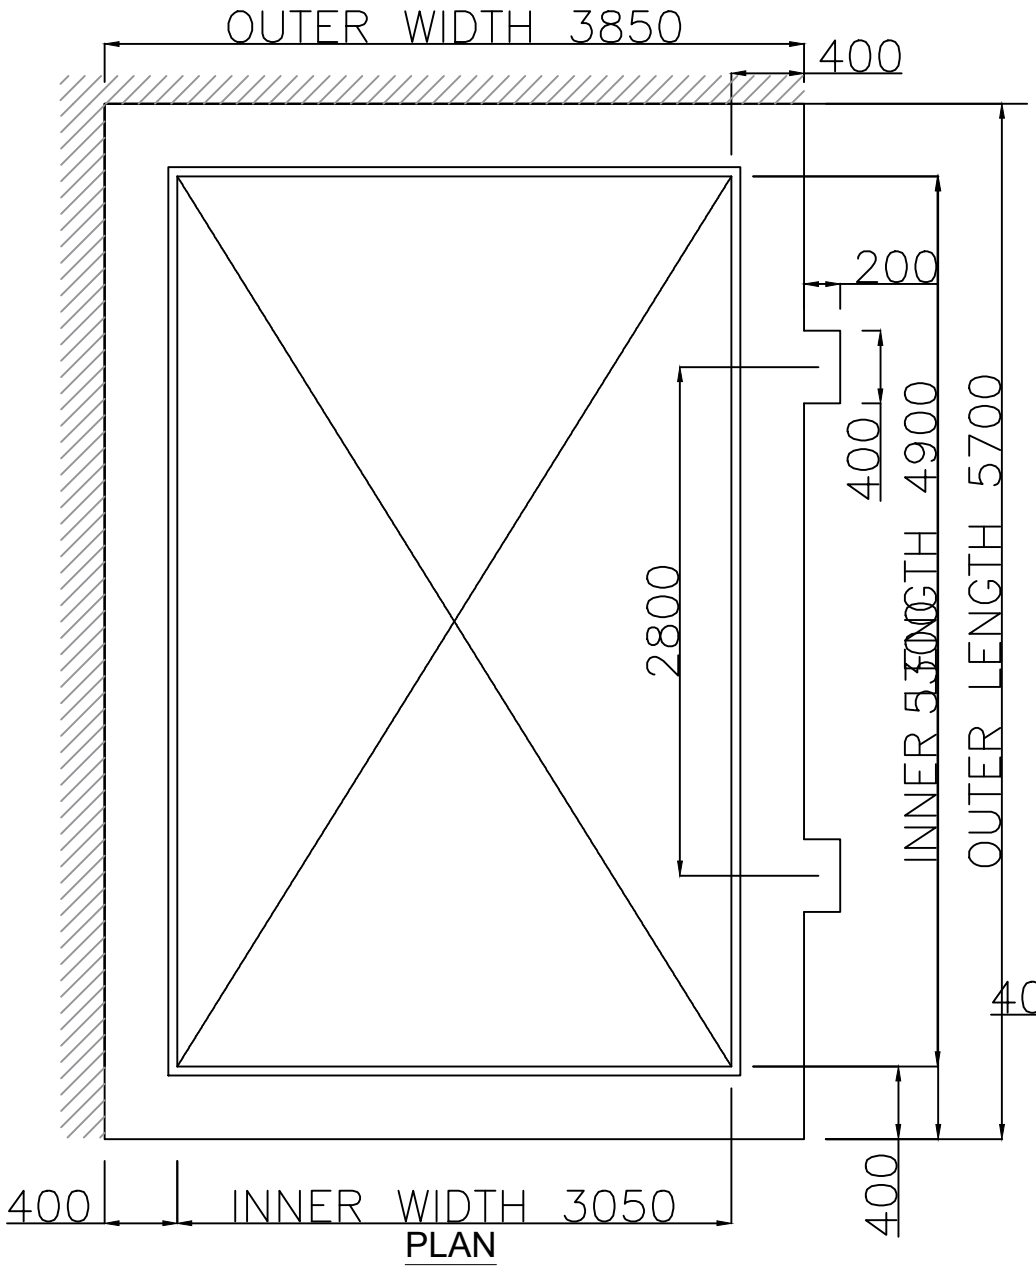

PLAN

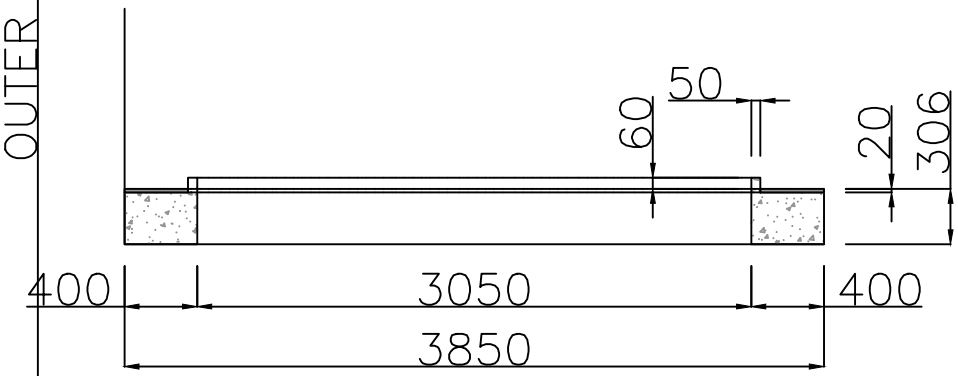

SECTION VIEW

1. THE STRUCTURE AROUND THE CUT OUT SHOULD BE OF CONCRETE FOR FOR PROPER FASTENING OF ROOF.
2. TOP SURFACE SHOULD BE OF GRANITE 20MM FOR SMOOTH FUNCTIONING OF ROOF TOWARDS CONCRETE SIDE.
3. REQUIRED 50X60 MM CONCRETE ELEVATION ALONG THE CUTOUT.
4. GRADIENT OF 50MM NEED TO BE PROVIDED ALONG THE OUTER LENGTH TO AVOID WATER STAGNANCY IN GUIDE RAIL.
5. ELECTRICAL REQUIREMENT - 220V 5AMP SINGLE PHASE CONNECTION.
6. ALL DIMENSION IN MM.