

• Add cross section for both (open & close) conditions


Condition shown is not correct. Update detail

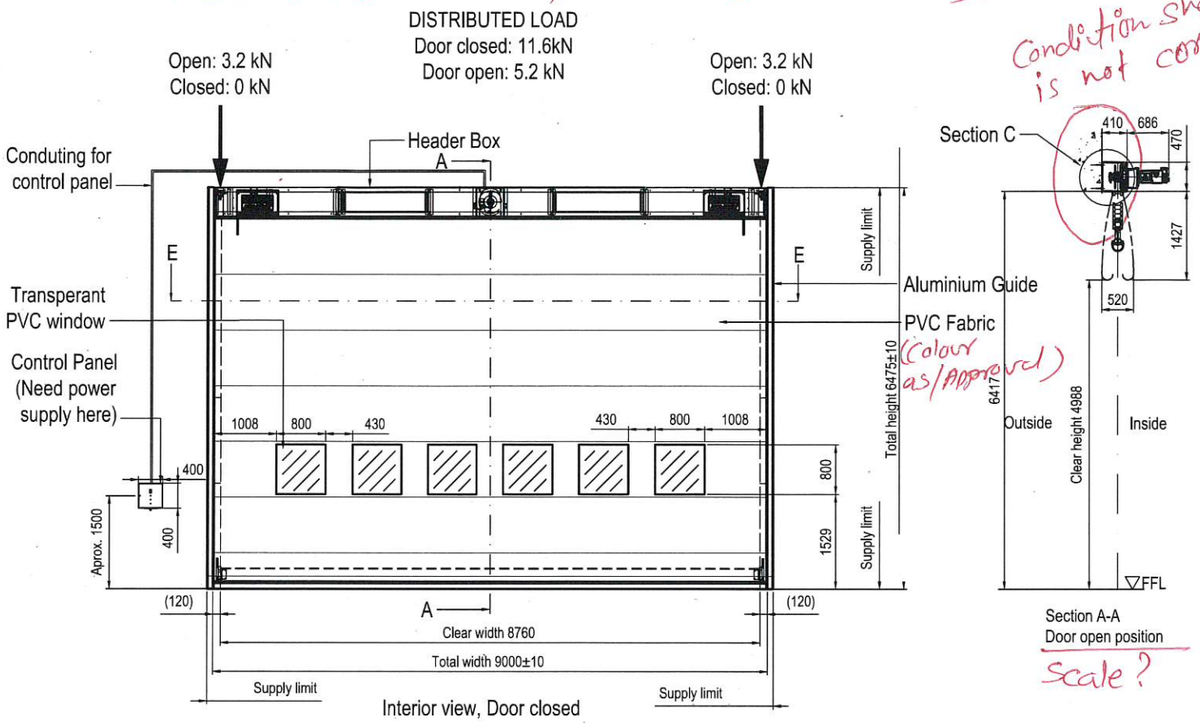

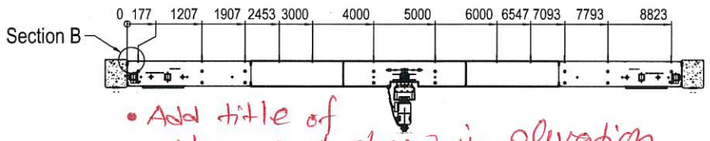


• Add title of plan and show in elevation


OUT SIDE

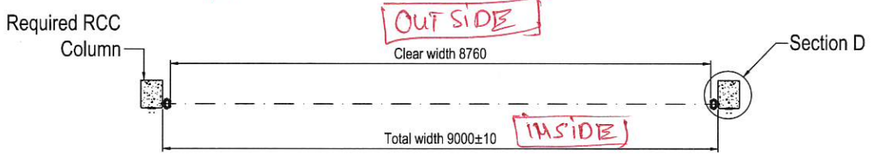


Scale not correct

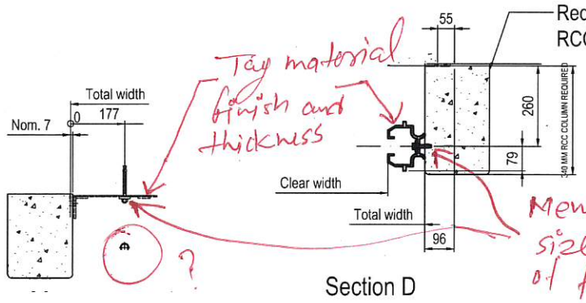


Scale not correct please Update

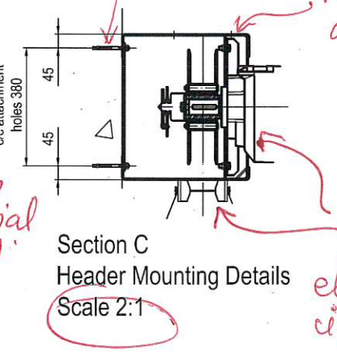



Force by differential pressure transferred to guide rail at each intermediate position.
F=4.7 kN

Position of intermidiate beam with guide



Load on header box attachment (each screw), due to wind load and door weight

• Mention correct scale for all details

• Electrical observation attached in mail.

NOT INCLUDED IN DOOR SUPPLY:

1. Design and supply of all door supporting structural components.
2. Design and supply of all closure between door and adjacent steel.
3. Door jambs adjustable for overall door width and true to plumb.
4. Paint job after completed door installation.
5. Any frameworks being provided by ASSA ABLOY will be clearly indicated as "by ASSA ABLOY".

REQUIREMENTS ON BUILDING:

6. Door head support must be straight within 1/600 of span in the in/out direction and free from protrusions of any kind.
7. For a single door leaf, door head support should be horizontal and straight within 1/600 of span at distributed full door load.
8. Door side jambs must be smooth, straight and parallel, out of plumb must not exceed 2mm/m (total deviation at full length 5 mm) in any direction.
9. Any footings at bottom of jamb columns must not interfere with installation of guide rails at floor level.
10. At time of installation, finished floor, free from obstructions, out to a distance of 2 m on each side of door centreline must be available.
11. Header box must be accessible from both sides during installation.

DOOR PROPERTIES:

12. The door is designed to withstand a differential pressure of 1.15kPa x 1.5 fos.
13. Color of door fabric (Please specify) As/ Approval
14. Side profiles : ? Mention
15. Metal trim: motor side


ELECTRICAL:

16. One main control panel provided of PLC type.
17. Audible and visual alarm
18. Back-up power switch
19. Safety edge
20. Approx. size of main control panel: WxHxD (500mm x 600mmx250 mm),
21. Power: 2.7kW
22. Nom. current: 6.4A → Confirm the phase requirement
23. (max. allowed voltage drop at start: 5%)

BELT HOIST UNITS:

SK 873.1-100L/4 Z dual brake

• Previous given comments are not fully incorporated in shop drawings. Please comply.

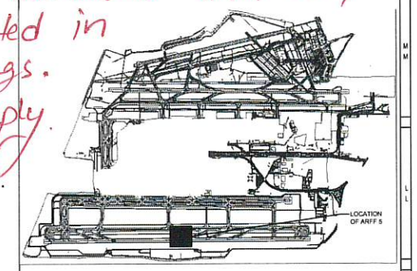

KEY PLAN (NOT TO SCALE)

NOTE:
1. 340 MM RCC COLUMN REQUIRED FOR GUIDE MOUNTING.
IF RCC COLUMN NOT AVAILABLE THEN WE WILL REQUIRE MS STRUCTURE FOR THE SAME.

• All sizes/dimensions are to be verified by Vendor at site prior to proceeding for production.

• All materials/finishes shown in shop drawings are subject to MAS/sample approval by DIAL.

REFERENCE DRAWINGS :
DIAL-LT-D-UTL-A-20-100 : ARFF4 FIRE STATION ELEVATIONS
DIAL-LT-D-UTL-A-20-101 : ARFF4 FIRE STATION ELEVATIONS
DIAL-LT-D-UTL-A-10-100 : ARFF4 FIRE STATION GROUND FLOOR PLAN

• Colours of fabric and frame subject to sample & approval by DIAL.

MAS

L&T Construction
Buildings & Factories

A	APPROVED. PROCEED FOR MANUFACTURE/ CONSTRUCTION.
B	APPROVED WITH COMMENTS. PROCEED TO MANUFACTURE/ CONSTRUCTION SUBJECT TO COMPLIANCE OF ALL COMMENTS AND RESUBMIT THE DOCUMENTS ONLY FOR LEVEL A & B.
C ✓	RESUBMIT AFTER INCORPORATION OF ALL COMMENTS FOR REVIEW.
D	REJECTED. MAKE A RESUBMISSION ALTOGETHER FOR REVIEW.

REVIEW OF THIS DOCUMENT IS ONLY TO CHECK COMPATIBILITY WITH BASIC DESIGN. THIS DOES NOT ABSOLVE THE SUB-CONTRACTOR/ MANUFACTURER FROM HIS RESPONSIBILITY TO MEET THE REQUIREMENT AS PER SPECIFICATIONS, CODES & STANDARDS, APPLICABLE LAWS, STATUTORY RULES & REGULATIONS, AS EXISTING OR AS MAY BE AMENDED TIME TO TIME.

CHECKED

SHOP DRAWING

Update format

REVNO.	DESCRIPTION	DESIGNED	DRAWN	CHECKED	APPROVED

CHECKED BY	SIGN	DATE	CHECKED BY	SIGN	DATE	CHECKED BY	SIGN	DATE
ARCHITECTURE			HVAC			GIS		
CIVIL & STRUCTURAL			FPS			GEOTECH.		
ELECTRICAL			PIPING			AIRPORT SYSTEMS		
ELV SYSTEM			PHE			INTERFACE		

DELHI INDIRA GANDHI INTERNATIONAL AIRPORT | GMR | L&T Construction


CLIENT : DELHI INTERNATIONAL AIRPORT LIMITED
PROJECT : NEW ATCT
PROJECT CONSULTANT: Engineering Design and Research Center L&T Construction (EDRC)
INSTALLED AND SUPPLIED BY: MMA TECHNOLOGIES PVT LTD

JOB No : JOBNO.


	NAME	SIGN	DATE
DSGN	G.J.P		02.10.2021
DRWN	G.J.P		02.10.2021
CHKD	A.K.		02.10.2021
APPD	V.T.		02.10.2021

TITLE: ARFF5 MEGADOOR 8760 X 4988 (RS7)
SCALE 1:1
DRAWING No. DIAL-LT-Q-PTB-A-HSRS-ARFF5-01
SHEET:
PROJECTION FIRST ANGLE
SIZE A3
REV C
RELEASED FOR ☐ PRELIMINARY ☐ TENDER ☐ INFORMATION ☑ APPROVAL ☐ CONSTRUCTION


Drawing no. not correct. Update drawing no.

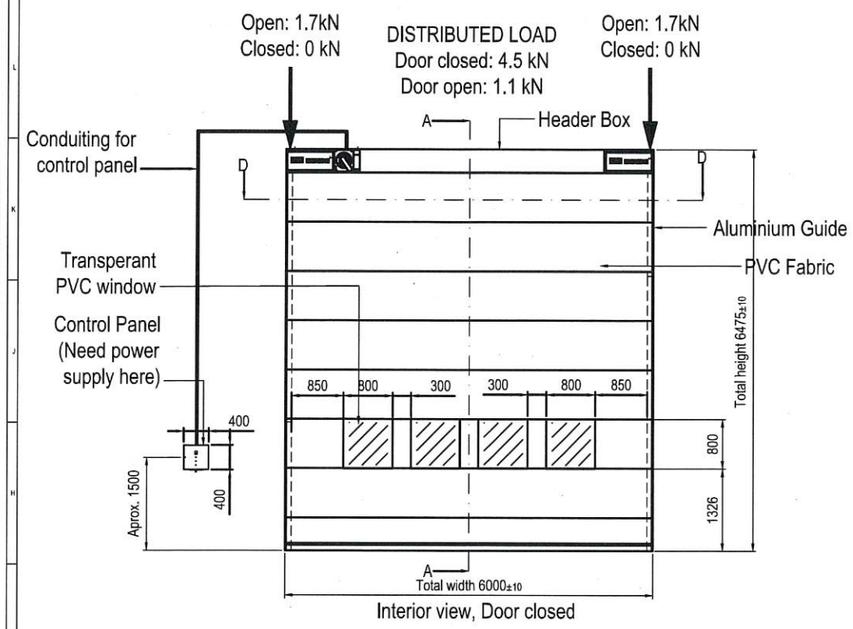


Interior view, Door closed

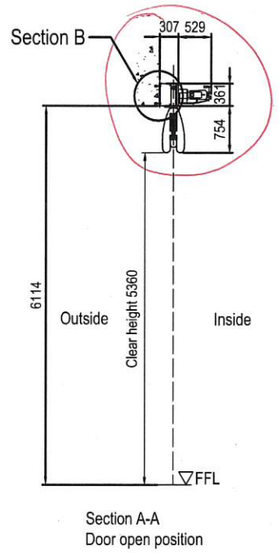


Section A-A
Door open position

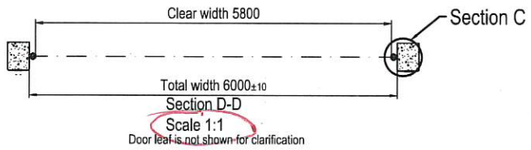

Section D-D
Scale 1:1
Door leaf is not shown for clarification

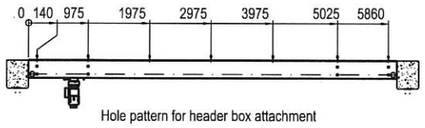


Hole pattern for header box attachment




Force by differential pressure transferred to guide rail at each intermediate position.
F= 2.7 kN


Position of intermidiate beam with guide



Load on header box attachment (each screw), due to wind load and door weight

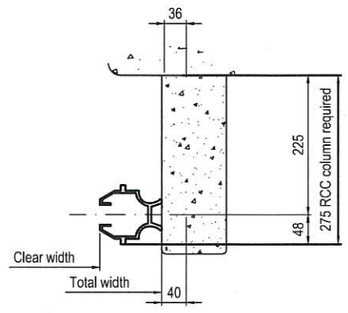

Section C
Guide Mounting Details
Scale 2:1



Section B
Header Mounting Details
Scale 2:1

Please refer general comments provided on first drawing

NOT INCLUDED IN DOOR SUPPLY:

1. Design and supply of all door supporting structural components.
2. Design and supply of all closure between door and adjacent steel.
3. Door jambs adjustable for overall door width and true to plumb.
4. Paint job after completed door installation.
5. Any frameworks being provided by ASSA ABLOY will be clearly indicated as "by ASSA ABLOY".

REQUIREMENTS ON BUILDING:

6. Door head support must be straight within 1/600 of span in the in/out direction and free from protrusions of any kind.
7. For a single door leaf, door head support should be horizontal and straight within 1/600 of span at distributed full door load.
8. Door side jambs must be smooth, straight and parallel, out of plumb must not exceed 2mm/m (total deviation at full length 5 mm) in any direction.
9. Any footings at bottom of jamb columns must not interfere with installation of guide rails at floor level.
10. At time of installation, finished floor, free from obstructions, out to a distance of 2 m on each side of door centreline must be available.
11. Header box must be accessible from both sides during installation.


DOOR PROPERTIES:

12. The door is designed to withstand a differential pressure of 1.15kPa x 1.5 fos.
13. Metal trim: motor side
14. Side profiles
15. Fabric colour: Please specify

ELECTRICAL:

14. One main control panel provided of PLC type.
15. Audible and visual alarm
16. Safety edge
17. Back-up power switch
18. Approx. size of main control panel: WxHxD (500mm x 600mm x 250 mm),
19. Power: 1.4kW
20. Nom. current: 3.3A
21. (max. allowed voltage drop at start: 5%)

BELT HOIST UNITS:
Sk 773.1-90S/4 Z dual brake

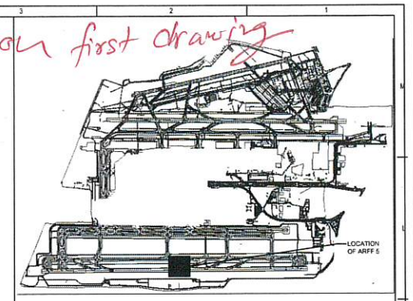

KEY PLAN (NOT TO SCALE)

NOTE:
1. 275 MM RCC COLUMN REQUIRED FOR GUIDE MOUNTING.
IF RCC COLUMN NOT AVAILABLE THEN WE WILL REQUIRE MS STRUCTURE FOR THE SAME.

REFERENCE DRAWINGS :

DIAL-LT-D-UTL-A-20-100 : ARFF4 FIRE STATION ELEVATIONS
DIAL-LT-D-UTL-A-20-101 : ARFF4 FIRE STATION ELEVATIONS
DIAL-LT-D-UTL-A-10-100 : ARFF4 FIRE STATION GROUND FLOOR PLAN

L&T Construction
Buildings & Factories

A	APPROVED. PROCEED FOR MANUFACTURE/ CONSTRUCTION.
B	APPROVED WITH COMMENTS. PROCEED TO MANUFACTURE/ CONSTRUCTION SUBJECT TO COMPLIANCE OF ALL COMMENTS AND RESUBMIT THE DOCUMENTS ONLY FOR LEVEL A APPROVAL
C	RESUBMIT AFTER INCORPORATION OF ALL COMMENTS FOR REVIEW.
D	REJECTED. MAKE A RESUBMISSION ALTOGETHER FOR REVIEW.

REVIEW OF THIS DOCUMENT IS ONLY TO CHECK COMPATIBILITY WITH BASIC DESIGN. THIS DOES NOT ABSOLVE THE SUB-CONTRACTOR/ MANUFACTURER FROM HIS RESPONSIBILITY TO MEET THE REQUIREMENT AS PER SPECIFICATIONS, CODES & STANDARDS, APPLICABLE LAWS STATUTORY RULES & REGULATIONS, AS EXISTING OR AS MAY BE AMENDED TIME TO TIME.

CHECKED
LETTER REF :
VERIFIED BY : DEBABRATA PAL
DESIGNATION : HEAD ARCHITECT
DATE :
SIGNATURE :

SHOP DRAWING

Update format correctly

REV.NO.	DESCRIPTION	DESIGNED	DRAWN	CHECKED	APPROVED
	REVISIONS				

CHECKED BY	SIGN	DATE	CHECKED BY	SIGN	DATE	CHECKED BY	SIGN	DATE
ARCHITECTURE			HVAC			GIS		
CIVIL & STRUCTURAL			FPS			GEOTECH.		
ELECTRICAL			PIPING			AIRPORT SYSTEMS		
ELV SYSTEM			PHE			INTERFACE		

DELHI INDIRA GANDHI INTERNATIONAL AIRPORT GMR
L&T Construction

CLIENT : DELHI INTERNATIONAL AIRPORT LIMITED.
PROJECT: DELHI INDIRA GANDHI INTERNATIONAL AIRPORT PHASE-3A DEVELOPMENT WORKS
CONCEPT : ASSA ABLOY
PROJECT CONSULTING: Engineering Design and Research Center L&T Construction (EDRC)
INSTALLED AND SUPPLIED BY: ASSA ABLOY ENTRANCE SYSTEMS INDIA PVT LTD


JOB No : JOBNO.


	NAME	SIGN	DATE
DSGN	G.J.P		02.10.2021
DRWN	G.J.P		02.10.2021
CHKD	A.K.		02.10.2021
APPD	V.S.		02.10.2021

TITLE: ARFF5 MEGADOOR 5800 X 5360 (RS6)
SCALE 1:1
DRAWING No. DIAL-LT-Q-PTB-A-HSRS-ARFF5-02
PROJECTION FIRST ANGLE
SIZE A3
REV 0
SHEET:
RELEASED FOR ☐ PRELIMINARY ☐ TENDER ☐ INFORMATION ☑ APPROVAL ☐ CONSTRUCTION

Drawing no. not Correct, Update it

Please refer general comments provided on 1st drawing

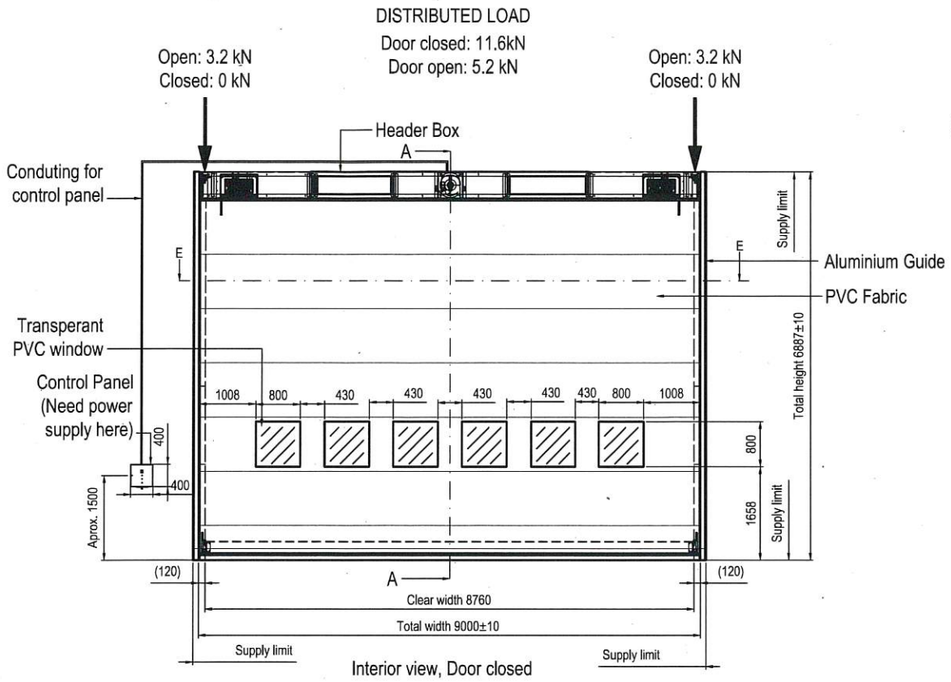

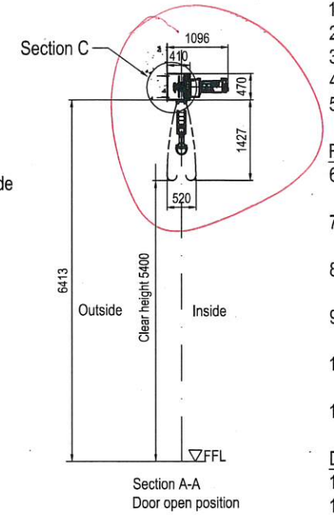

NOT INCLUDED IN DOOR SUPPLY:

1. Design and supply of all door supporting structural components.
2. Design and supply of all closure between door and adjacent steel.
3. Door jambs adjustable for overall door width and true to plumb.
4. Paint job after completed door installation.
5. Any frameworks being provided by ASSA ABLOY will be clearly indicated as "by ASSA ABLOY".

REQUIREMENTS ON BUILDING:

6. Door head support must be straight within 1/600 of span in the in/out direction and free from protrusions of any kind.
7. For a single door leaf, door head support should be horizontal and straight within 1/600 of span at distributed full door load.
8. Door side jambs must be smooth, straight and parallel, out of plumb must not exceed 2mm/m (total deviation at full length 5 mm) in any direction.
9. Any footings at bottom of jamb columns must not interfere with installation of guide rails at floor level.
10. At time of installation, finished floor, free from obstructions, out to a distance of 2 m on each side of door centreline must be available.
11. Header box must be accessible from both sides during installation.

DOOR PROPERTIES:


12. The door is designed to withstand a differential pressure of 1.15kPa x 1.5 FOS.
13. Color of door fabric: Please specify
14. Side profiles
15. Metal trim: motor side


ELECTRICAL:


16. One main control panel provided of PLC type.
17. Audible and visual alarm
18. Back-up power switch
19. Safety edge
20. Approx. size of main control panel: WxHxD (500mm x 600mmx250 mm),
21. Power: 2.7kW
22. Nom. current: 6.4A
23. (max. allowed voltage drop at start: 5%)

BELT HOIST UNITS:


SK 873.1-100L/4 Z dual brake

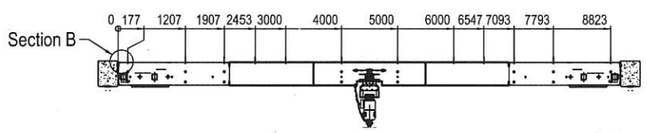

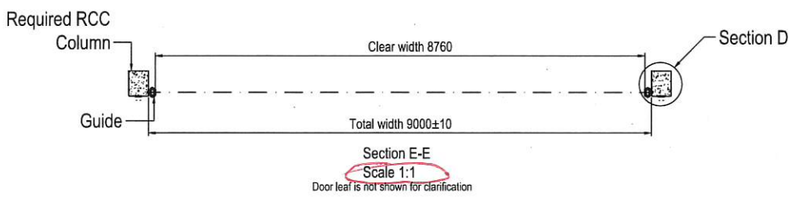





Section B
Scale : 2:1




Section C
Header Mounting Details
Scale 2:1

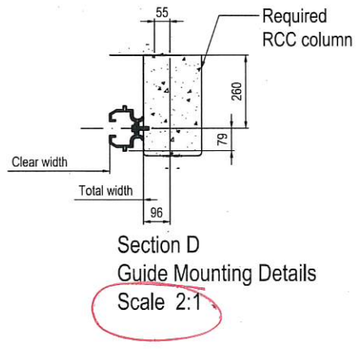


Section D
Guide Mounting Details
Scale 2:1



Force by differential pressure transferred to guide rail at each intermediate position.
F=4.7 kN
Position of intermidiate beam with guide



Load on header box attachment (each screw), due to wind load and door weight

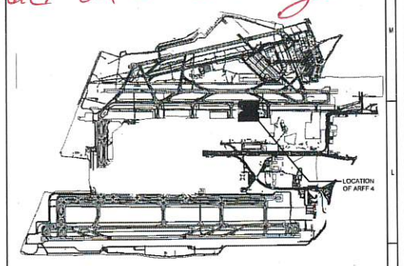

KEY PLAN (NOT TO SCALE)

NOTE:
1. 340 MM RCC COLUMN REQUIRED FOR GUIDE MOUNTING.
IF RCC COLUMN NOT AVAILABLE THEN WE WILL REQUIRE MS STRUCTURE FOR THE SAME.

REFERENCE DRAWING :

DIAL-LT-D-UTL-A-20-300 : ARFF4 FIRE STATION ELEVATIONS
DIAL-LT-D-UTL-A-20-301 : ARFF4 FIRE STATION ELEVATIONS
DIAL-LT-D-UTL-A-10-300 : ARFF4 FIRE STATION GROUND FLOOR PLAN

L&T Construction
Buildings & Factories

A	APPROVED. PROCEED FOR MANUFACTURE/ CONSTRUCTION.
B	APPROVED WITH COMMENTS. PROCEED TO MANUFACTURE/ CONSTRUCTION SUBJECT TO COMPLIANCE OF ALL COMMENTS AND RESUBMIT THE DOCUMENTS ONLY FOR LEVEL A APPROVAL
C	RESUBMIT AFTER INCORPORATION OF ALL COMMENTS FOR REVIEW.
D	REJECTED. MAKE A RESUBMISSION ALTOGETHER FOR REVIEW.

REVIEW OF THIS DOCUMENT IS ONLY TO CHECK COMPATIBILITY WITH BASIC DESIGNS. THIS DOES NOT ABSOLVE THE SUB-CONTRACTOR/ MANUFACTURER FROM HIS RESPONSIBILITY TO MEET THE REQUIREMENT AS PER SPECIFICATIONS, CODES & STANDARDS, APPLICABLE LAWS, STATUTORY RULES & REGULATIONS, AS EXISTING OR AS MAY BE AMENDED TIME TO TIME.

CHECKED
LETTER REF
VERIFIED BY : DEBABRATA PAL
DESIGNATION : HEAD ARCHITECT
DATE :
SIGNATURE :

SHOP DRAWING

REV.NO.	DESCRIPTION	DESIGNED	DRAWN	CHECKED	APPROVED
A	Issued for approval				

REVISIONS


CHECKED BY	SIGN	DATE	CHECKED BY	SIGN	DATE	CHECKED BY	SIGN	DATE
ARCHITECTURE			HVAC			QS		
CIVIL & STRUCTURAL			FPS			GEOTECH.		
ELECTRICAL			PIPING			AIRPORT SYSTEMS		
ELV SYSTEM			PHE			INTERFACE		

DELHI INDIRA GANDHI INTERNATIONAL AIRPORT
GMR
DELHI INTERNATIONAL AIRPORT LIMITED
L&T Construction
PROJECT: NEW DELHI INTERNATIONAL AIRPORT PHASE-3A DEVELOPMENT WORKS
CLIENT :
PROJECT CONSULTANT: Engineering Design and Research Center L&T Construction (EDRC)
CONCEPT :
DESIGNED AND SUPPLIED BY: WHR TECHNOLOGIES PVT LTD

JOB NO.	NAME	SIGN	DATE
DSGN	G.J.P		02.10.2021
DRWN	G.J.P		02.10.2021
CHKD	A.K.		02.10.2021
APPD	V.S.		02.10.2021


TITLE: ARFF4 MEGADOOR 8760 X 5400 (RS7)
SCALE 1:1
DRAWING No. DIAL-LT-Q-PTB-A-HSRS-ARFF4-01
SHEET:
PROJECTION: DIRECT METHOD
SIZE A3
REV 0
RELEASED FOR: ☐ PRELIMINARY ☐ TENDER ☐ INFORMATION ☑ APPROVAL ☐ CONSTRUCTION

Please refer general comments provided on 1st drawing

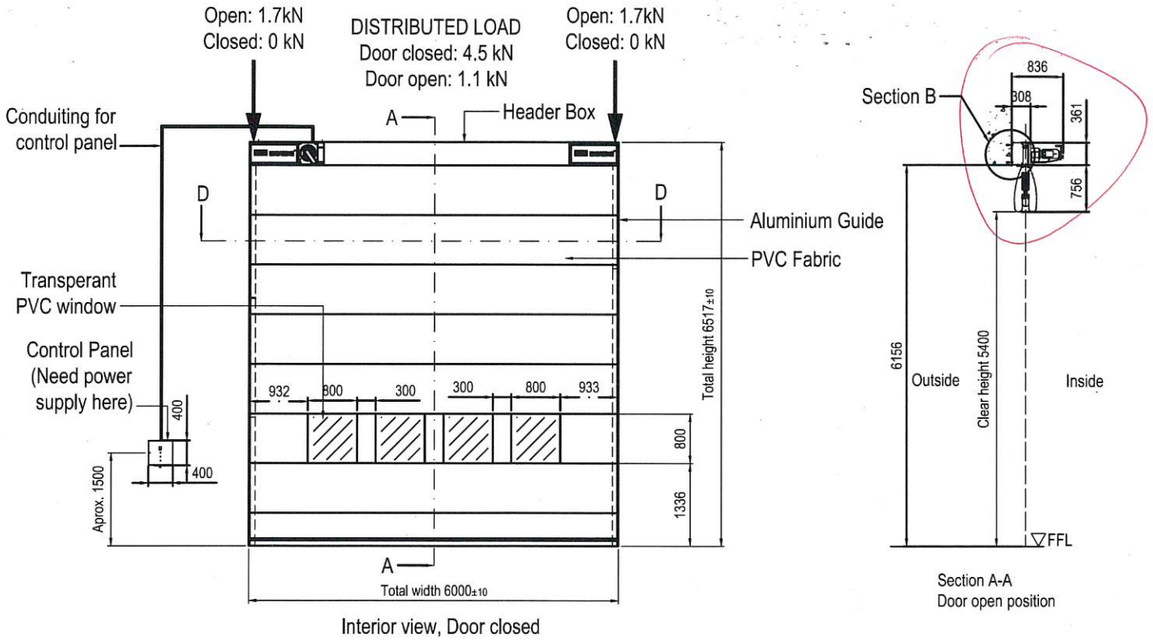


Interior view, Door closed


Section A-A
Door open position

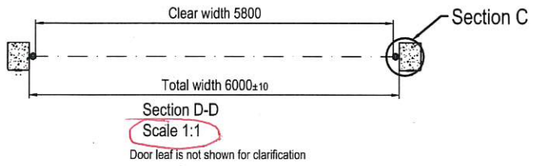

Section D-D
Scale 1:1
Door leaf is not shown for clarification

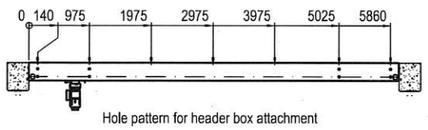


Hole pattern for header box attachment




Force by differential pressure transferred to guide rail at each intermediate position.
F= 2.7 kN


Position of intermidiate beam with guide



Load on header box attachment (each screw), due to wind load and door weight

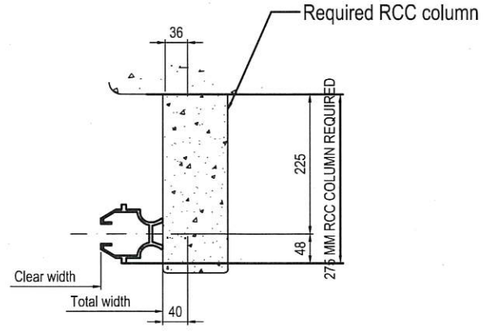

Section C
Guide Mounting Details
Scale 2:1



Section B
Header Mounting Details
Scale 2:1

NOT INCLUDED IN DOOR SUPPLY:

1. Design and supply of all door supporting structural components.
2. Design and supply of all closure between door and adjacent steel.
3. Door jambs adjustable for overall door width and true to plumb.
4. Paint job after completed door installation.
5. Any frameworks being provided by ASSA ABLOY will be clearly indicated as "by ASSA ABLOY".

REQUIREMENTS ON BUILDING:

6. Door head support must be straight within 1/600 of span in the in/out direction and free from protrusions of any kind.
7. For a single door leaf, door head support should be horizontal and straight within 1/600 of span at distributed full door load.
8. Door side jambs must be smooth, straight and parallel, out of plumb must not exceed 2mm/m (total deviation at full length 5 mm) in any direction.
9. Any footings at bottom of jamb columns must not interfere with installation of guide rails at floor level.
10. At time of installation, finished floor, free from obstructions, out to a distance of 2 m on each side of door centreline must be available.
11. Header box must be accessible from both sides during installation.


DOOR PROPERTIES:

12. The door is designed to withstand a differential pressure of 1.15kPa X 1.5 FOS.
13. Metal trim: motor side
14. Side profiles
15. Fabric colour: Please specify

ELECTRICAL:

14. One main control panel provided of PLC type.
15. Audible and visual alarm
16. Safety edge
17. Back-up power switch
18. Approx. size of main control panel: WxHxD (500mm x 600mmx250 mm),
19. Power: 1.4kW
20. Nom. current: 3.3A
21. (max. allowed voltage drop at start: 5%)

BELT HOIST UNITS:
Sk 773.1-90S/4 Z dual brake

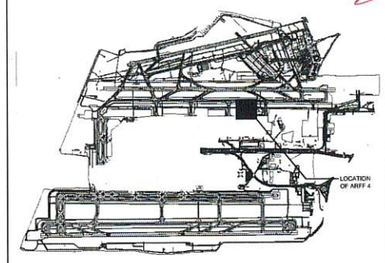

KEY PLAN (NOT TO SCALE)

NOTE:
1. 275 MM RCC COLUMN REQUIRED FOR GUIDE MOUNTING.
IF RCC COLUMN NOT AVAILABLE THEN WE WILL REQUIRE MS STRUCTURE FOR THE SAME.

REFERENCE DRAWING :
DIAL-LT-D-UTL-A-20-300 : ARFF4 FIRE STATION ELEVATIONS
DIAL-LT-D-UTL-A-20-301 : ARFF4 FIRE STATION ELEVATIONS
DIAL-LT-D-UTL-A-10-300 : ARFF4 FIRE STATION GROUND FLOOR PLAN

L&T Construction
Buildings & Factories

A APPROVED. PROCEED FOR MANUFACTURE/ CONSTRUCTION.
B APPROVED WITH COMMENTS. PROCEED TO MANUFACTURE/ CONSTRUCTION SUBJECT TO COMPLIANCE OF ALL COMMENTS AND RESUBMIT THE DOCUMENTS ONLY FOR LEVEL A APPRO
C RESUBMIT AFTER INCORPORATION OF ALL COMMENTS FOR REVIEW.
D REJECTED. MAKE A RESUBMISSION ALTOGETHER FOR REVIEW.

REVIEW OF THIS DOCUMENT IS ONLY TO CHECK COMPATIBILITY WITH BASIC DESIGN. THIS DOES NOT ABSOLVE THE SUB-CONTRACTOR/ MANUFACTURER FROM HIS RESPONSIBILITY TO MEET THE REQUIREMENT AS PER SPECIFICATIONS, CODES & STANDARDS, APPLICABLE LAW STATUTORY RULES & REGULATIONS, AS EXISTING OR AS MAY BE AMENDED TIME TO TIME.

CHECKED
LETTER REF:
VERIFIED BY : DEBABRATA PAL
DESIGNATION : HEAD ARCHITEC
DATE :
SIGNATURE :

SHOP DRAWING

REV.NO.	DESCRIPTION	DESIGNED	DRAWN	CHECKED	APPROVED

REVISIONS

CHECKED BY	SIGN	DATE	CHECKED BY	SIGN	DATE	CHECKED BY	SIGN	DATE
ARCHITECTURE			HVAC			QS		
CIVIL & STRUCTURAL			FPS			GEOTECH.		
ELECTRICAL			PIPING			AIRPORT SYSTEMS		
ELV SYSTEM			PHE			INTERFACE		

DELHI INDIRA GANDHI INTERNATIONAL AIRPORT GAR
L&T Construction

CLIENT : DIAL INTERNATIONAL AIRPORT LIMITED.
PROJECT: NEW GREEN INTERNATIONAL AIRPORT PHASE-3A DEVELOPMENT WORKS
CONCEPT : ASSA ABLOY
PROJECT CONSULTANT: Engineering Design and Research Center L&T Construction (EDRC)
INSTALLED AND SUPPLIED BY: MIWA TECHNOLOGIES PVT LTD

JOB No : JOBNO.	NAME	SIGN	DATE
DSGN	G.L.P		02.10.2021
DRWN	G.L.P		02.10.2021
CHKD	A.K.		02.10.2021
APPD	V.T.		02.10.2021

TITLE: ARFF4 MEGADOOR 5800 X 5400 (RS6)
SCALE
SCALE
DRAWING No. DIAL-LT-Q-PTB-A-HSRS-ARFF4-02
SHEET:
PROJECTION FIRST ANGLE
SIZE A3
REV 0
RELEASED FOR ☐ PRELIMINARY ☐ TENDER ☐ INFORMATION ☑ APPROVAL ☐ CONSTRUCTION