

PLAN LAYOUT

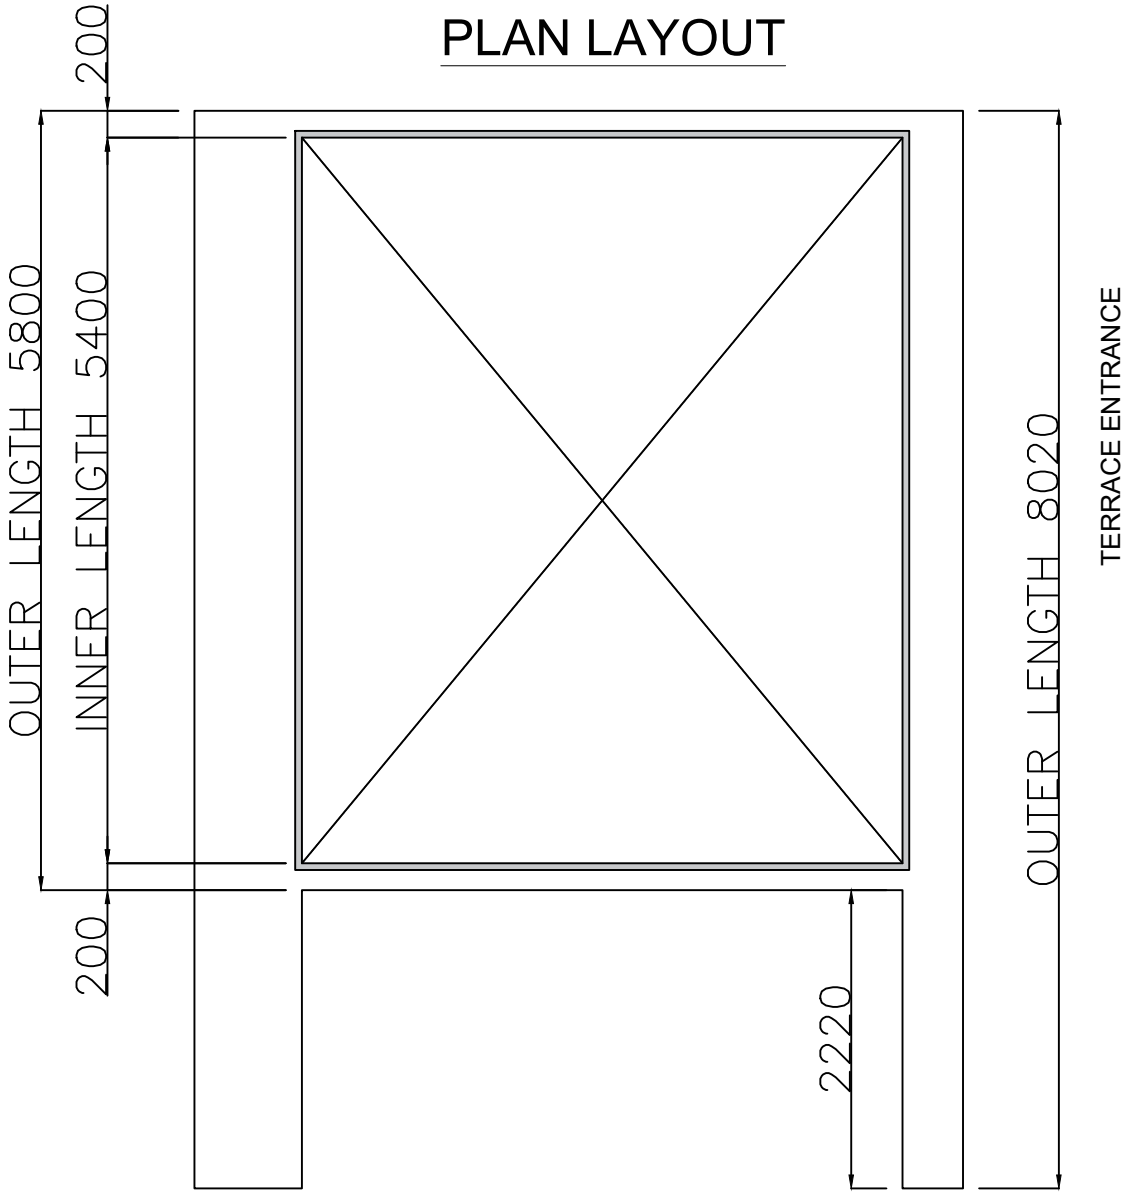

PLAN

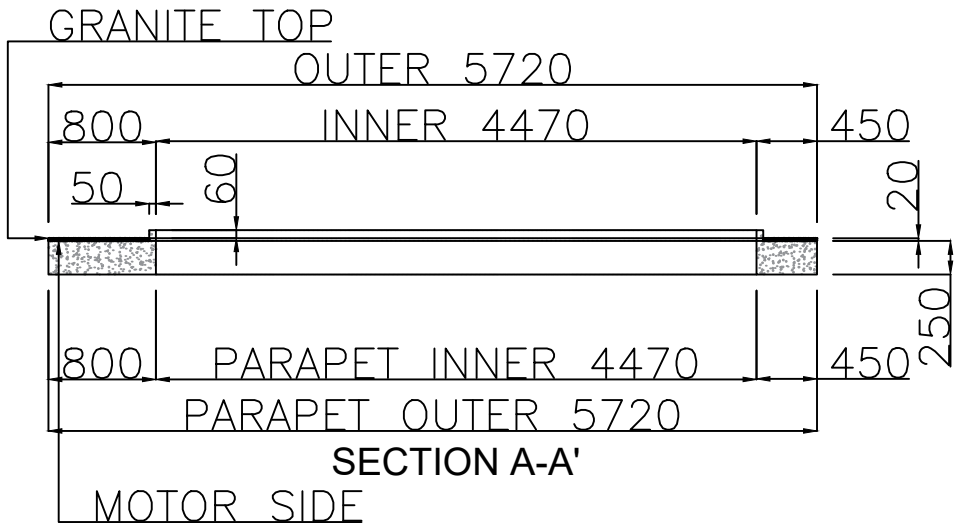

SECTION A-A'

MOTOR SIDE

1. THE STRUCTURE AROUND THE CUT OUT SHOULD BE OF CONCRETE FOR PROPER FASTENING OF SLIDING ROOF.
2. INNER PROJECTION OF 50X60MM REQUIRED AS A SINGLE STRUCTURE WITHOUT ANY JOINT TO AVOID WATER SEEPAGE INSIDE.
3. TOP SURFACE SHOULD BE OF GRANITE 20MM FOR SMOOTH FUNCTIONING OF ROOF.
4. GRADIENT OF 50MM NEED TO BE PROVIDED ALONG THE OUTER LENGTH TO AVOID WATER STAGNANCY IN GUIDE RAIL.
5. WE REQUIRE 250 MM HIGH CONCRETE FOR ANCHORING THE ROOF FROM THE BASE.
6. ALL THE JOINT SHOULD BE LEAK PROOF ON SITE.
7. PARAPET REFERENCE GIVEN AS PER THE PLANNED ROOF LAYOUT PROVIDED BY CLIENT.
8. ELECTRICAL CONNECTION - 5 AMP, 220V SINGLE PHASE.
9. ALL DIMENSION ARE IN MM.